

Technical Information

iTHERM TrustSens TM371, TM372

Compact thermometer for hygienic and aseptic applications

HART®-Protocol

Outstanding sensor technology with self-calibrating function

100% Compliance - 0% Effort



Applications

- Specially designed for use in hygienic and aseptic applications in the Food & Beverages and Life Sciences industries
- Measuring range: -40 to $+160$ °C (-40 to $+320$ °F)
- Pressure range up to 50 bar (725 psi)
- Protection class: IP67/68 or IP69K
- Communication: Analog output 4 to 20 mA, HART® protocol

Your benefits

- Risk and cost reduction thanks to self-calibration and 'Heartbeat technology'
- Fully automated, traceable, inline self-calibration
- Automatized documentation, memory for 350 self-calibration points
- Printable calibration certificate - audit proof
- Elimination of nonconformity or undetected failures
- International certifications, regulations (EC/EU), approvals and declarations of conformity:
 - EHEDG, ASME BPE, FDA, 3-A, EC 1935/2004, EC 2023/2006, EU 10/2011
 - CE/EAC, CRN, CSA General Purpose
- Highest measurement accuracy through sensor-transmitter matching
- Heartbeat Technology

Table of contents

Function and system design	3	Material	24
iTHERM TrustSens	3	Surface roughness	24
Measuring principle	3	Protection tube	25
Measuring system	3		
Equipment architecture	4	Operability	33
		Operating concept	33
Input	5	Local operation	33
Measuring range	5	Remote operation	33
		Certificates and approvals	34
Output	5	CE mark	34
Output signal	5	EAC mark	34
Failure information	5	cCSAus	34
Load	5	MTBF	34
Linearization/transmission behavior	5	Hygiene standard	34
Filter	5	Other standards and guidelines	34
Protocol-specific data	5	Parts in contact with the medium	34
		CRN approval	34
Wiring	6	Surface purity	35
Supply voltage	6	Material resistance	35
Current consumption	6	Material certification	35
Electrical connection	6	Calibration	35
Device plug connection	7	Protection tube testing and load capacity calculation	35
Overvoltage protection	7		
		Ordering information	35
Performance characteristics	7	Application packages	35
Reference operating conditions	7	Heartbeat diagnostics	35
Internal calibration point	7	Heartbeat verification	36
Measurement uncertainty	8	Heartbeat Monitoring	36
Long-term drift	8		
Influence of ambient temperature	8	Accessories	37
Influence of supply voltage	8	Device-specific accessories	37
Response time	9	Communication-specific accessories	40
Calibration	9	Service-specific accessories	41
Insulation resistance	11	System components	42
		Documentation	42
Installation	11		
Orientation	11		
Installation instructions	11		
Environment	13		
Ambient temperature range	13		
Storage temperature range	13		
Climate class	13		
Degree of protection	14		
Shock and vibration resistance	14		
Electromagnetic compatibility (EMC)	14		
Process	14		
Process temperature range	14		
Thermal shock	14		
Process pressure range	14		
Medium - state of aggregation	15		
Mechanical construction	15		
Design, dimensions	15		
Weight	24		


Function and system design

The iTHERM TrustSens thermometer incorporates a groundbreaking innovation – its self-calibration functionality. Under normal operation a standard Pt100 sensor element is being used. By means of a built-in, highly accurate reference sensor, the Pt100 measurement is automatically calibrated at a certain process temperature. This eliminates the need to remove the thermometer for calibration purposes. For more details please see chapter calibration.

iTHERM TrustSens

This thermometer is part of the compact thermometer line for hygienic and aseptic applications.

Differentiating factors when selecting a suitable thermometer

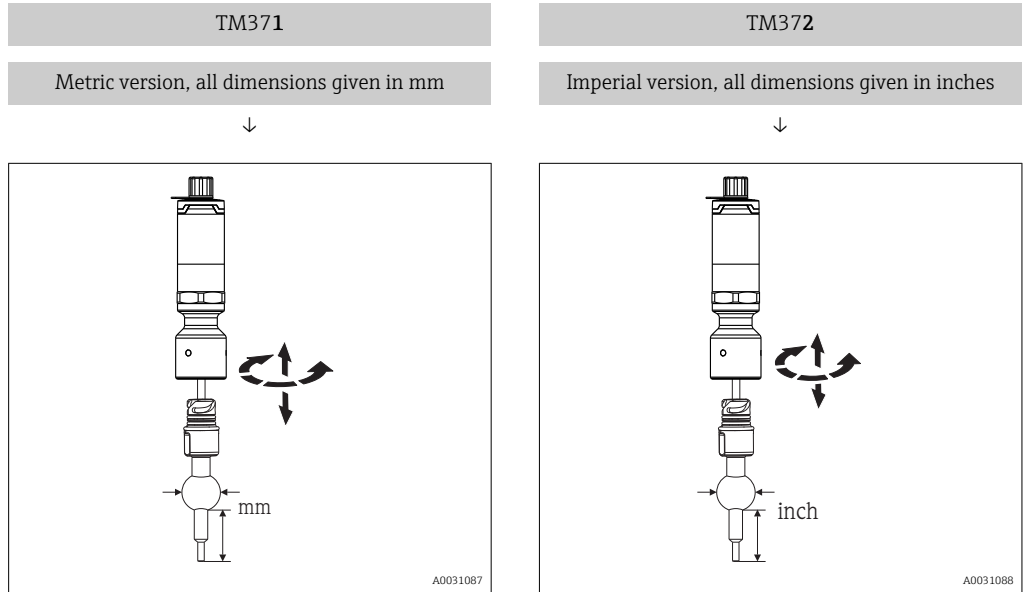

Measuring principle

Resistance thermometer (RTD)

These resistance thermometers use a Pt100 temperature sensor according to IEC 60751. The temperature sensor is a temperature-sensitive platinum resistor with a resistance of 100 Ω at 0 °C (32 °F) and a temperature coefficient $\alpha = 0.003851 \text{ } ^\circ\text{C}^{-1}$.

Thin film platinum resistance thermometers (TF): A ultrapure platinum layer, about 1 μm thick, is applied by vapor deposition in a vacuum on a ceramic substrate and then structured photolithographically. The platinum conductor paths formed in this way create the measuring resistance. Additional covering and passivation layers are applied and reliably protect the thin platinum layer from contamination and oxidation, even at high temperatures.

The primary advantages of thin film temperature sensors are their small sizes and good vibration resistance.


Measuring system

Endress+Hauser offers a complete portfolio of optimized components for the temperature measuring point – everything you need for the seamless integration of the measuring point into the overall facility. This includes:

- Power supply unit/barrier
- Display units
- Overvoltage protection



For more information, see the brochure 'System Products and Data Managers - Solutions for the loop' (FA00016K/EN)

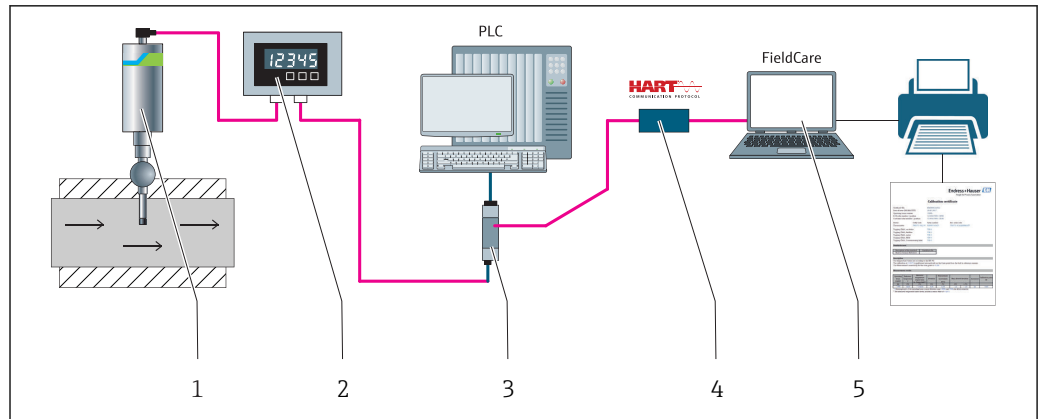

A0031089

1 Example of application, measuring point layout with additional Endress+Hauser components

- 1 Installed iTHERM compact thermometer with HART® communication protocol
- 2 RIA15 loop powered process display - It is integrated in the current loop and displays the measuring signal or HART® process variables in digital form. The process display unit does not require an external power supply. It is powered directly from the current loop. More information on this can be found in the Technical Information, see "Documentation", → 42.
- 3 Active barrier RN221N - The RN221N (24 V DC, 30 mA) active barrier has a galvanically isolated output for supplying voltage to loop-powered transmitters. The universal power supply works with an input supply voltage of 20 to 250 V DC/AC, 50/60 Hz, which means that it can be used in all international power grids. More information on this can be found in the Technical Information, see "Documentation", → 42.
- 4 Commubox FXA195 for intrinsically safe HART® communication with FieldCare via the USB interface.
- 5 FieldCare is a FDT-based plant asset management tool from Endress+Hauser, more details see section 'accessories'. The acquired self-calibration data is stored in the device (1) and can be read using FieldCare. This also enables an auditable calibration certificate to be created and printed.

Equipment architecture

Design	Options	
	1: Wiring, electrical connection, output signal 2: Transmitter housing	<p>i Your benefits:</p> <ul style="list-style-type: none"> ■ Optimum protection even with high-pressure cleaning: As standard IP67/68, optional IP69K protection ■ M12, 4pin connector: cost and time savings as well as incorrect wiring avoided ■ Compact built-in transmitter (4 to 20 mA, HART®)
	3: Extension neck	<ul style="list-style-type: none"> ■ Welded-in-place or removable ■ Optional with iTHERM QuickNeck bayonet joint <p>i Your benefits:</p> <ul style="list-style-type: none"> ■ iTHERM QuickNeck: tool-free removal of the compact thermometer ■ IP69K protection: safety under extreme process conditions
	4: Process connection → 25	More than 50 different versions.
	5: Protection tube	<ul style="list-style-type: none"> ■ Versions with and without protection tube (insert in direct contact with process). ■ Various diameters ■ Various tip shapes (straight or reduced)
	6: Insert	Sensor model: thin-film Pt100 sensor (TF) with iTHERM TrustSens technology.
		<p>i Your benefits:</p> <ul style="list-style-type: none"> ■ Risk and cost reduction thanks to Heartbeat technology ■ Fully automated, traceable, inline self-calibration ■ Automated documentation, memory for the last 350 calibration points ■ Printable calibration certificate - audit proof ■ No risk of unconformity or undetected failures ■ International certifications and approvals

A0031106

Input

Measuring range	Pt100 thin-film (TF)	-40 to +160 °C (-40 to +320 °F)
-----------------	----------------------	---------------------------------


Output

Output signal	Analog output	4 to 20 mA
	Digital output	HART® protocol (revision 7)

Failure information **Failure information as per NAMUR NE43:**
 Failure information is created if the measuring information is missing or not valid. A complete list of all the errors occurring in the measuring system is created.

Underranging	Linear decrease from 4.0 to 3.8 mA
Overranging	Linear increase from 20.0 to 20.5 mA
Failure, e.g. sensor breakage, sensor short-circuit	≤ 3.6 mA ("low") or ≥ 21 mA ("high"), can be selected The "high" alarm setting can be set between 21.5 mA and 23 mA, thus providing the flexibility needed to meet the requirements of various control systems.

Load Maximum possible HART® communication resistance

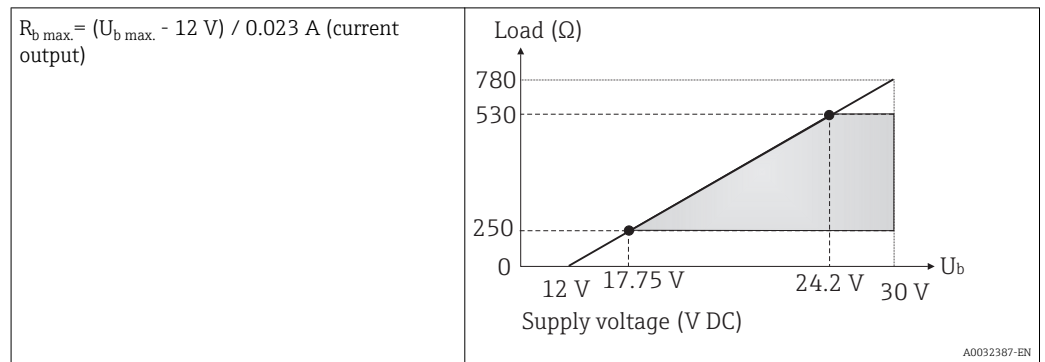

Linearization/transmission behavior Temperature-linear

Filter 1st order digital filter: 0 to 120 s, factory setting: 0 s (PV)

Protocol-specific data HART

Manufacturer ID	17 (0x11)
Device type ID	0x11CF
HART revision	7
Device description files (DTM, DD)	Information and files at: <ul style="list-style-type: none"> ■ www.endress.com/downloads ■ www.fieldcommgroup.org
HART load	Min. 250 Ω

HART device variables	Measured value for PV (primary value) Temperature Measured values for SV, TV, QV (secondary, tertiary and quaternary variable) <ul style="list-style-type: none"> ▪ SV: Device temperature ▪ TV: Calibration counter ▪ QV: Calibration deviation
Supported functions	<ul style="list-style-type: none"> ▪ Additional transmitter status ▪ NE107 diagnostics

Startup behavior / wireless HART data


Minimum start-up voltage	12 V _{DC}
Start-up current	3.58 mA
Start-up time	< 7 s, until the first valid measured value signal is present at the current output
Minimum operating voltage	12 V _{DC}
Multidrop current	4 mA
Lead time	0 s

Wiring

 According to the 3-A Standard electrical connecting cables must be smooth, corrosion-resistant and easy to clean.

Supply voltage


$U_b = 12 \text{ to } 30 \text{ V}_{DC}$

 The device may only be powered by a power supply unit with a limited energy electric circuit in accordance with UL/EN/IEC 61010-1 chapter 9.4 or Class 2 according to UL 1310, "SELV or Class 2 circuit".


Current consumption

- $I = 3.58 \text{ to } 23 \text{ mA}$
- Minimum current consumption: $I = 3.58 \text{ mA}$, multi-drop mode $I = 4 \text{ mA}$
- Maximum current consumption: $I \leq 23 \text{ mA}$

Electrical connection

 To prevent any kind of damage from the device electronics, leave the pins 2 and 4 unconnected. They are reserved for the connection of the configuration cable.


Do not tighten the M12 plug too much, in order to prevent damage to the device. Maximum torque: 0.4 Nm (M12 knurl)

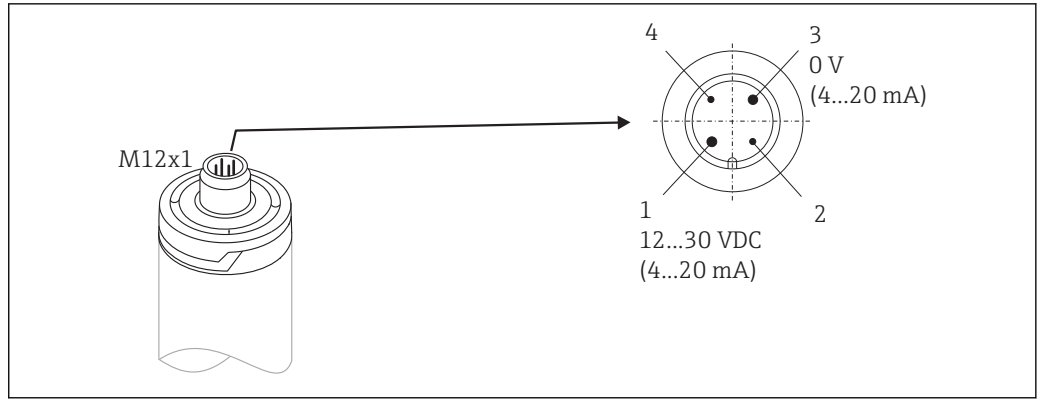

2 Pin assignment of the device connecting socket

- 1 Power supply 12 to 30 V_{DC}; current output 4 to 20 mA
- 2 Reserved for configuration cable
- 3 Power supply 0 V_{DC}; current output 4 to 20 mA
- 4 Reserved for configuration cable

Device plug connection

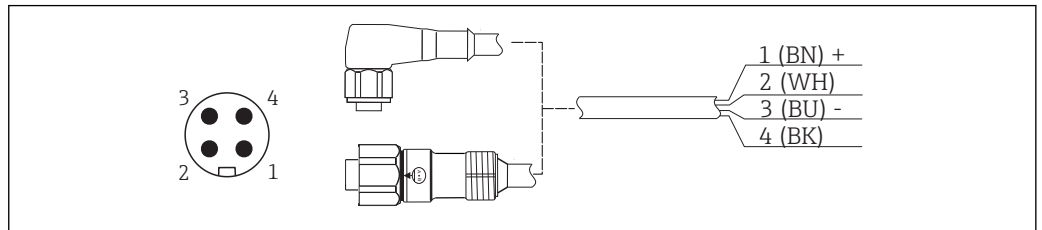

3 Pin assignment of the plug connector

- 1 Power supply +, wire color brown = BN
- 2 Connection of PC configuration cable, wire color white = WH
- 3 Power supply -, wire color blue = BU
- 4 Connection of PC configuration cable, wire color black = BK

i Appropriate cord sets with straight or angle plugs are available as accessory.

Overvoltage protection

To protect against overvoltage in the power supply and signal/communication cables for the thermometer electronics, Endress+Hauser offers the HAW562 surge arrester for DIN rail mounting.

i For more information see the Technical Information 'HAW562 Surge arrester' TI01012K

Performance characteristics

Reference operating conditions

- Ambient temperature: 25 °C ± 5 °C (77 °F ± 9 °F)
- Supply voltage: 24 V_{DC}


Internal calibration point

- 118 °C (244.4 °F) +1.2 K / -1.7 K
- Lowest possible calibration point = 116.3 °C (241.3 °F)
- Highest possible calibration point = 119.2 °C (246.6 °F)

i The individual calibration point of each TrustSens device is indicated in the ex-works calibration certificate enclosed with the shipment.

Measurement uncertainty


The given uncertainty values include non-linearity and non-repeatability and correspond to 2σ (95% confidence level according to the Gaussian distribution curve).

Uncertainty of self-calibration of digital output (HART® value) at the calibration point.		< 0.35 °C (0.63 °F)
Uncertainty of the temperature sensor inclusive digital output (HART® value) at reference conditions in delivery state.	Process temperature: +20 to +135 °C (+68 to +275 °F) +135 to +160 °C (+275 to +320 °F) 0 to +20 °C (+32 to +68 °F) -20 to 0 °C (-4 to +32 °F) -40 to -20 °C (-40 to -4 °F)	< 0.22 °C (0.4 °F) < 0.38 °C (0.68 °F) < 0.27 °C (0.49 °F) < 0.46 °C (0.83 °F) < 0.8 °C (1.44 °F)
 Each iTHERM TrustSens is calibrated and matched by default before shipment to guarantee the given accuracy.		
Uncertainty of D/A converter (analog output current)		0.03 % of the measurement range

Long-term drift

Pt100 sensing element	< 1000 ppm/1000 h ¹⁾
A/D converter (digital output - HART®)	< 500 ppm/1000 h ¹⁾
D/A converter (analog output - current)	< 100 ppm/1000 h

1) This would be detected by the self-calibration

 Long-term drift decreases at an exponential rate over time. So it may not be extrapolated in a linear way for time spans longer than the above given values.

Influence of ambient temperature

A/D converter (digital output - HART®) at typical operating conditions	< 0.05 K (0.09 °F)
A/D converter (digital output - HART®) at maximum operating conditions	< 0.15 K (0.27 °F)
D/A converter (analog output - current)	≤ 30 ppm/°C (2σ), related to the deviation from the reference temperature

Typical operating conditions

- Ambient temperature: 0 to +40 °C (+32 to +104 °F)
- Process temperature: 0 to +140 °C (+32 to +284 °F)
- Power supply: 18 to 24 V_{DC}

Influence of supply voltage

According to IEC 61298-2:

A/D converter (digital output - HART®) at typical operating conditions	< 15 ppm/V ¹⁾
D/A converter (analog output - current)	< 10 ppm/V ¹⁾

1) Related to the deviation from the reference supply voltage

Sample calculation with Pt100, measuring range +20 to +135 °C (+68 to +275 °F), ambient temperature +25 °C (+77 °F), supply voltage 24 V:

Measured error digital	0.220 °C (0.396 °F)
Measured error D/A = 0.03 % x 150 °C (302 °F)	0.045 °C (0.081 °F)
Measured error digital value (HART):	0.220 °C (0.396 °F)
Measured error analog value (current output): $\sqrt{(\text{Measured error digital}^2 + \text{Measured error D/A}^2)}$	0.225 °C (0.405 °F)

Sample calculation with Pt100, measuring range +20 to +135 °C (+68 to +275 °F), ambient temperature +35 °C (+95 °F), supply voltage 30 V:

Measured error digital	0.220 °C (0.396 °F)
Measured error D/A = 0.03 % x 150 °C (302 °F)	0.045 °C (0.081 °F)
Influence of ambient temperature (digital)	0.050 °C (0.090 °F)
Influence of ambient temperature (D/A) = (35 °C - 25 °C) x (30 ppm/°C x 150 °C)	0.045 °C (0.081 °F)
Influence of supply voltage (digital) = (30 V - 24 V) x 15 ppm/V x 150 °C	0.014 °C (0.025 °F)
Influence of supply voltage (D/A) = (30 V - 24 V) x 10 ppm/V x 150 °C	0.009 °C (0.016 °F)
Measured error digital value (HART): $\sqrt{(\text{Measured error digital})^2 + \text{Influence of ambient temperature (digital)}^2 + \text{Influence of supply voltage (digital)}^2}$	0.226 °C (0.407 °F)
Measured error analog value (current output): $\sqrt{(\text{Measured error digital})^2 + \text{Measured error D/A}^2 + \text{Influence of ambient temperature (digital)}^2 + \text{Influence of ambient temperature (D/A)}^2 + \text{Influence of supply voltage (digital)}^2 + \text{Influence of supply voltage (D/A)}^2}$	0.235 °C (0.423 °F)

Response time Tests in water at 0.4 m/s (1.3 ft/s), according to IEC 60751; 10 K temperature step change. t_{63} / t_{90} are defined as the time that passes until the instrument output reaches 63% / 90% of the new value.

Response time with heat transfer paste ¹⁾

Protection tube	Shape of tip	Insert	t_{63}	t_{90}
ϕ6 mm (0.24 in)	Reduced 4.3 mm (0.17 in) x 20 mm (0.79 in)	ϕ3 mm (0.12 in)	2.9 s	5.4 s
ϕ9 mm (0.35 in)	Straight	ϕ6 mm (0.24 in)	9.1 s	17.9 s
	Reduced 5.3 mm (0.21 in) x 20 mm (0.79 in)	ϕ3 mm (0.12 in)	2.9 s	5.4 s
ϕ12.7 mm (½ in)	Straight	ϕ6 mm (0.24 in)	10.9 s	24.2 s
	Reduced 5.3 mm (0.21 in) x 20 mm (0.79 in)	ϕ3 mm (0.12 in)	2.9 s	5.4 s
	Reduced 8 mm (0.31 in) x 32 mm (1.26 in)	ϕ6 mm (0.24 in)	10.9 s	24.2 s

1) Between the insert and the protection tube.

Response time without heat transfer paste

Protection tube	Shape of tip	Insert	t_{63}	t_{90}
Without protection tube	-	ϕ6 mm (0.24 in)	5.3 s	10.4 s
ϕ6 mm (0.24 in)	Reduced 4.3 mm (0.17 in) x 20 mm (0.79 in)	ϕ3 mm (0.12 in)	7.4 s	17.3 s
ϕ9 mm (0.35 in)	Straight	ϕ6 mm (0.24 in)	24.4 s	54.1 s
	Reduced 5.3 mm (0.21 in) x 20 mm (0.79 in)	ϕ3 mm (0.12 in)	7.4 s	17.3 s
ϕ12.7 mm (½ in)	Straight	ϕ6 mm (0.24 in)	30.7 s	74.5 s
	Reduced 5.3 mm (0.21 in) x 20 mm (0.79 in)	ϕ3 mm (0.12 in)	7.4 s	17.3 s
	Reduced 8 mm (0.31 in) x 32 mm (1.26 in)	ϕ6 mm (0.24 in)	30.7 s	74.5 s

Calibration

Calibration of thermometers

Calibration involves comparing the measured values of a device under test (DUT) with those of a more precise calibration standard using a defined and reproducible measurement method. The aim is to determine the deviation of the DUT's measured values from the true value of the measured variable. Two different methods are used for thermometers:

- Calibration at fixed-point temperatures, e.g. at the freezing point of water at 0 °C,
- Comparison calibration against a precise reference thermometer.


The thermometer to be calibrated must display the fixed point temperature or the temperature of the reference thermometer as accurately as possible. Temperature-controlled calibration baths or special calibration furnaces with homogeneous distribution of temperature are typically used for

thermometer calibrations. The DUT and the reference thermometer are placed closely together into the bath or furnace at a sufficient depth.

The measurement uncertainty can increase due to heat conduction errors and short immersion lengths. The existing measurement uncertainty is listed on the individual calibration certificate.

For accredited calibrations according to IEC/ISO 17025, the measurement uncertainty must not be twice as high as the accredited measurement uncertainty of the laboratory. If the limit value is exceeded, only a factory calibration can be carried out.

i For manual calibration in calibration baths the maximum immersion length of the device ranges from the sensor tip to the lower part of the electronic housing. Do not immerse the housing into the calibration bath!

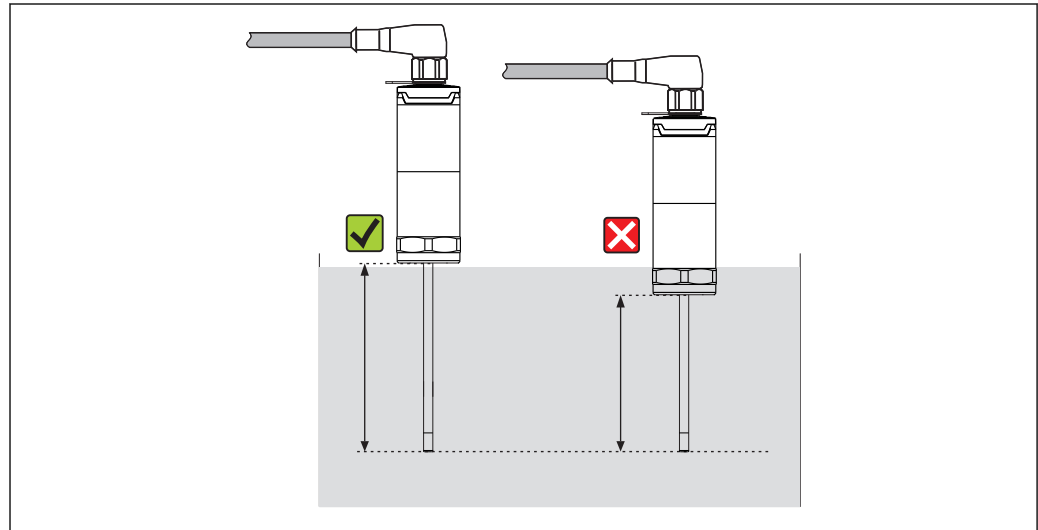

A0032391

Self-calibration


The self-calibration procedure uses the Curie temperature (T_c) of a reference material as a built-in temperature reference. A self-calibration is performed automatically, when the process temperature (T_p) falls below the nominal Curie Temperature (T_c) of the device. At the Curie temperature, a phase change of the reference material takes place, which is associated with a change in its electrical properties. The electronics automatically detects this change and simultaneously calculates the deviation of the measured Pt100-temperature to the known, physically fixed Curie temperature. The TrustSens thermometer is calibrated. A green flashing LED light indicates the ongoing self-calibration process. Subsequently the thermometer electronics stores the results of this calibration. The calibration data can be read via an asset management software like FieldCare or DeviceCare. A self-calibration certificate can be created automatically. This inline self calibration allows a continuous and repeated monitoring of changes to the Pt100 sensor and to the electronics' characteristics. As the inline calibration is being performed under real ambient or process conditions (e.g. heating of electronics), the result is closer to reality than a sensor calibration under laboratory conditions.

Process criteria for self-calibration

To ensure a valid self-calibration within the given measurement accuracy, the process temperature characteristics needs to fulfil the criteria, which are checked by the device automatically. Based on this, the device is ready to perform a self-calibration under the following conditions:

- Process temperature > calibration temperature +3 °C (5.4 °F) for 25 s before cooling down; $t_1 - t_2$.
- Cooling rate: 0.5 to 16.5 K/min (0.9 to 29.7 °F/min), while the process temperature crosses the Curie temperature; $t_2 - t_3 + 10$ s.

The process temperature ideally declines continuously below 116 °C (240.8 °F). A valid self-calibration process is done when the green LED flashes with a frequency 5 Hz for 5 s.

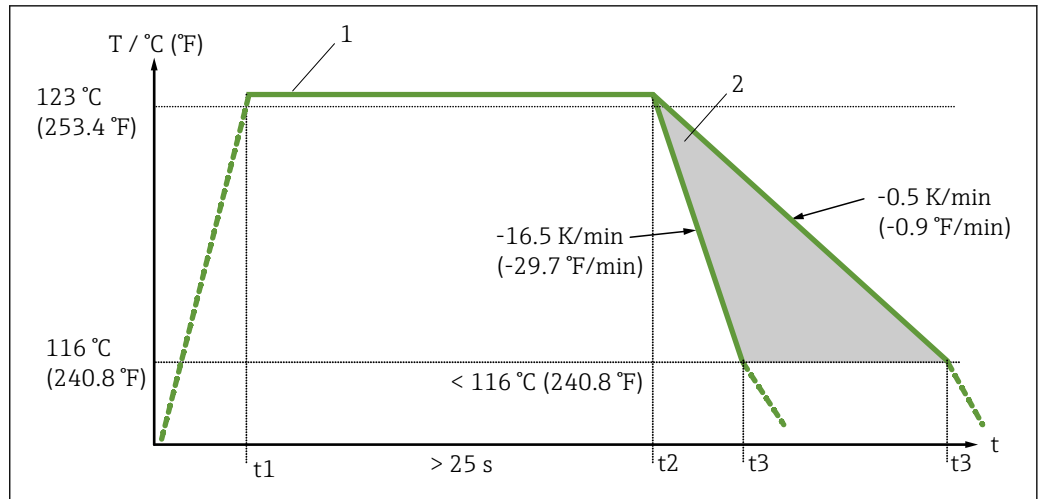

4 Needed process temperature profile for self-calibration

- 1 Process temperature 123 °C (253.4 °F)
- 2 Allowed self-calibration range

Calibration monitoring

Available in conjunction with Advanced Data Manager Memograph M (RSG45). → 42

Application package:

- Up to 20 devices can be monitored via the HART interface
- Self-calibration data displayed on screen or via the Web server
- Generation of a calibration history
- Creation of a calibration protocol as an RTF file directly at the RSG45
- Evaluation, analysis and further processing of the calibration data using "Field Data Manager" (FDM) analysis software

Insulation resistance

Insulation resistance $\geq 100 \text{ M}\Omega$ at ambient temperature.

Insulation resistance between the terminals and the outer jacket is measured with a minimum voltage of 100 V DC.

Installation


Orientation

No restrictions. However, self-draining in the process must be guaranteed. If there is an opening to detect leaks at the process connection, this opening must be at the lowest possible point.

Installation instructions

The immersion length of the thermometer can influence the accuracy. If the immersion length is too small then errors in the measurement are caused by heat conduction via the process connection. If installing into a pipe then the immersion length should ideally be half of the pipe diameter.

Installation possibilities: Pipes, tanks or other plant components

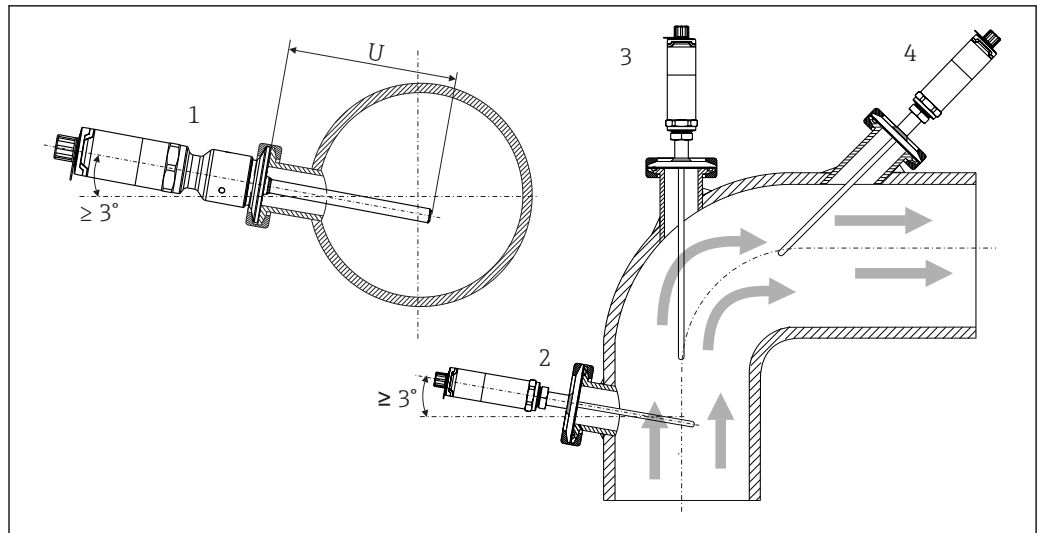


A0031007

5 Installation examples

- 1, 2 Perpendicular to flow direction, installed at a min. angle of 3° to ensure self-draining
- 3 On elbows
- 4 Inclined installation in pipes with a small nominal diameter
- U Immersion length


i In the case of pipes with a small nominal diameter, it is advisable for the tip of the thermometer to project well into the process so that it extends past the pipe axis. Installation at an angle (4) could be another solution. When determining the immersion length or installation depth all the parameters of the thermometer and of the medium to be measured must be taken into account (e.g. flow velocity, process pressure).

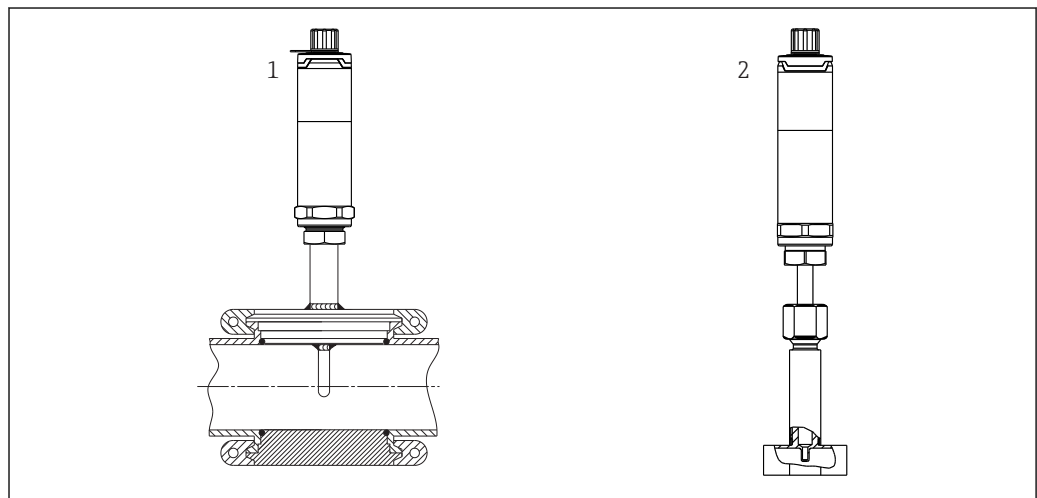

A0031022

6 Process connections for thermometer installation in pipes with small nominal diameters

- 1 Varivent® process connection type N for DN40
- 2 Corner-piece or T-piece (illustrated) for weld-in as per DIN 11865 / ASME BPE 2012

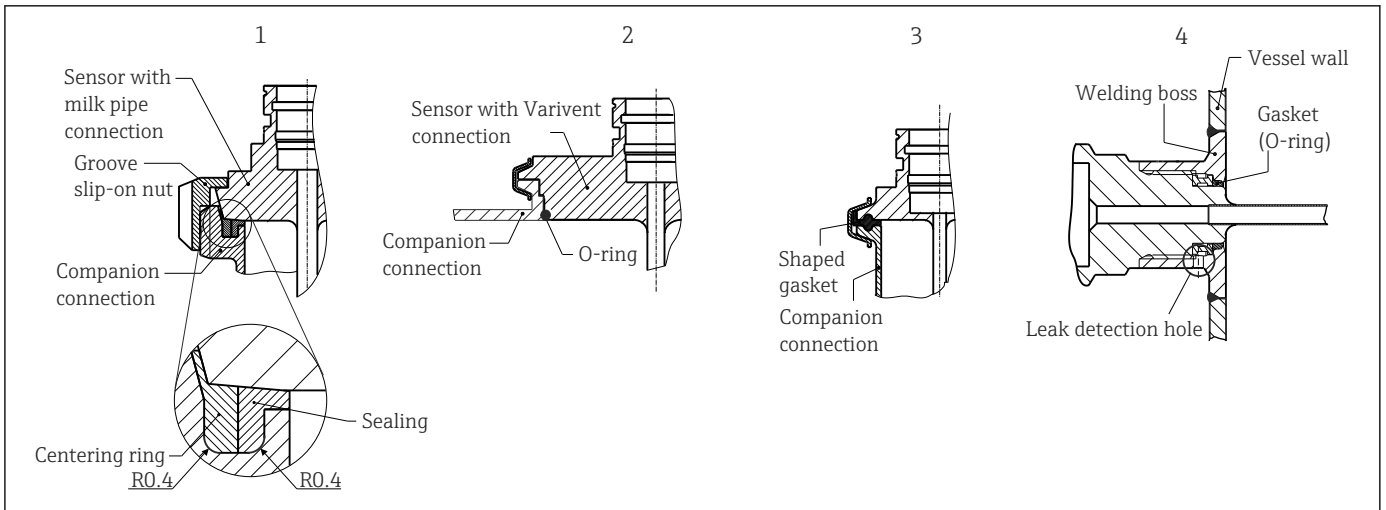

A0011758-EN

7 Detailed installation instructions for hygiene-compliant installation

- 1 Sanitary connection according to DIN 11851, only in connection with EHEDG-certified and self-centering sealing ring
- 2 Varivent® process connection for VARINLINE® housing
- 3 Clamp according to ISO 2852
- 4 Liquiphant-M G1" process connection, horizontal installation

i The counterpieces for the process connections and the seals or sealing rings are not included in the scope of supply for the thermometer. Liquiphant M weld-in adapters with associated seal kits are available as accessories.

Procedure in case of seal failure indicated by leak detection port:

- Disassembling of the thermometer, validated cleaning procedure of thread and and sealing ring groove
- Replacement of the seal or sealing ring
- CIP after re-assembly

In the case of weld-in connections, exercise the necessary degree of care when performing the welding work on the process side:

- Suitable welding material
- Flush-welded or with welding radius > 3.2 mm (0.13 in)
- No pits, folds, crevices or cracks
- Polished surface, $R_a \leq 0.76 \mu\text{m}$ (30 μin)



As a general rule, the thermometers should be installed in such a way that does not impact their ability to be cleaned (the requirements of the 3-A Sanitary Standard must be observed). The Varivent® and Liquiphant-M weld-in adapter and Ingold (+ weld-in adapter) connections enable flush-mounted installation.

Environment

Ambient temperature range	Ambient temperature T_a	-40 to +60 °C (-40 to +140 °F)
	Maximum electronics temperature T	-40 to +85 °C (-40 to +185 °F)

Storage temperature range $T = -40$ to $+85$ °C (-40 to +185 °F)

Climate class As per IEC 60654-1, Class Dx

Degree of protection	<ul style="list-style-type: none"> ■ IP54 for the version without protection tube provided for installation in an existing protection tube ■ IP67/68 for housing with LED status indication ■ IP69K for housing without LED status indication and only if appropriate cord-set with M12x1 coupling is connected. →  40 <p> The specified rating IP67/68 or IP69K for the compact thermometer is only assured when an approved M12 connector with a suitable IP rating is installed according to its manual.</p>
-----------------------------	--

Shock and vibration resistance	Endress+Hauser temperature sensors meet the requirements of IEC 60751 which specify shock and vibration resistance of 3g in the range from 10 to 500 Hz. This also applies for the quick-fastening iTHERM QuickNeck.
---------------------------------------	--



Electromagnetic compatibility (EMC)	<p>EMC to all relevant requirements of the IEC/EN 61326 - series and NAMUR Recommendation EMC (NE21). For details, refer to the Declaration of Conformity. All tests were passed both with and without ongoing HART® communication.</p> <p>All EMC measurements were performed with a turn down (TD) = 5:1. Maximum fluctuations during EMC- tests: < 1% of measuring span.</p> <p>Interference immunity to IEC/EN 61326 - series, requirements for industrial areas.</p> <p>Interference emission to IEC/EN 61326 - series, electrical equipment Class B.</p>
--	---

Process

Process temperature range	T_p	-40 to +160 °C (-40 to +320 °F)
----------------------------------	-------	---------------------------------


Reference sensor defective if temperature range of -45 to +200 °C (-49 to +392 °F) is exceeded. Temperature measurement continues, but selfcalibration is out of function.

Thermal shock	Thermal shock resistance in CIP/SIP process with a temperature increase and decrease from +5 to +130 °C (+41 to +266 °F) within 2 seconds.
----------------------	--

Process pressure range	<p>The maximum static process pressure is limited by the process connection, see respective section. →  25</p> <p> It is possible to check the mechanical loading capacity as a function of the installation and process conditions online in the TW Sizing Module for protection tubes in the Endress+Hauser Applicator software. This is valid for DIN thermowell calculations. See 'Accessories' section.</p>
-------------------------------	--

Example of the permitted flow velocity depending on the immersion length and process medium

The highest flow velocity tolerated by the thermometer diminishes with increasing immersion length exposed to the stream of the fluid. In addition it is dependent on the diameter of the thermometer tip, on the kind of process medium, on the process temperature and on the process pressure. The following figures exemplify the maximum permitted flow velocities in water at a process pressure of 40 bar (580 PSI) and superheated steam at a process pressure of 6 bar (87 PSI).

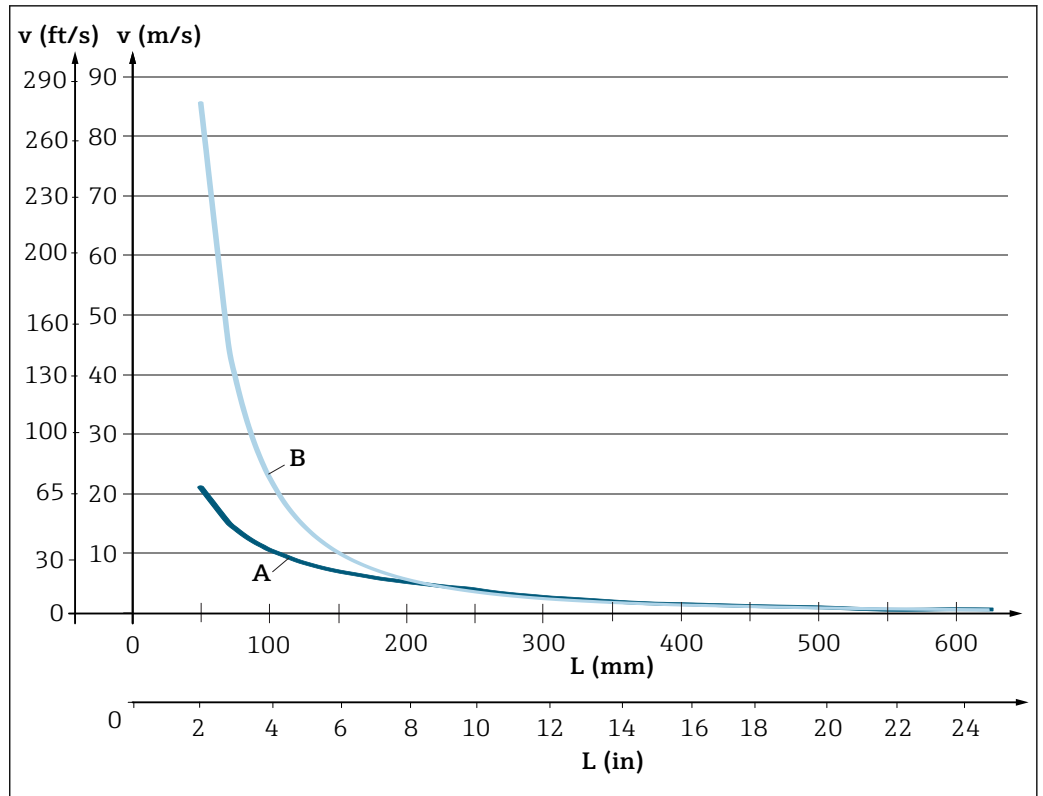

8 Permitted flow velocities, protection tube diameter 9 mm (0.35 in)

- A Medium water at $T = 50\text{ °C}$ (122 °F)
- B Medium superheated steam at $T = 160\text{ °C}$ (320 °F)
- L Immersion length exposed to flow
- v Flow velocity

Medium - state of aggregation

Gaseous or liquid (also with high viscosity, e.g. yogurt).

Mechanical construction

Design, dimensions

All dimensions in mm (in). The design of the thermometer depends on the protection tube version used:

- Thermometer without a protection tube
- Diameter 6 mm (0.24 in)
- Diameter 9 mm (0.35 in)
- Diameter 12.7 mm ($\frac{1}{2}$ in)
- T-piece and corner-piece protection tube version as per DIN 11865 / ASME BPE 2012 for weld-in

i Various dimensions, such as the immersion length U for example, are variable values and are therefore indicated as items in the following dimensional drawings.


Variable dimensions:

Item	Description
E	Extension neck length, variable depending on the configuration or predefined for the version with iTHERM QuickNeck
L	Protection tube length (U+T)
B	Protection tube bottom thickness: predefined, depends on protection tube version (see also the individual table data)
T	Length of protection tube shaft: variable or predefined, depends on protection tube version (see also the individual table data)

Item	Description
U	Immersion length: variable, depending on the configuration
∅ID	Insert diameter 6 mm (0.24 in) or 3 mm (0.12 in)

Without protection tube

For installation with compression fitting TK40 as process connection and the insert in direct contact with the process or in an existing protection tube.

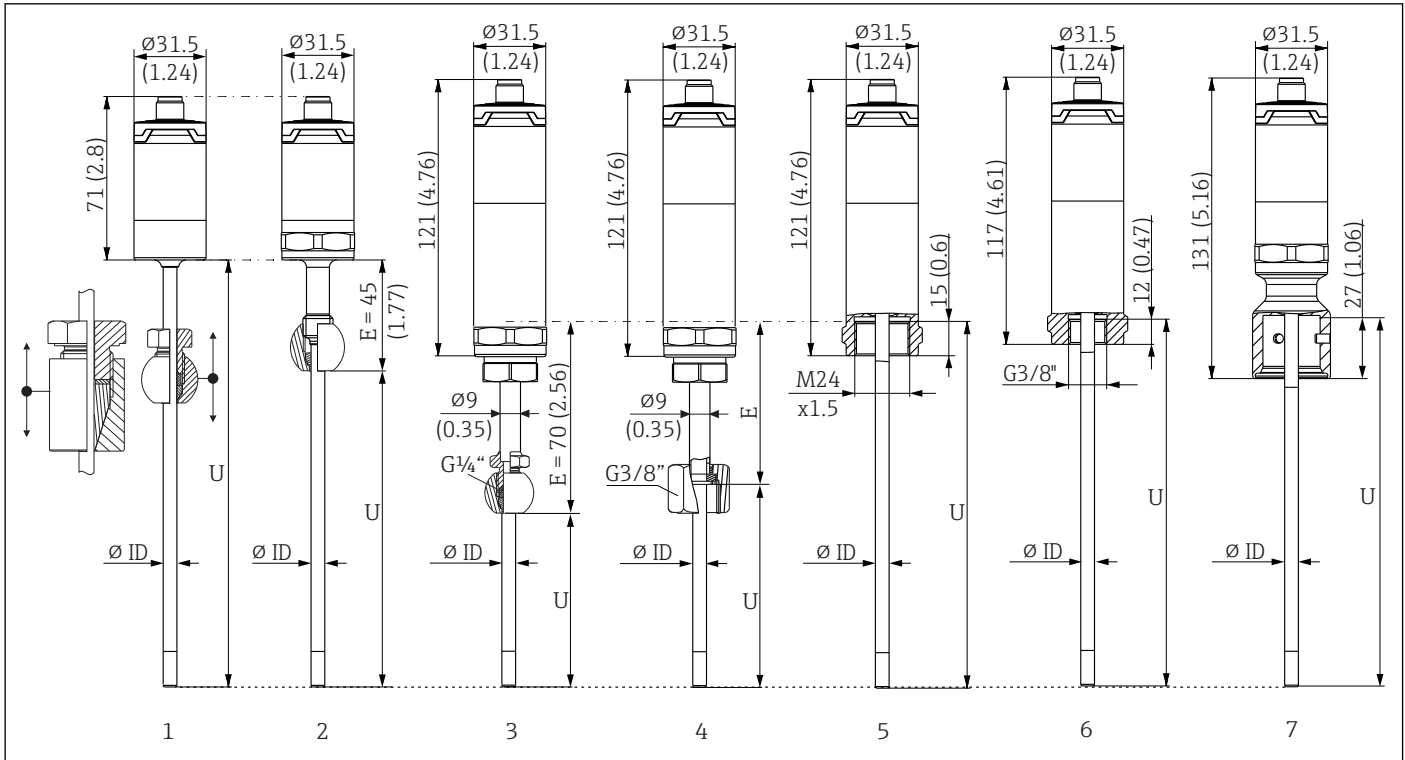

A0031214


- 1 Thermometer without extension neck, for mounting with adjustable compression fitting TK40, spherically and cylindrically, only $\varnothing ID = 6 \text{ mm}$
- 2 Thermometer with extension neck, for mounting with compression fitting TK40 in fix position, only $\varnothing ID = 6 \text{ mm}$
- 3 Thermometer with compression fitting TK40 fixed by extension neck, connection thread M24x1.5, $\varnothing ID = 6 \text{ mm}$
- 4 Thermometer with neck tube TE411, G3/8" thread adapter nut
- 5 Thermometer with M24x1.5 female thread for protection tube connection, e.g. TT411, $\varnothing ID = 3 \text{ mm}$ or 6 mm
- 6 Thermometer with G3/8" female thread for protection tube connection, e.g. TT411, $\varnothing ID = 3 \text{ mm}$ or 6 mm
- 7 Thermometer with iTHERM QuickNeck top part for protection tube with QuickNeck connection, $\varnothing ID = 3 \text{ mm}$ or 6 mm

Item	Description
$U_{(\text{protection tube})}$	Immersion length of the protection tube available at point of installation
$T_{(\text{protection tube})}$	Shaft length of protection tube available at point of installation
E	Length of the extension neck at point of installation (provided one is available)
$B_{(\text{protection tube})}$	Base thickness of protection tube

Pay attention to the following equations when calculating the immersion length U for immersion into a protection tube TT411 already available:

Version 5	$U = U_{(\text{protection tube})} + T_{(\text{protection tube})} + E + 3 \text{ mm} - B_{(\text{protection tube})}$
Version 3, 4, 6 and 7	$U = U_{(\text{protection tube})} + T_{(\text{protection tube})} + 3 \text{ mm} - B_{(\text{protection tube})}$

With protection tube diameter 6 mm (0.24 in)

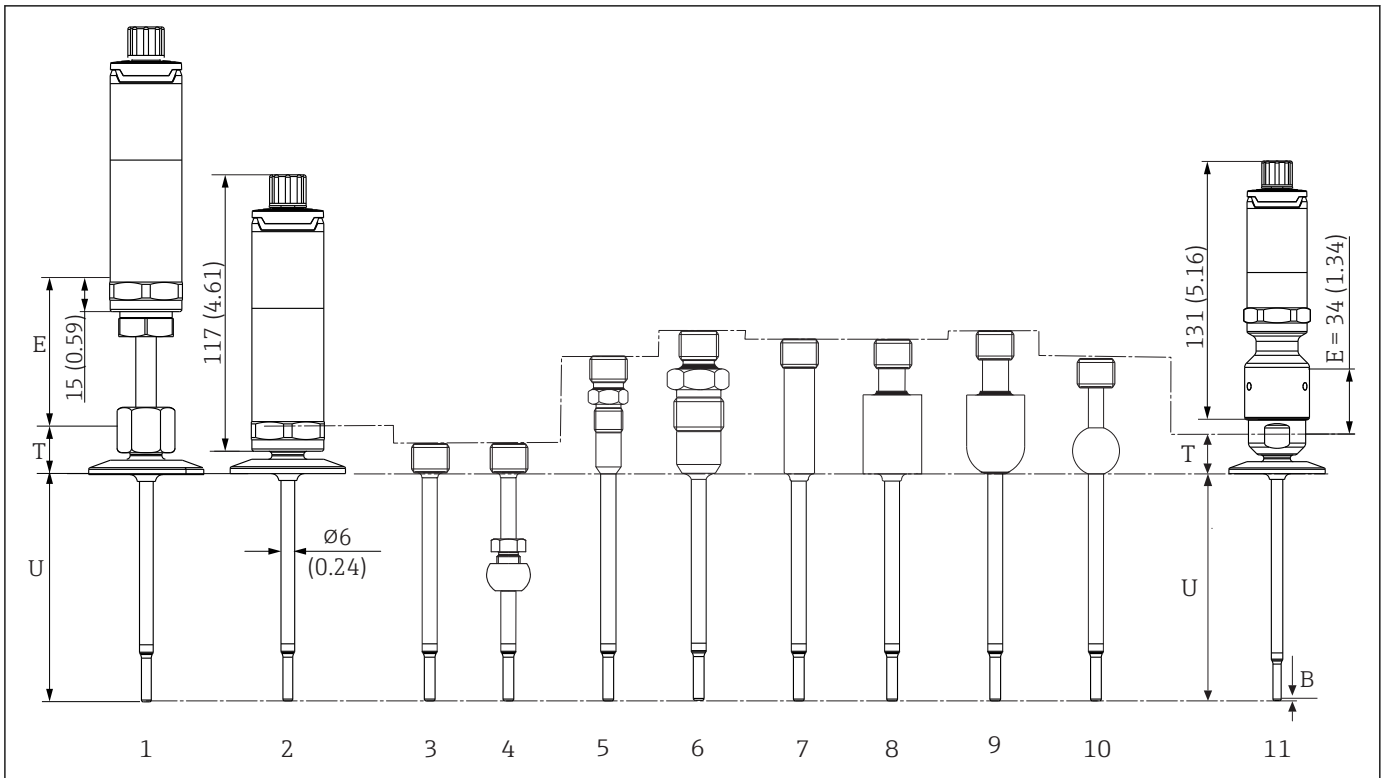

A0031254

- 1 Thermometer with extension neck and process connection as clamp version
- 2 Thermometer without extension neck and process connection as clamp version
- 3 Without process connection
- 4 Process connection version as spherical compression fitting TK40
- 5 Process connection version as metal sealing system M12x1
- 6 Process connection version as metal sealing system G½"
- 7 Process connection version as cylindrical weld-in adapter $\phi 12 \times 40$ mm
- 8 Process connection version as cylindrical weld-in adapter $\phi 30 \times 40$ mm
- 9 Process connection version as spherical-cylindrical weld-in adapter $\phi 30 \times 40$ mm
- 10 Process connection version as spherical weld-in adapter $\phi 25 \times$ mm
- 11 Thermometer with quick-fastening iTHERM QuickNeck and process connection as sanitary connection (clamp version)


G3/8" thread for protection tube connection

Item	Version	Length
Extension neck E	Without extension neck	-
	Replaceable extension neck	9 mm (0.35 in) - variable, depending on the configuration
	iTHERM QuickNeck	34 mm (1.34 in)
Length of protection tube shaft T ¹⁾	Clamp DN12 according to ISO 2852	24 mm (0.94 in)
	Clamp DN25/DN40 according to ISO 2852	21 mm (0.83 in)
	Without process connection (only G3/8" thread), where necessary with compression fitting TK40	12 mm (0.47 in)
	Metal sealing system M12x1	46 mm (1.81 in)
	Metal sealing system G½"	60 mm (2.36 in)
	Cylindrical weld-in adapter $\phi 12$ mm (0.47 in)	55 mm (2.17 in)
	Cylindrical weld-in adapter $\phi 30$ mm (1.18 in)	55 mm (2.17 in)

Item	Version	Length
	Spherical-cylindrical weld-in adapter	58 mm (2.28 in)
	Spherical weld-in adapter	47 mm (1.85 in)
	Tri-clamp (0.5"-0.75")	24 mm (0.94 in)
	Microclamp (DN8-18)	23 mm (0.91 in)
	Sanitary connection DN25/DN32/DN40 according to DIN 11851	29 mm (1.14 in)
Immersion length U	Independent of the version	Variable, depending on the configuration
Bottom thickness B	Reduced tip ϕ 4.3 mm (0.17 in)	2 mm (0.08 in)

1) Depends on the process connection


With protection tube diameter 9 mm (0.35 in)

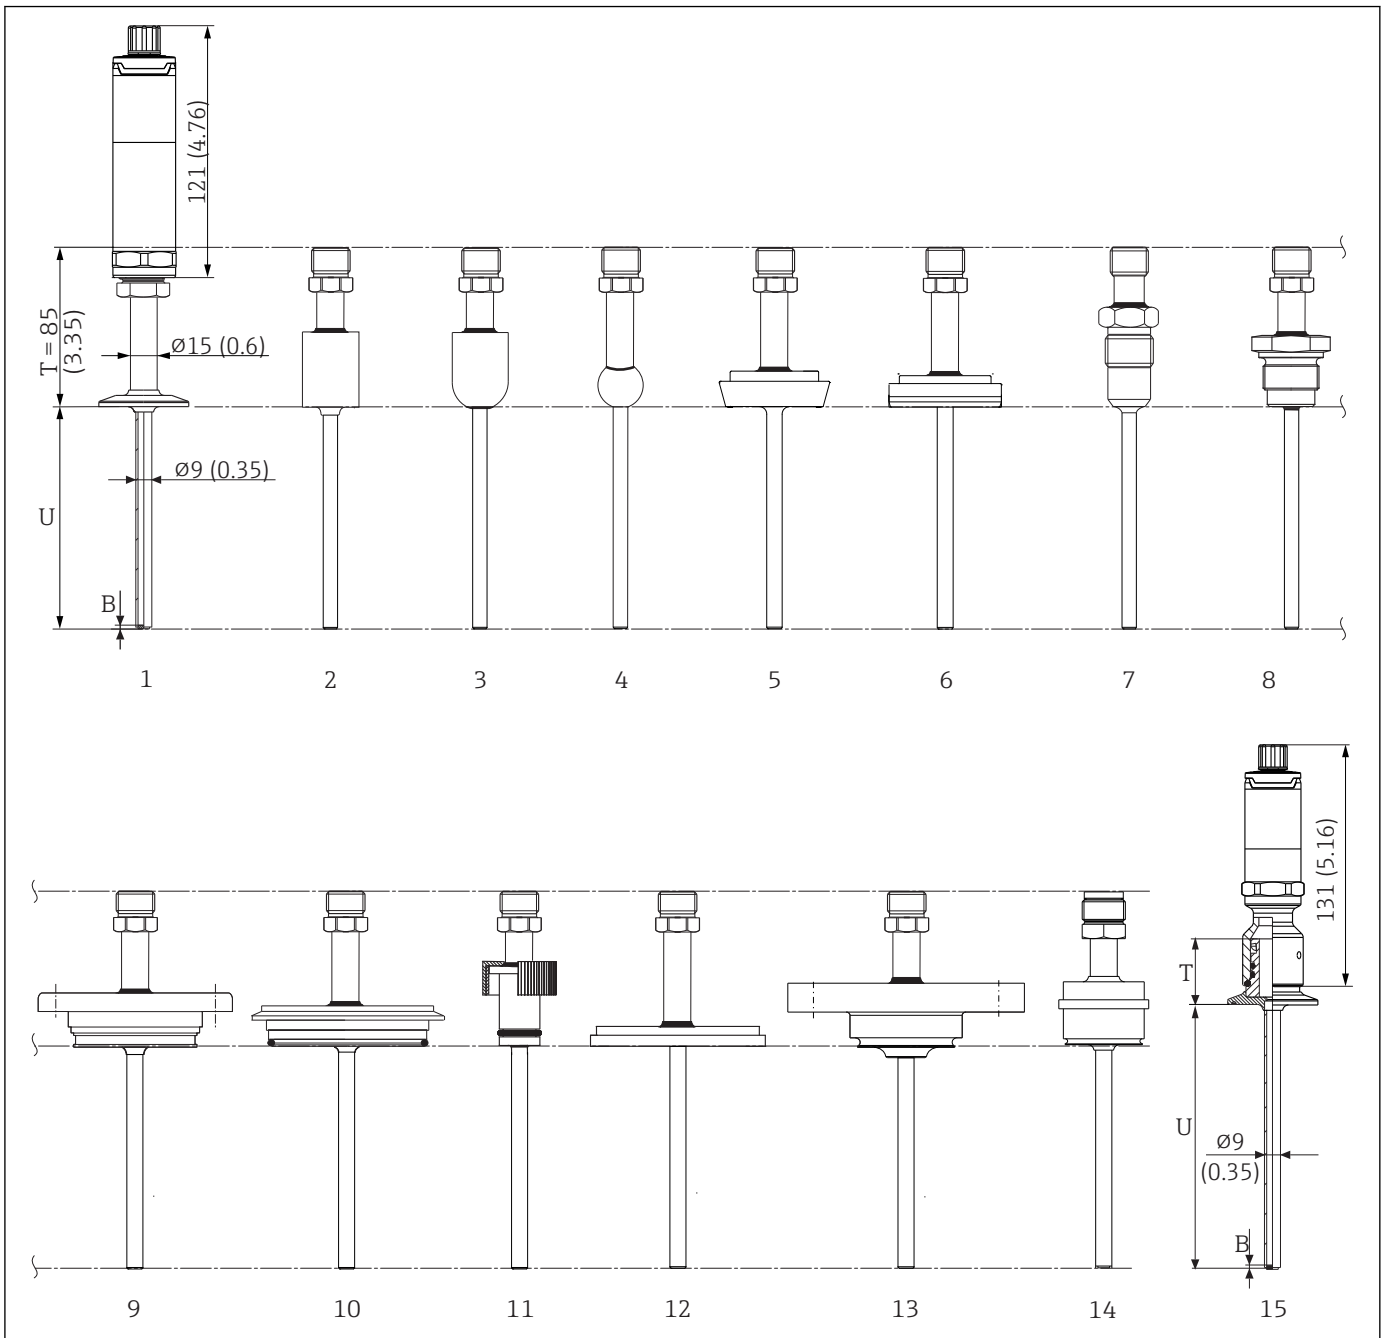

- 1 Thermometer with extension neck, process connection as clamp version
- 2 Process connection version as cylindrical weld-in adapter $\Phi 30 \times 40$ mm
- 3 Process connection version as spherical-cylindrical weld-in adapter $\Phi 30 \times 40$ mm
- 4 Process connection version as spherical weld-in adapter $\Phi 25 \times \text{mm}$
- 5 Process connection version as sanitary connection according to DIN 11851
- 6 Process connection version as aseptic pipe union according to DIN 11864-1 Form A
- 7 Process connection version as metal sealing system $G\frac{1}{2}$ "
- 8 Process connection version as thread according to ISO 228 for Liquiphant weld-in adapter
- 9 Process connection version APV Inline
- 10 Process connection version Varivent®
- 11 Process connection version Ingold connection
- 12 Process connection to SMS 1147
- 13 Process connection version Neumo Biocontrol
- 14 Process adapter D45
- 15 Thermometer with quick-fastening iTHERM QuickNeck and process connection, as clamp version for example

Item	Version	Length
Extension neck E	No separate extension neck available	-
Length of protection tube shaft T	Without quick-fastening iTHERM QuickNeck independent of the process connection	85 mm (3.35 in)
	Without quick-fastening iTHERM QuickNeck in combination with Ingold connection ø25 mm (0.98 in) x 46 mm (1.81 in)	100 mm (3.94 in)
	With quick-fastening iTHERM QuickNeck, depending on the process connection:	
	SMS 1147, DN25	40 mm (1.57 in)
	SMS 1147, DN38	41 mm (1.61 in)
	SMS 1147, DN51	42 mm (1.65 in)
	Varivent®, type F, D = 50 mm (1.97 in) Varivent®, type N, D = 68 mm (2.67 in)	52 mm (2.05 in)
	Varivent®, type B, D = 31 mm (1.22 in)	56 mm (2.2 in)
	Thread G1" according to ISO 228 for Liquiphant weld-in adapter	77 mm (3.03 in)
	Spherical-cylindrical weld-in adapter	70 mm (2.76 in)
	Cylindrical weld-in adapter	67 mm (2.64 in)
	Aseptic pipe union according to DIN11864-A, DN25	45 mm (1.77 in)
	Aseptic pipe union according to DIN11864-A, DN40	
	Sanitary connection according to DIN 11851, DN32	47 mm (1.85 in)
	Sanitary connection according to DIN 11851, DN40	
	Sanitary connection according to DIN 11851, DN50	
	Clamp according to ISO 2852, DN12	48 mm (1.89 in)
	Clamp according to ISO 2852, DN25	
	Clamp according to ISO 2852, DN40	
	Clamp according to ISO 2852, DN63.5	
	Clamp according to ISO 2852, DN70	39 mm (1.54 in)
	Microclamp (DN18)	
	Tri-clamp (0.75")	
	Ingold connection ø25 mm (0.98 in) x 30 mm (1.18 in)	78 mm (3.07 in)
Ingold connection ø25 mm (0.98 in) x 46 mm (1.81 in)	94 mm (3.7 in)	
Metal sealing system G½"	77 mm (3.03 in)	
APV-Inline, DN50	51 mm (2.01 in)	
Immersion length U	Independent of the version	Variable, depending on the configuration
Bottom thickness B	Reduced tip ø5.3 mm (0.21 in)x 20 mm (0.79 in)	2 mm (0.08 in)
	Straight tip	

With protection tube diameter 12.7 mm (½ in)

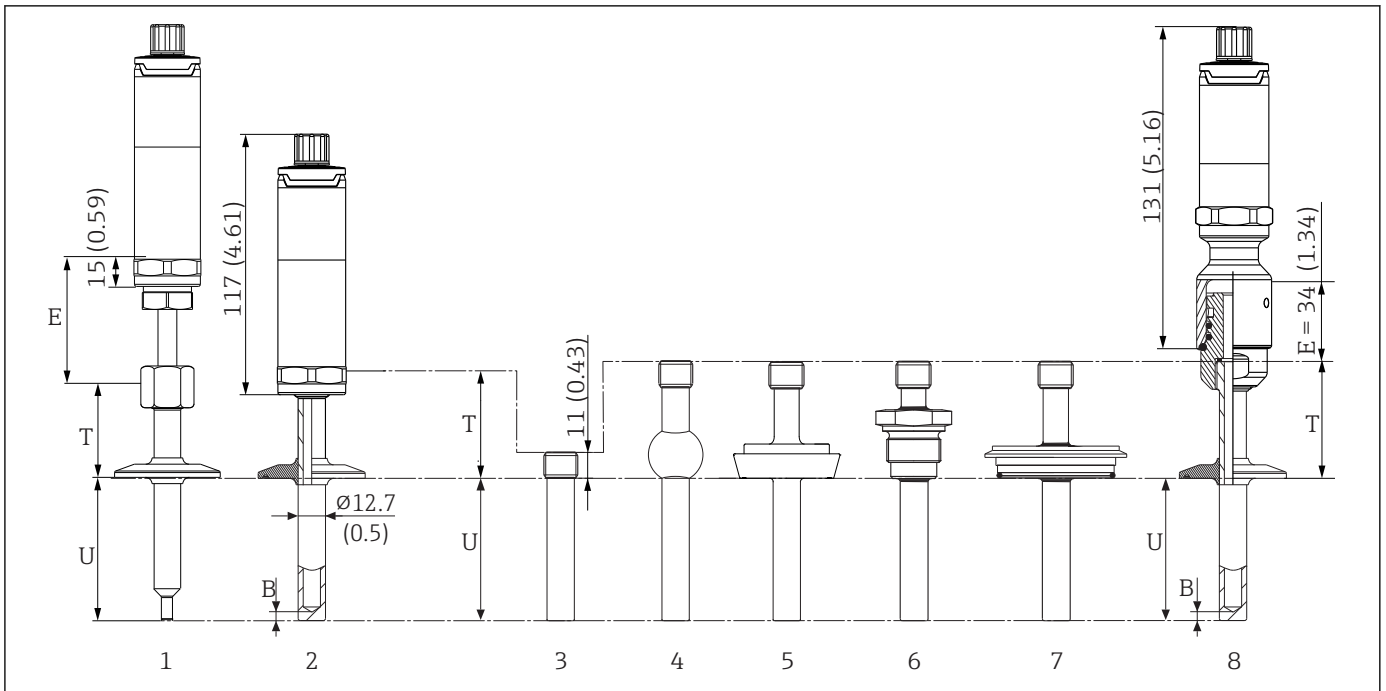


A0091372

- 1 Thermometer with standard extension neck, thread and process connection as clamp version
- 2 Thermometer with extension neck and process connection as clamp version
- 3 Process connection version as cylindrical weld-in adapter ϕ 12.7 mm (½ in)
- 4 Process connection version as spherical weld-in adapter ϕ 25 mm (1 in)
- 5 Process connection version as sanitary connection according to DIN 11851
- 6 Thread according to ISO 228 for Liquiphant weld-in adapter
- 7 Process connection version Varivent®
- 8 Thermometer with quick-fastening iTHERM QuickNeck and process connection, as clamp version for example

- G3/8" thread for protection tube connection
- Protection tube made from solid bar stock drilled for $L \leq 200$ mm (7.87 in)
- Welded protection tube for $L > 200$ mm (7.87 in)

Item	Version	Length
Extension neck E	Without extension neck	-
	Replaceable extension neck	9 mm (0.35 in) - variable, depending on the configuration
	iTHERM QuickNeck	34 mm (1.34 in)
Length of protection tube shaft T	Weld-in adapter, cylindrical, ϕ 12.7 mm (½ in)	12 mm (0.47 in)
	All other process connections	65 mm (2.56 in)
Immersion length U	Independent of the process connection	Variable, depending on the configuration
Bottom thickness B	Reduced tip ϕ 5.3 mm (0.21 in) x 20 mm (0.79 in)	2 mm (0.079 in)
	Reduced tip ϕ 8 mm (0.31 in) x 32 mm (1.26 in)	4 mm (0.16 in)
	Straight tip	6 mm (0.24 in)

With tee- or elbow piece protection tube version

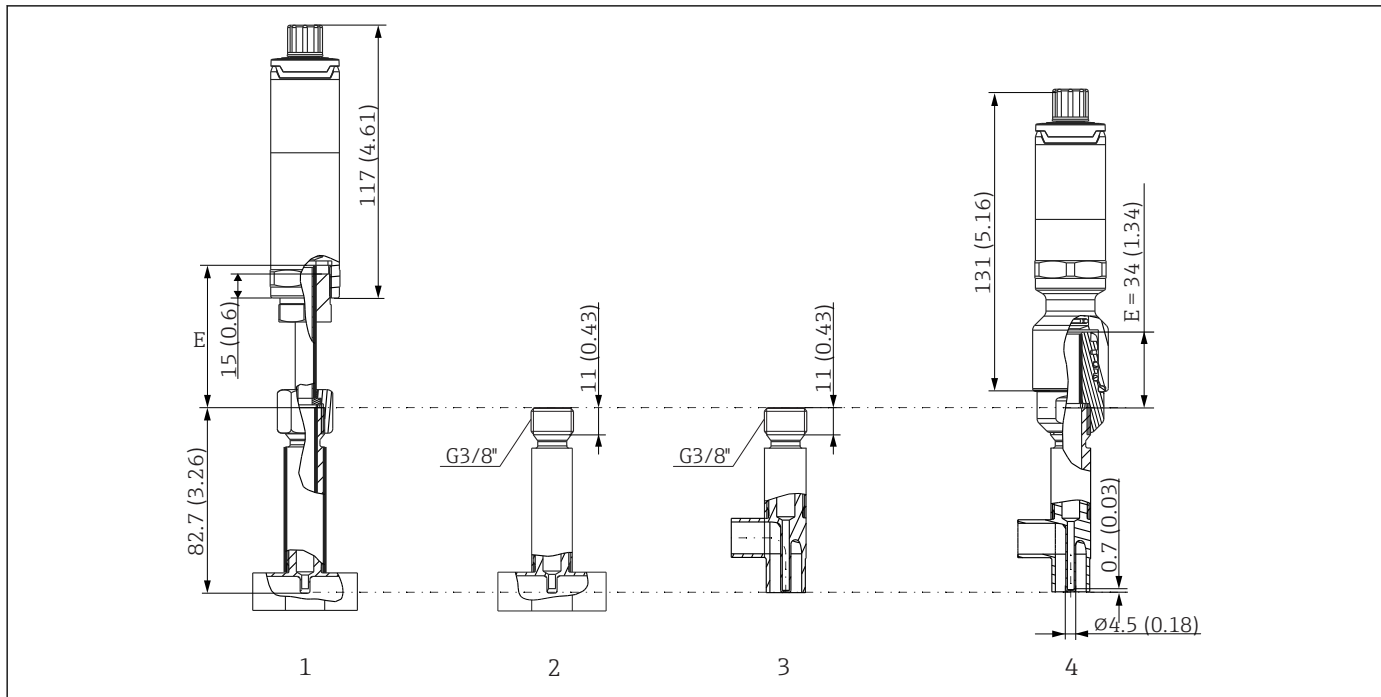

A0031515

- 1 Thermometer with extension neck and tee-piece protection tube
- 2 Version with tee-piece protection tube
- 3 Version with elbow piece
- 4 Thermometer with quick-fastening iTHERM QuickNeck and elbow piece protection tube

Item	Version	Length
Extension neck E	Without extension neck	-
	Replaceable extension neck	9 mm (0.35 in) - variable, depending on the configuration
	iTHERM QuickNeck	34 mm (1.34 in)
Bottom thickness B	Independent of the version	0.7 mm (0.03 in)
Immersion length U	Independent of the version	82.7 mm (3.26 in)

- Pipe sizes according to DIN11865 series A (DIN), B (ISO) and C (ASME BPE)
- Nominal diameters > DN25, with 3-A symbol
- IP69K protection class
- Material 1.4435+316L, Delta ferrite content <0.5%
- Temperature measurement range: -60 to +200 °C (-76 to +392 °F)
- Pressure range: PN25 according to DIN11865

i Due to the small immersion length U in pipes with a small nominal diameter, the use of iTHERM QuickSens inserts is recommended.

Possible combinations of the protection tube versions with the available process connections and quick-fastening iTHERM QuickNeck

Process connection and size	Protection tube diameter			iTHERM QuickNeck for $\phi 9$ mm (0.35 in) ¹⁾
	6 mm (0.24 in) ²⁾	9 mm (0.35 in)	12.7 mm ($\frac{1}{2}$ in) ²⁾	
Without process connection (for installation with compression fitting)	<input checked="" type="checkbox"/>	-	-	-
Process adapter D45	-	<input checked="" type="checkbox"/>	-	-
Weld-in adapter				
Cylindrical $\phi 12.7$ mm (0.5 in)	-	-	<input checked="" type="checkbox"/>	-
Cylindrical $\phi 30 \times 40$ mm	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	-	<input checked="" type="checkbox"/>
Cylindrical $\phi 12 \times 40$ mm		-	-	-
Spherical-cylindrical $\phi 30 \times 40$ mm	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	-	<input checked="" type="checkbox"/>
Spherical $\phi 25$ mm (0.98 in)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	-
Clamp according to ISO 2852				
Microclamp/Tri-clamp DN18 (0.75 in)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	-	<input checked="" type="checkbox"/>
DN12 - 21.3			<input checked="" type="checkbox"/>	
DN25 - 38 (1 - 1.5 in)	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
DN40 - 51 (2 in)				
DN63.5 (2.5 in)	-	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
DN70 - 76.5 (3 in)				
Sanitary connection according to DIN 11851				
DN25	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	-
DN32, DN40				<input checked="" type="checkbox"/>
DN50	-			<input checked="" type="checkbox"/>
Aseptic pipe union according to DIN 11864-1 Form A				
DN25, DN40	-	<input checked="" type="checkbox"/>	-	<input checked="" type="checkbox"/>
Metal sealing system				
M12x1	<input checked="" type="checkbox"/>	-	-	-
G $\frac{1}{2}$ "		<input checked="" type="checkbox"/>	-	<input checked="" type="checkbox"/>
Thread according to ISO 228 for Liquiphant weld-in adapter				
G $\frac{3}{4}$ " for FTL31/33/20	-	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	-
G $\frac{3}{4}$ " for FTL50				-
G1" for FTL50				<input checked="" type="checkbox"/>
APV Inline				
DN50	-	<input checked="" type="checkbox"/>	-	<input checked="" type="checkbox"/>
Varivent®				
Type B, $\phi 31$ mm; Type F, $\phi 50$ mm ; Type N, $\phi 68$ mm	-	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
Ingold connection				
25 x 30 mm or 25 x 46 mm	-	<input checked="" type="checkbox"/>	-	<input checked="" type="checkbox"/>
SMS 1147				
DN25, DN38, DN51	-	<input checked="" type="checkbox"/>	-	<input checked="" type="checkbox"/>

Process connection and size	Protection tube diameter			iTHERM QuickNeck for $\phi 9$ mm (0.35 in) ¹⁾
	6 mm (0.24 in) ²⁾	9 mm (0.35 in)	12.7 mm ($\frac{1}{2}$ in) ²⁾	
Neumo Biocontrol				
D25 PN16, D50 PN16, D65 PN16	-	<input checked="" type="checkbox"/>	-	-

1) In the case of 6 mm (0.24 in) and 12.7 mm ($\frac{1}{2}$ in) diameters, the iTHERM QuickNeck is available for all process connection versions.

2) All versions available with iTHERM QuickNeck

Weight 0.2 to 2.5 kg (0.44 to 5.5 lbs) for standard options.

Material The temperatures for continuous operation specified in the following table are only intended as reference values for use of the various materials in air and without any significant compressive load. The maximum operating temperatures can be reduced considerably in cases where abnormal conditions such as high mechanical load occur or in aggressive media.

Designation	Short form	Recommended max. temperature for continuous use in air	Properties
AISI 316L (corresponds to 1.4404 or 1.4435)	X2CrNiMo17-13-2, X2CrNiMo18-14-3	650 °C (1 202 °F) ¹⁾	<ul style="list-style-type: none"> ▪ Austenitic, stainless steel ▪ High corrosion resistance in general ▪ Particularly high corrosion resistance in chlorine-based and acidic, non-oxidizing atmospheres through the addition of molybdenum (e.g. phosphoric and sulfuric acids, acetic and tartaric acids with a low concentration) ▪ Increased resistance to intergranular corrosion and pitting
1.4435+316L, delta ferrite < 1% or < 0.5%	With regard to analytical limits, the specifications of both materials (1.4435 and 316L) are met simultaneously. In addition, the delta ferrite content of the wetted parts is limited to <1% - including the welding seams (following Basel Standard II); or <0.5%		

1) Can be used to a limited extent up to 800 °C (1472 °F) for low compressive loads and in non-corrosive media. Contact your Endress+Hauser sales team for further information.

Surface roughness

Values for wetted surfaces:¹⁾

Mechanically polished surface	$R_a \leq 0.76 \mu\text{m}$ (30 μin)
Mechanically polished surface ²⁾	$R_a \leq 0.38 \mu\text{m}$ (15 μin)
Mechanically polished surface and electropolished	$R_a \leq 0.38 \mu\text{m}$ (15 μin)+ electropolished

1) Exception: internal welding seams of the tee- and elbow pieces

2) Not compliant with ASME BPE

Protection tube

Process connections

All dimensions in mm (in).

For welding in

Type	Version	Dimensions	Technical properties
<p>Weld-in adapter</p>	1: Cylindrical ¹⁾	$\phi d = 12.7 \text{ mm } (\frac{1}{2} \text{ in})$, U = immersion length from lower edge of thread, T = 12 mm (0.47 in)	<ul style="list-style-type: none"> ▪ P_{max.} depends on the weld-in process ▪ 3-A marked and EHEDG certification ▪ ASME BPE compliance
	2: Cylindrical ²⁾	$\phi d \times h = 12 \text{ mm } (0.47 \text{ in}) \times 40 \text{ mm } (1.57 \text{ in})$, T = 55 mm (2.17 in)	
	3: Cylindrical	$\phi d \times h = 30 \text{ mm } (1.18 \text{ in}) \times 40 \text{ mm } (1.57 \text{ in})$	
	4: Spherical-cylindrical	$\phi d \times h = 30 \text{ mm } (1.18 \text{ in}) \times 40 \text{ mm } (1.57 \text{ in})$	
	5: Spherical	$\phi d = 25 \text{ mm } (0.98 \text{ in})$ $h = 24 \text{ mm } (0.94 \text{ in})$	


- 1) For protection tube $\phi 12.7 \text{ mm } (\frac{1}{2} \text{ in})$
- 2) For protection tube $\phi 6 \text{ mm } (0.24 \text{ in})$


Releasable process connection

Type	Technical properties																										
<p>Sanitary connection according to DIN 11851</p> <p>1 Centering ring 2 Sealing ring</p>	<ul style="list-style-type: none"> ▪ 3-A marked and EHEDG certification (only with EHEDG-certified and self-centering sealing ring). ▪ ASME BPE compliance 																										
<table border="1"> <thead> <tr> <th rowspan="2">Version¹⁾</th> <th colspan="5">Dimensions</th> <th rowspan="2">P_{max.}</th> </tr> <tr> <th>ϕD</th> <th>A</th> <th>B</th> <th>ϕi</th> <th>ϕa</th> </tr> </thead> <tbody> <tr> <td>DN25</td> <td>44 mm (1.73 in)</td> <td>30 mm (1.18 in)</td> <td>10 mm (0.39 in)</td> <td>26 mm (1.02 in)</td> <td>29 mm (1.14 in)</td> <td>40 bar (580 psi)</td> </tr> <tr> <td>DN32</td> <td>50 mm (1.97 in)</td> <td>36 mm (1.42 in)</td> <td>10 mm (0.39 in)</td> <td>32 mm (1.26 in)</td> <td>35 mm (1.38 in)</td> <td>40 bar (580 psi)</td> </tr> </tbody> </table>	Version ¹⁾	Dimensions					P _{max.}	ϕD	A	B	ϕi	ϕa	DN25	44 mm (1.73 in)	30 mm (1.18 in)	10 mm (0.39 in)	26 mm (1.02 in)	29 mm (1.14 in)	40 bar (580 psi)	DN32	50 mm (1.97 in)	36 mm (1.42 in)	10 mm (0.39 in)	32 mm (1.26 in)	35 mm (1.38 in)	40 bar (580 psi)	
Version ¹⁾		Dimensions						P _{max.}																			
	ϕD	A	B	ϕi	ϕa																						
DN25	44 mm (1.73 in)	30 mm (1.18 in)	10 mm (0.39 in)	26 mm (1.02 in)	29 mm (1.14 in)	40 bar (580 psi)																					
DN32	50 mm (1.97 in)	36 mm (1.42 in)	10 mm (0.39 in)	32 mm (1.26 in)	35 mm (1.38 in)	40 bar (580 psi)																					

Type						Technical properties
DN40	56 mm (2.2 in)	42 mm (1.65 in)	10 mm (0.39 in)	38 mm (1.5 in)	41 mm (1.61 in)	40 bar (580 psi)
DN50	68 mm (2.68 in)	54 mm (2.13 in)	11 mm (0.43 in)	50 mm (1.97 in)	53 mm (2.1 in)	25 bar (363 psi)

1) Pipes in accordance with DIN 11850

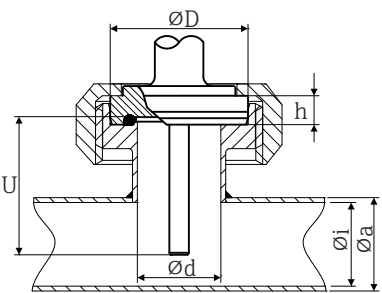Type	Version	Dimensions					Technical properties
		ϕd	ϕD	ϕi	ϕa	h	
Aseptic pipe union according to DIN 11864-1, Form A 	DN25	26 mm (1.02 in)	42.9 mm (1.7 in)	26 mm (1.02 in)	29 mm (1.14 in)	9 mm (0.35 in)	<ul style="list-style-type: none"> ■ $P_{max} = 40$ bar (580 psi) ■ 3-A marked and EHEDG certification ■ ASME BPE compliance
	DN40	38 mm (1.5 in)	54.9 mm (2.16 in)	38 mm (1.5 in)	41 mm (1.61 in)	10 mm (0.39 in)	

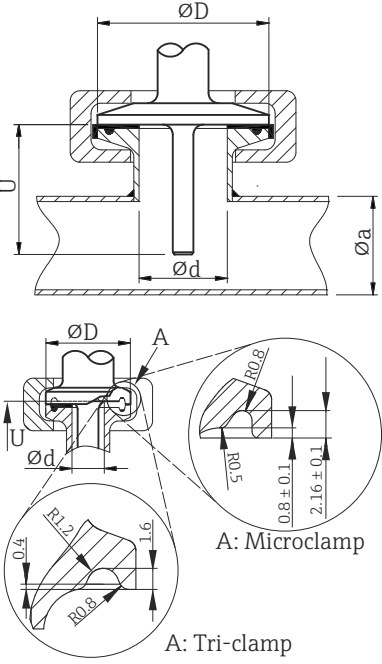
Type	Version	Dimensions		Technical properties
	ϕd : ¹⁾	ϕD	ϕa	
Clamp according to ISO 2852 	Microclamp ²⁾ DN8-18 (0.5"-0.75") ³⁾	25 mm (0.98 in)	-	<ul style="list-style-type: none"> ■ $P_{max} = 16$ bar (232 psi), depends on clamp ring and suitable seal ■ 3-A marked
	Tri-clamp DN8-18 (0.5"-0.75")		-	
	DN12-21.3	34 mm (1.34 in)	16 to 25.3 mm (0.63 to 0.99 in)	<ul style="list-style-type: none"> ■ $P_{max} = 16$ bar (232 psi), depends on clamp ring and suitable seal ■ 3-A marked and EHEDG certification (combined with Hyjoin PEEK/stainless steel seal or Dupont de Nemours Kalrez/stainless steel seal) ■ ASME BPE compliance⁴⁾
	DN25-38 (1"-1.5")	50.5 mm (1.99 in)	29 to 42.4 mm (1.14 to 1.67 in)	
	DN40-51 (2")	64 mm (2.52 in)	44.8 to 55.8 mm (1.76 to 2.2 in)	
	DN63.5 (2.5")	77.5 mm (3.05 in)	68.9 to 75.8 mm (2.71 to 2.98 in)	<ul style="list-style-type: none"> ■ $P_{max} = 16$ bar (232 psi), depends on clamp ring and suitable seal ■ 3-A marked ■ ASME BPE compliance
	DN70-76.5 (3")	91 mm (3.58 in)	> 75.8 mm (2.98 in)	


- 1) Pipes in accordance with ISO 2037 and BS 4825 Part 1
- 2) Microclamp (not in ISO 2852); no standard pipes
- 3) DN8 (0.5") only possible with protection tube diameter = 6 mm (0.24 in)
- 4) Not for DN12-21.3

Type	Version	Technical properties
Metal sealing system		
<p>M12x1.5</p>	<p>G½"</p>	<p>Protection tube diameter 6 mm (0.24 in)</p> <p>$P_{max.} = 16 \text{ bar (232 psi)}$ Maximum torque = 10 Nm (7.38 lbf ft)</p>


Type	Version	Technical properties
<p>Process adapter</p>	D45	<ul style="list-style-type: none"> 3-A marked EHEDG certification

Type	Version G	Dimensions			Technical properties
		L1 thread length	A	1 (SW/AF)	
<p>Thread according to ISO 228 (for weld-in adapter)</p>	G¾" for FTL31/33/20 adapter	16 mm (0.63 in)	25.5 mm (1 in)	32	<ul style="list-style-type: none"> $P_{max.} = 25 \text{ bar (362 psi)}$ at max. 150 °C (302 °F) $P_{max.} = 40 \text{ bar (580 psi)}$ at max. 100 °C (212 °F) 3-A marked and EHEDG certification ASME BPE compliance
	G¾" for FTL50 adapter				
	G1" for FTL50-adapter	18.6 mm (0.73 in)	29.5 mm (1.16 in)	41	

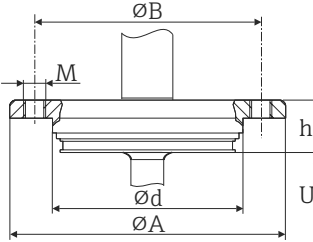Type	Version	Dimensions					Technical properties
		ϕd	ϕA	ϕB	M	h	
APV Inline 	DN50	69 mm (2.72 in)	99.5 mm (3.92 in)	82 mm (3.23 in)	2xM8	19 mm (0.75 in)	<ul style="list-style-type: none"> ■ $P_{max.} = 25$ bar (362 psi) ■ 3-A marked and EHEDG certification ■ ASME BPE compliance

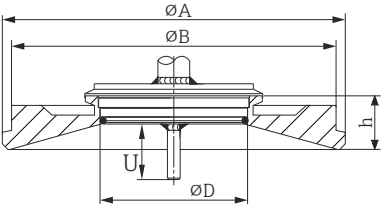Type	Version	Dimensions				Technical properties	
		ϕD	ϕA	ϕB	h	$P_{max.}$	
Varivent® 	Type B	31 mm (1.22 in)	105 mm (4.13 in)	-	22 mm (0.87 in)	10 bar (145 psi)	<ul style="list-style-type: none"> ■ 3-A marked and EHEDG certification ■ ASME BPE compliance
	Type F	50 mm (1.97 in)	145 mm (5.71 in)	135 mm (5.31 in)	24 mm (0.95 in)		
	Type N	68 mm (2.67 in)	165 mm (6.5 in)	155 mm (6.1 in)	24.5 mm (0.96 in)		


i The VARINLINE® housing connection flange is suitable for weld-in into the conical or torispherical head in tanks or containers with a small diameter (≤ 1.6 m (5.25 ft)) and up to a wall thickness of 8 mm (0.31 in).

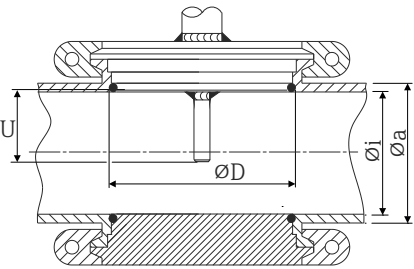Type	Technical properties
Varivent® for VARINLINE® housing for installation in pipes 	<ul style="list-style-type: none"> ■ 3-A marked and EHEDG certification ■ ASME BPE compliance

Version	Dimensions			$P_{max.}$
	ϕD	ϕi	ϕa	
Type N, according to DIN 11866, series A	68 mm (2.67 in)	DN40: 38 mm (1.5 in)	DN40: 41 mm (1.61 in)	DN40 to DN65: 16 bar (232 psi)
		DN50: 50 mm (1.97 in)	DN50: 53 mm (2.1 in)	
		DN65: 66 mm (2.6 in)	DN65: 70 mm (2.76 in)	
		DN80: 81 mm (3.2 in)	DN80: 85 mm (3.35 in)	DN80 to DN150: 10 bar (145 psi)
		DN100: 100 mm (3.94 in)	DN100: 104 mm (4.1 in)	
		DN125: 125 mm (4.92 in)	DN125: 129 mm (5.08 in)	
		DN150: 150 mm (5.9 in)	DN150: 154 mm (6.06 in)	


Version	Dimensions			P _{max.}
	ϕD	ϕi	ϕa	
Type N, according to EN ISO 1127, series B	68 mm (2.67 in)	38.4 mm (1.51 in)	42.4 mm (1.67 in)	42.4 mm (1.67 in) to 60.3 mm (2.37 in): 16 bar (232 psi)
		44.3 mm (1.75 in)	48.3 mm (1.9 in)	
		56.3 mm (2.22 in)	60.3 mm (2.37 in)	
		72.1 mm (2.84 in)	76.1 mm (3 in)	76.1 mm (3 in) to 114.3 mm (4.5 in): 10 bar (145 psi)
		82.9 mm (3.26 in)	42.4 mm (3.5 in)	
		108.3 mm (4.26 in)	114.3 mm (4.5 in)	
Type N, according to DIN 11866, series C	68 mm (2.67 in)	OD 1½": 34.9 mm (1.37 in)	OD 1½": 38.1 mm (1.5 in)	OD 1½" to OD 2½": 16 bar (232 psi)
		OD 2": 47.2 mm (1.86 in)	OD 2": 50.8 mm (2 in)	
		OD 2½": 60.2 mm (2.37 in)	OD 2½": 63.5 mm (2.5 in)	
Type N, according to DIN 11866, series C	68 mm (2.67 in)	OD 3": 73 mm (2.87 in)	OD 3": 76.2 mm (3 in)	OD 3" to OD 4": 10 bar (145 psi)
		OD 4": 97.6 mm (3.84 in)	OD 4": 101.6 mm (4 in)	

Advanced tee-piece (no welds, no dead legs)

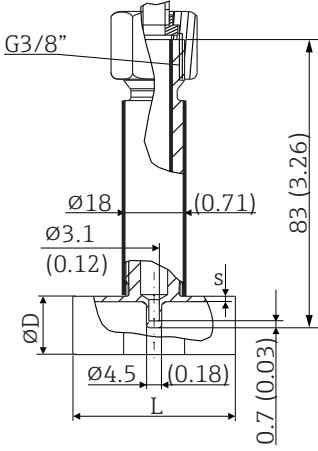
Type	Version		Dimensions in mm (in)			Technical properties
			ϕD	L	s ¹⁾	
Tee-piece for weld-in as per DIN 11865 (part A, B and C) 	Part A	DN10 PN25	13 mm (0.51 in)	48 mm (1.89 in)	1.5 mm (0.06 in)	<ul style="list-style-type: none"> ■ P_{max.} = 25 bar (362 psi) ■ 3-A marked for > DN25
		DN15 PN25	19 mm (0.75 in)			
		DN20 PN25	23 mm (0.91 in)			
		DN25 PN25	29 mm (1.14 in)			
		DN32 PN25	32 mm (1.26 in)			
	Part B	DN13,5 PN25	13.5 mm (0.53 in)		1.6 mm (0.063 in)	
		DN17,2 PN25	17.2 mm (0.68 in)			
		DN21,3 PN25	21.3 mm (0.84 in)			
		DN26,9 PN25	26.9 mm (1.06 in)			
		DN33,7 PN25	33.7 mm (1.33 in)			
	Part C ²⁾	DN12,7 PN25 (½")	12.7 mm (0.5 in)		1.65 mm (0.065 in)	
		DN19,05 PN25 (¾")	19.05 mm (0.75 in)			
		DN25,4 PN25 (1")	25.4 mm (1 in)			
		DN38,1 PN25 (1½")	38.1 mm (1.5 in)			



- 1) Wall thickness
- 2) Dimensions as per ASME BPE 2012


Advanced elbow piece (no welds, no dead legs)

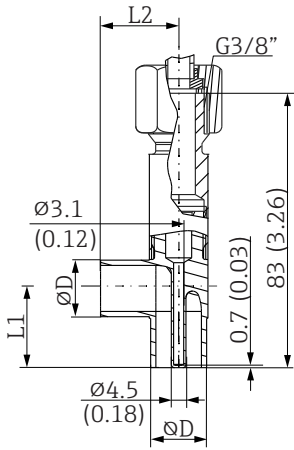Type	Version		Dimensions				Technical properties
			ØD	L1	L2	s ¹⁾	
Elbow piece for weld-in as per DIN 11865 (part A, B and C)  <small>A0035899</small>	Part A	DN10 PN25	13 mm (0.51 in)	24 mm (0.95 in)	1.5 mm (0.06 in)	<ul style="list-style-type: none"> ■ P_{max.} = 25 bar (362 psi) ■ 3-A marked for > DN25 	
		DN15 PN25	19 mm (0.75 in)	25 mm (0.98 in)			
		DN20 PN25	23 mm (0.91 in)	27 mm (1.06 in)			
		DN25 PN25	29 mm (1.14 in)	30 mm (1.18 in)			
		DN32 PN25	35 mm (1.38 in)	33 mm (1.3 in)			
	Part B	DN13,5 PN25	13.5 mm (0.53 in)	32 mm (1.26 in)	1.6 mm (0.063 in)		
		DN17,2 PN25	17.2 mm (0.68 in)	34 mm (1.34 in)			
		DN21,3 PN25	21.3 mm (0.84 in)	36 mm (1.41 in)			
		DN26,9 PN25	26.9 mm (1.06 in)	29 mm (1.14 in)			
		DN33,7 PN25	33.7 mm (1.33 in)	32 mm (1.26 in)	2.0 mm (0.08 in)		
	Part C	DN12,7 PN25 (½") ²⁾	12.7 mm (0.5 in)	24 mm (0.95 in)	1.65 mm (0.065 in)		
		DN19,05 PN25 (¾")	19.05 mm (0.75 in)	25 mm (0.98 in)			
		DN25,4 PN25 (1")	25.4 mm (1 in)	28 mm (1.1 in)			
		DN38,1 PN25 (1½")	38.1 mm (1.5 in)	35 mm (1.38 in)			


- 1) Wall thickness
- 2) Dimensions as per ASME BPE 2012

Type	Version, dimensions ØD x h	Technical properties
Ingold connection  <small>A0009573</small>	Ø25 mm (0.98 in) x 30 mm (1.18 in) x = 1.5 mm (0.06 in)	P _{max.} = 25 bar (362 psi) A seal is included in the delivery Material V75SR: FDA compliant, 3-A compliant, USP Class VI compliant
	Ø25 mm (0.98 in) x 46 mm (1.81 in) x = 6 mm (0.24 in)	

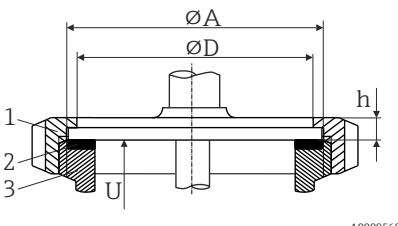Type	Version	Dimensions			Technical properties
		ϕD	ϕA	h	
SMS 1147  1 Thread adapter nut 2 Sealing ring 3 Counterpart connection A0009568	DN25	32 mm (1.26 in)	35.5 mm (1.4 in)	7 mm (0.28 in)	$P_{max.} = 6 \text{ bar (87 psi)}$
	DN38	48 mm (1.89 in)	55 mm (2.17 in)	8 mm (0.31 in)	
	DN51	60 mm (2.36 in)	65 mm (2.56 in)	9 mm (0.35 in)	
 The counterpart connection must fit the sealing ring and fix it in place.					

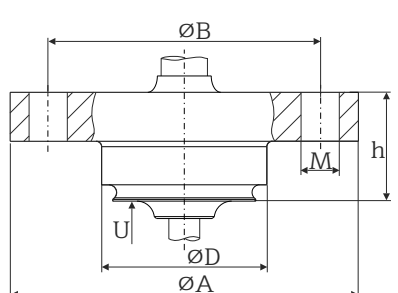Type	Version	Dimensions					Technical properties
		ϕA	ϕB	ϕD	ϕd	h	
Neumo Biocontrol  A0018497	D25 PN16	64 mm (2.52 in)	50 mm (1.97 in)	30.4 mm (1.2 in)	7 mm (0.28 in)	20 mm (0.79 in)	<ul style="list-style-type: none"> ■ $P_{max.} = 16 \text{ bar (232 psi)}$ ■ 3-A marked
	D50 PN16	90 mm (3.54 in)	70 mm (2.76 in)	49.9 mm (1.97 in)	9 mm (0.35 in)	27 mm (1.06 in)	
	D65 PN25	120 mm (4.72 in)	95 mm (3.74 in)	67.9 mm (2.67 in)	11 mm (0.43 in)		

Compression fitting

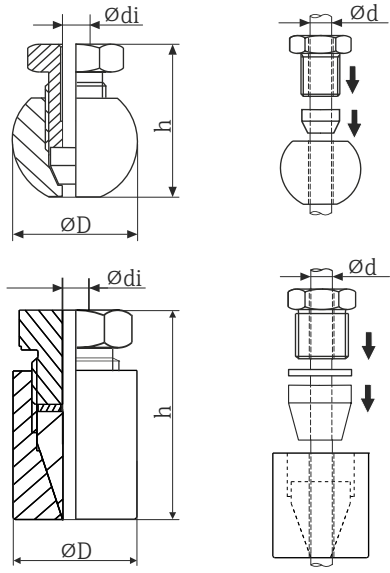
Type	Version	Dimensions			Technical properties ¹⁾
	Spherical or cylindrical	ϕdi	ϕD	h	
Compression fitting TK40 for weld-in 	Spherical Ferrule material PEEK or 316L Thread G $\frac{1}{4}$ "	6.3 mm (0.25 in)	25 mm (0.98 in)	33 mm (1.3 in)	<ul style="list-style-type: none"> ▪ P_{max.} = 10 bar (145 psi), T_{max.} = +150 °C (+302 °F) for PEEK material, tightening torque = 10 Nm ▪ P_{max.} = 50 bar (725 psi), T_{max.} = +200 °C (+392 °F) for 316L material, tightening torque = 25 Nm ▪ PEEK compression fitting is EHEDG tested and 3-A marked
	Cylindrical Ferrule material Elastosil® Thread G $\frac{1}{2}$ "	6.2 mm (0.24 in) ²⁾	9.2 mm (0.36 in)	30 mm (1.18 in)	

- 1) All the pressure specifications apply for cyclic temperature load
- 2) For insert or protection tube diameter $\phi d = 6$ mm (0.236 in).

Tip shape

The thermal response time, the reduction of the flow cross-section and the mechanical load that occurs in the process are the criteria that matter when selecting the shape of the tip. Advantages of using reduced or tapered thermowell tips:


- A smaller tip shape has less impact on the flow characteristics of the pipe carrying the medium.
- The flow characteristics are optimized, thereby increasing the stability of the thermowell.
- Endress+Hauser offers users a range of thermowell tips to meet every requirement:
 - Reduced tip with $\phi 4.3$ mm (0.17 in) and $\phi 5.3$ mm (0.21 in): walls of lower thickness significantly reduce the response times of the overall measuring point.
 - Tapered tip with $\phi 6.6$ mm (0.26 in) and reduced tip with $\phi 8$ mm (0.31 in): walls of greater thickness are particularly well suited to applications with a higher degree of mechanical load or wear (e.g. pitting, abrasion etc.).

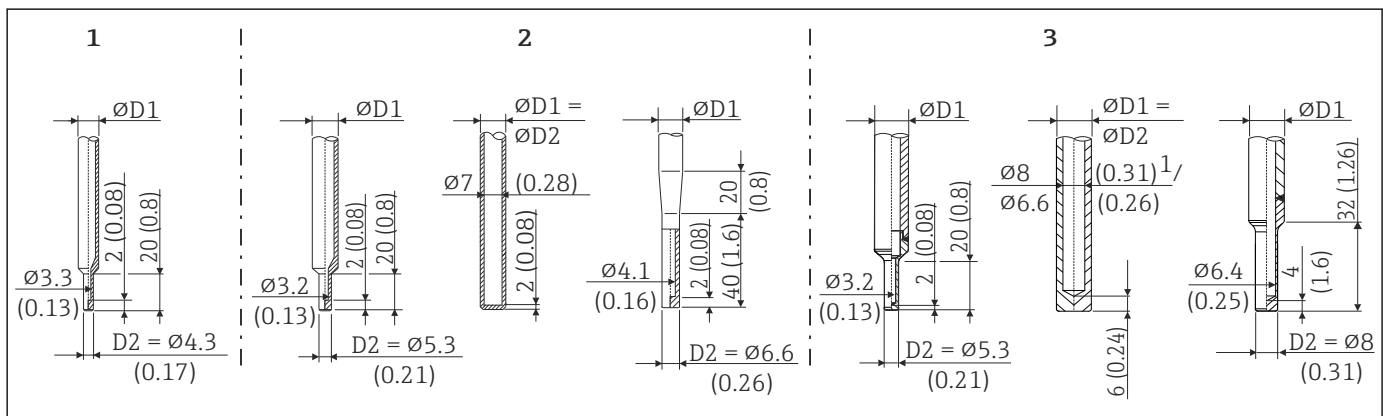

9 Thermowell tips available (reduced, straight or tapered)

Item No.	Thermowell (ΦD1)		Insert (ΦID)
1	Φ6 mm (¼ in)	Reduced tip	Φ3 mm (⅛ in)
2	Φ9 mm (0.35 in)	<ul style="list-style-type: none"> ■ Reduced tip with Φ5.3 mm (0.21 in) ■ Straight tip ■ Tapered tip with Φ6.6 mm (0.26 in) 	<ul style="list-style-type: none"> ■ Φ3 mm (⅛ in) ■ Φ6 mm (¼ in) ■ Φ3 mm (⅛ in)
3	Φ12.7 mm (½ in) ¹⁾	<ul style="list-style-type: none"> ■ Reduced tip with Φ5.3 mm (0.21 in) ■ Straight tip ²⁾ ■ Reduced tip with Φ8 mm (0.31 in) 	<ul style="list-style-type: none"> ■ Φ3 mm (⅛ in) ■ Φ6 mm (¼ in) ■ Φ6 mm (¼ in)

- 1) The thermowell is made from barstock for L ≤ 200 mm (7.87 in). The tip is welded on for L > 200 mm (7.87 in).
- 2) For L ≤ 200 mm (7.87 in) = internal diameter Φ8 mm (0.31 in). For L > 200 mm (7.87 in) = internal diameter Φ6.6 mm (0.26 in)

 It is possible to check the mechanical loading capacity as a function of the installation and process conditions online in the TW Sizing Module for thermowells in the Endress+Hauser Applicator software. See 'Accessories' section.

Operability

Operating concept


The configuration of device-specific parameters is done via the HART protocol or CDI interface (= Endress+Hauser Common Data Interface). There are specific configuration or operating programs from different manufacturers available to the user for this purpose. Both the DD (Device Description) as well as the DTM (Device Type Manager) files are being provided for the iTHERM TrustSens thermometers.

Self-calibration

A self-calibration certificate similar to laboratory calibration can be created with a DTM and can be printed on demand. The necessary measurement data is stored in the device and can be requested by the DTM.

Local operation

LED signals

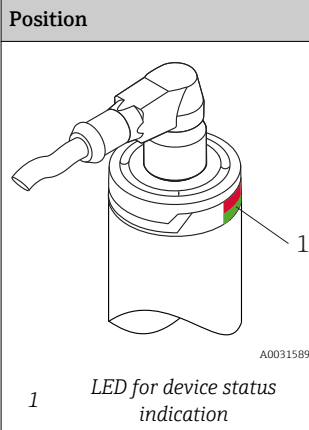Position	LEDs	Function description
	LED green (gn) is illuminated	Voltage supply is correct. The device is operational and the set limit values are met.
	LED green (gn) is flashing	With a frequency 1 Hz: self-calibration currently being performed. With a frequency 5 Hz for 5 s: self-calibration finished and valid, all process criteria were within specifications. Calibration data stored.
	LED red (rd) and green (gn) are flashing alternating	Self-calibration process finished but not valid, violation of necessary process criteria. Calibration data not stored.
	LED red (rd) is flashing	Presence of a diagnostic event: "Warning"
	LED red (rd) is illuminated	Presence of a diagnostic event: "Alarm"

Operating elements

To prevent manipulation, no operating elements are present directly on the device. The thermometer is configured only by remote operation.

Remote operation

Configuration


Configuration kits, e. g. Commubox FXA195 or TXU10, for PC-programmable thermometer with setup software and interface for PC with USB port.

HART® functions and device-specific parameters are configured by HART® communication or via the interface of the device. There are special configuration tools like FieldCare or DeviceCare by Endress+Hauser. For more information, contact your Endress+Hauser sales representative.

Operating tools

Operating tool	Sources for obtaining the required device descriptions (DD) or device type manager (DTM)
FieldCare (Endress+Hauser)	<ul style="list-style-type: none"> ▪ www.endress.com → Download Area → Software ▪ DVD (contact Endress+Hauser)
DeviceCare (Endress+Hauser)	www.endress.com → Download Area → Software
FieldXpert SFX350, SFX370 (Endress+Hauser)	Use update function of handheld terminal

Certificates and approvals

CE mark	The product meets the requirements of the harmonized European standards. As such, it complies with the legal specifications of the EC directives. The manufacturer confirms successful testing of the product by affixing to it the CE-mark.
EAC mark	The product meets the legal requirements of the EEU guidelines. The manufacturer confirms the successful testing of the product by affixing the EAC mark.
cCSAus	The product complies with "CLASS 2252 05 - Process Control Equipment" and "CLASS 2252 85 - Process Control Equipment - Certified to US Standards" requirements.
MTBF	For the transmitter: 180 years - according to Siemens Standard SN29500
Hygiene standard	<ul style="list-style-type: none"> ▪ EHEDG certification, type EL - CLASS I. Permitted process connections in accordance with EHEDG, see 'Process connections' section →  25 ▪ 3-A authorization no. 1144, 3-A sanitary standard 74-06. Permitted process connections in accordance with 3-A, see also 'Process connections' section ▪ ASME BPE, certificate of conformity can be ordered for indicated options ▪ FDA-compliant ▪ All product contact surfaces are produced without materials used derived from bovine or other animal sources (TSE Certificate of Suitability)
Other standards and guidelines	<ul style="list-style-type: none"> ▪ IEC 60529: Degrees of protection provided by enclosures (IP code) ▪ IEC 61010-1: Safety requirements for electrical equipment for measurement, control and laboratory use ▪ IEC 60751: Industrial platinum resistance thermometers ▪ DIN 43772: Protection tubes
Parts in contact with the medium	<p>Parts of the thermometer in contact with the medium comply with the following European regulations:</p> <ul style="list-style-type: none"> ▪ (EC) No. 1935/2004, Article 3, paragraph 1, Articles 5 and 17 on materials and articles intended to come into contact with food. ▪ (EC) No. 2023/2006 on good manufacturing practice for materials and articles intended to come into contact with food. ▪ (EU) No. 10/2011 on plastic materials and articles intended to come into contact with food.
CRN approval	The CRN approval is only available for certain options of protection tubes. These will be marked and shown during the configuration of this device.

Detailed ordering information is available from the following sources:

- In the download area on the Endress+Hauser website: www.endress.com → Select your country → Downloads → Enter product code or device → Media type: Approvals & certificates → Select type of approval → Start search
- From your nearest Endress+Hauser sales organization: www.addresses.endress.com

Surface purity	Cleaned from oil and grease for O ₂ applications, optional
Material resistance	Material resistance - including housing - to the following cleaning agents/disinfectants from the company Ecolab: P3-topax 66, P3-topactive 200, P3-topactive 500 and P3-topactive OKTO as well as demineralized water.
Material certification	The material certificate 3.1 (according to standard EN 10204) can be requested separately. The "short form" certificate includes a simplified declaration with no enclosures of documents related to the materials used in the construction of the single sensor and guarantees the traceability of the materials through the identification number of the thermometer. The data related to the origin of the materials can subsequently be requested by the client if necessary.
Calibration	The "Factory calibration" is carried out according to an internal procedure in a laboratory of Endress+Hauser accredited by the European Accreditation Organization (EA) to ISO/IEC 17025. A calibration which is performed according to EA guidelines (SIT/Accredia) or (DKD/DakKS) may be requested separately. The analog current output of the device is calibrated.
Protection tube testing and load capacity calculation	<ul style="list-style-type: none"> ■ Protection tube pressure tests are carried out in accordance with the specifications in DIN 43772. With regard to protection tubes with tapered or reduced tips that do not comply with this standard, these are tested using the pressure of corresponding straight protection tubes. Tests according to other specifications can be carried out on request. ■ Load capacity calculation for the protection tube as per DIN43772

Ordering information

Detailed ordering information is available from the following sources:

- In the Product Configurator on the Endress+Hauser website: www.endress.com -> Click "Corporate" -> Select your country -> Click "Products" -> Select the product using the filters and search field -> Open product page -> The "Configure" button to the right of the product image opens the Product Configurator.
- From your Endress+Hauser Sales Center: www.addresses.endress.com



Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
- Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

Application packages

Heartbeat diagnostics	Available in all device versions. Function <ul style="list-style-type: none"> ■ Continuous self-monitoring of the device ■ Diagnostic messages output to: <ul style="list-style-type: none"> - the local display - an asset management system (e.g. FieldCare/DeviceCare) - an automation system (e.g. PLC)
------------------------------	---

Advantages

- Device condition information is available immediately and processed in time.
- The status signals are classified in accordance with VDI/VDE 2650 and NAMUR recommendation NE 107 and contain information about the cause of the error and remedial action.



For detailed information on Heartbeat functions, see the Operating Instructions → 42

Heartbeat verification

Available in all device versions.

Device functionality checked on demand

- Verification of the correct functioning of the measuring device within specifications
- The verification result provides information about the condition of the device: "Passed" or "Failed"
- The results are documented in a verification report
- The automatically generated report supports the obligation to demonstrate compliance with internal and external regulations, laws and standards
- Verification is possible without interrupting the process

Advantages

- No onsite presence is required to use the function
- The DTM¹⁾ triggers verification in the device and interprets the results. No specific knowledge is required on the part of the user.
- The verification report can be used to prove quality measures to a third party.
- Heartbeat Verification can replace other maintenance tasks (e.g. periodic check) or extend the test intervals.



For detailed information on Heartbeat functions, see the Operating Instructions → 42

Heartbeat Monitoring

Available in all device versions.

Function

Calibration information is logged in addition to the verification parameters. 350 calibration points are saved in the device (FIFO memory).

Advantages

- Early detection of changes (trends) to ensure plant availability and product quality.
- Use of information for the proactive planning of measures (e.g. maintenance).






For detailed information on Heartbeat functions, see the Operating Instructions → 42


1) Device Type Manager: controls device operation via DeviceCare, FieldCare or a DTM-based process control system.

Accessories


Device-specific accessories

Device-specific accessories

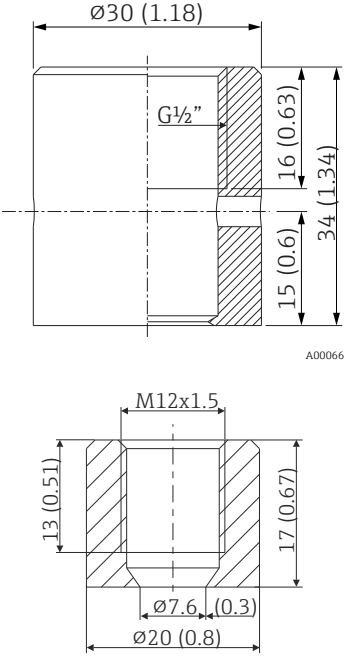
Accessories	Description
<p data-bbox="507 398 877 450">Welding boss with sealing taper (metal-metal)</p>  <p data-bbox="826 824 877 837">A0006621</p> <p data-bbox="826 1137 877 1151">A0018236</p>	<p data-bbox="890 398 1289 506">Welding boss for G$\frac{1}{2}$" and M12x1.5 thread Metal-sealing; conical Material of wetted parts: 316L/1.4435 Max. process pressure 16 bar (232 PSI)</p> <p data-bbox="890 517 1038 539">Order number:</p> <ul data-bbox="890 544 1123 595" style="list-style-type: none"> ■ 60021387 (G$\frac{1}{2}$") ■ 71405560 (M12x1.5)
<p data-bbox="635 1171 751 1193">Dummy plug</p>  <p data-bbox="810 1518 877 1532">A0009213-EN</p>	<p data-bbox="890 1171 1528 1223">Dummy plug for G$\frac{1}{2}$" or M12x1.5 conical metal-sealing welding boss Material: SS 316L/1.4435</p> <p data-bbox="890 1234 1038 1256">Order number:</p> <ul data-bbox="890 1261 1123 1312" style="list-style-type: none"> ■ 60022519 (G$\frac{1}{2}$") ■ 60021194 (M12x1.5)
<p data-bbox="531 1603 855 1655">Weld-in adapter for Ingold process connections</p>  <p data-bbox="826 1921 877 1935">A0008956</p>	<p data-bbox="890 1603 1254 1655">Material of wetted parts: 316L/1.4435 Weight: 0.32 kg (0.7 lb)</p> <p data-bbox="890 1659 1142 1682">Order number: 60017887</p> <p data-bbox="890 1693 1031 1715">O-ring seal set</p> <ul data-bbox="890 1720 1347 1798" style="list-style-type: none"> ■ Silicone O-ring in accordance with FDA CFR 21 ■ Maximum temperature: 230 °C (446 °F) ■ Order number: 60018911
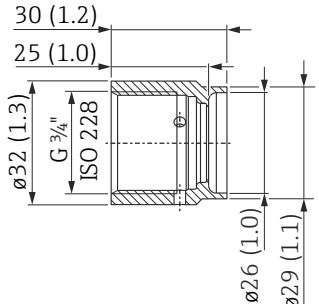
<p>Weld-in adapter for FTL31/33/20, pipe-mounting</p>  <p style="text-align: right;">A0008265</p>	<p>G$\frac{3}{4}$" d=29 mm, without flange Material: 316L Roughness in μm (μin): 1.5 (59.1) Order number: 52028295 (with inspection certificate EN10204-3.1 material) Order number seal (5-pc. set): silicone O-ring 52021717 ¹⁾, FDA-compliant</p>
--	---


1) A seal is included in the delivery.
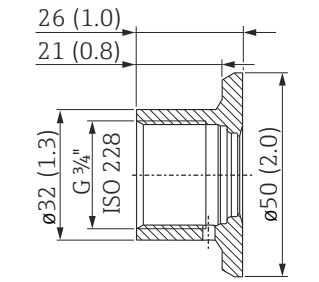
<p>Weld-in adapter for FTL31/33/20, vessel-mounting</p>  <p style="text-align: right;">A0008810</p>	<p>G$\frac{3}{4}$" d=50 mm, with flange Material: 316L Roughness in μm (μin): 0.8 (31.5) Order number: 52018765 (with inspection certificate EN10204-3.1 material) Order number seal (5-pc. set): silicone O-ring 52021717 ¹⁾, FDA-compliant EHEDG tested and 3-A marked</p>
---	--

1) A seal is included in the delivery.
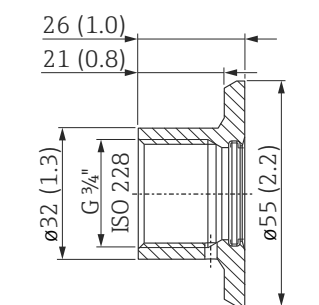
<p>Weld-in adapter for FTL50</p>  <p style="text-align: right;">A0008274</p>	<p>G$\frac{3}{4}$" d=55 mm, with flange Material: 316L Roughness in μm (μin): 0.8 (31.5) Order number: 52001052 (without inspection certificate EN10204-3.1 material) Order number: 52011897 (with inspection certificate EN10204-3.1 material) Order number seal (5-pc. set): silicone O-ring 52014473 ¹⁾, FDA-compliant Order number weld-in dummy: MVT2L0692 EHEDG tested and 3-A marked</p>
---	---

1) A seal is included in the delivery.
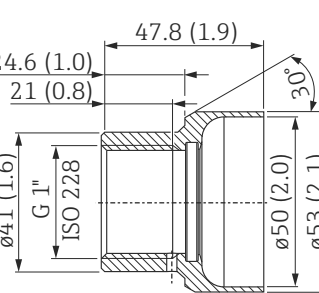
<p>Weld-in adapter for FTL50</p>  <p style="text-align: right;">A0011927</p>	<p>G1" d=53 mm, without flange Material: 316L Roughness in μm (μin): 0.8 (31.5) Order number: 71093129 (with inspection certificate EN10204-3.1 material) Order number seal (5-pc. set): silicone O-ring 52014472 ¹⁾, FDA-compliant Order number weld-in dummy: MVT2L0691</p>
---	---

1) A seal is included in the delivery.

<p style="text-align: center;">Weld-in adapter for FTL50</p> <p style="text-align: right; font-size: small;">A0008267</p>	<p>G1", d=60 mm, with flange Material: 316L Roughness in μm (μin): 0.8 (31.5) Order number: 52001051 (without inspection certificate EN10204-3.1 material) Order number: 52011896 (with inspection certificate EN10204-3.1 material) Order number seal (5-pc. set): silicone O-ring 52014472 ¹⁾, FDA-compliant Order number weld-in dummy: MVT2L0691 EHEDG tested and 3-A marked</p>
---	--

1) A seal is included in the delivery.




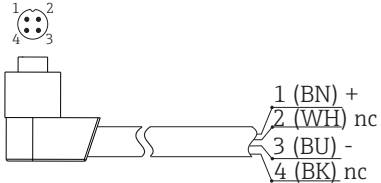
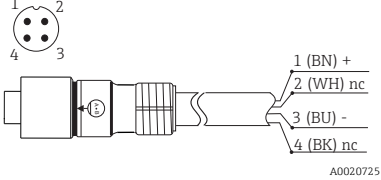





<p style="text-align: center;">Weld-in adapter for FTL50</p> <p style="text-align: right; font-size: small;">A0008272</p>	<p>G1", can be aligned Material: 316L Roughness in μm (μin): 0.8 (31.5) Order number: 52001221 (without inspection certificate EN10204-3.1 material) Order number: 52011898 (with inspection certificate EN10204-3.1 material) Order number seal (5-pc. set): silicone O-ring 52014424 ¹⁾, FDA-compliant Order number weld-in dummy: M40167</p>
---	--


1) A seal is included in the delivery.

<p style="text-align: center;">Flexible handle cap to cover the QuickNeck bottom part</p> <p style="text-align: right; font-size: small;">A0027201</p>	<p>Diameter \varnothingD: 24 to 26 mm (0.94 to 1.02 in) Material: Thermoplastic polyolefin - elastomer (TPE), free from plasticizers Maximum temperature: +150 °C (+302 °F) Order number: 71275424</p>
--	---

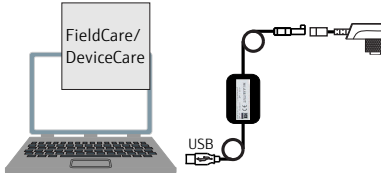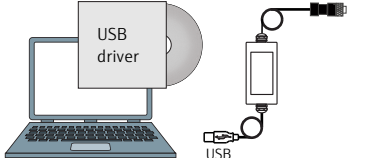

- Maximum process pressure for the weld-in adapters:**
 - 25 bar (362 PSI) at maximum 150 °C (302 °F)
 - 40 bar (580 PSI) at maximum 100 °C (212 °F)
- For more information on the weld-in adapters, see Technical Information (TI00426F/00).

Communication-specific accessories




<p>Configuration kit TXU10</p>  <p style="text-align: right;">A0028635</p>	<p>Configuration kit for CDI communication with PC-programmable devices. Includes interface cable for PC with USB port and M12x1 coupling (Non-Ex area). Order code: TXU10-BD</p>
<p>Commubox FXA291</p>  <p style="text-align: right;">A0034600</p>	<p>Connects Endress+Hauser field devices with a CDI interface (= Endress+Hauser Common Data Interface) and the USB port of a computer or laptop (Non-Ex area and Ex area).</p> <p> For details, see "Technical Information" TI00405C</p>
<p>Cordset M12x1, angle plug</p>  <p style="text-align: right;">A0020723</p>	<p>PVC cable, 4 x 0.34 mm² (22 AWG) with M12x1 coupling; angle plug; screw plug; length 5 m (16.4 ft); IP69K Order number: 52024216</p> <p>Core colours:</p> <ul style="list-style-type: none"> ■ 1 = BN brown ■ 2 = WH white ■ 3 = BU blue ■ 4 = BK black
<p>Cordset M12x1, straight</p>  <p style="text-align: right;">A0020725</p>	<p>PVC cable, 4 x 0.34 mm² (22 AWG) with M12x1 coupling nut from stainless steel; straight female connector type; screw plug; length 5 m (16.4 ft); IP69K Order number: 71217708</p> <p>Core colors:</p> <ul style="list-style-type: none"> ■ 1 = BN brown ■ 2 = WH white ■ 3 = BU blue ■ 4 = BK black
<p>Commubox FXA195 HART</p>  <p style="text-align: right;">A0032846</p>	<p>For intrinsically safe HART communication with FieldCare via the USB interface.</p> <p> For details, see "Technical Information" TI00404F</p>
<p>HART Loop Converter HMX50</p>	<p>Is used to evaluate and convert dynamic HART process variables to analog current signals or limit values.</p> <p> For details, see "Technical Information" TI00429F and Operating Instructions BA00371F</p>
<p>Fieldgate FXA320</p>	<p>Gateway for the remote monitoring of connected 4-20 mA measuring devices via a Web browser.</p> <p> For details, see "Technical Information" TI00025S and Operating Instructions BA00053S</p>
<p>Fieldgate FXA520</p>	<p>Gateway for the remote diagnostics and remote configuration of connected HART measuring devices via a Web browser.</p> <p> For details, see "Technical Information" TI00025S and Operating Instructions BA00051S</p>

Field Xpert SFX350, 370	<ul style="list-style-type: none"> ■ Field Xpert is a powerful, compact industrial PDA based on the Windows Embedded Handheld operating system and offering integrated WLAN, USB, Bluetooth and infrared interfaces. This allows it to be connected to HART and/or FOUNDATION Fieldbus devices via a modem or gateway. ■ SFX350 for configuration of field devices in Non-Ex areas ■ SFX370 for configuration of field devices in Non-Ex areas and Ex areas <p> For details, see Operating Instructions BA01202S</p>
-------------------------	--

Service-specific accessories

Accessories	Description
Applicator	<p>Software for selecting and sizing Endress+Hauser measuring devices:</p> <ul style="list-style-type: none"> ■ Calculation of all the necessary data for identifying the optimum measuring device: e.g. pressure loss, accuracy or process connections. ■ Graphic illustration of the calculation results <p>Administration, documentation and access to all project-related data and parameters over the entire life cycle of a project.</p> <p>Applicator is available: Via the Internet: https://portal.endress.com/webapp/applicator</p>
Configurator	<p>Product Configurator - the tool for individual product configuration</p> <ul style="list-style-type: none"> ■ Up-to-the-minute configuration data ■ Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language ■ Automatic verification of exclusion criteria ■ Automatic creation of the order code and its breakdown in PDF or Excel output format ■ Ability to order directly in the Endress+Hauser Online Shop <p>The Configurator is available on the Endress+Hauser website: www.endress.com -> Click "Corporate" -> Select your country -> Click "Products" -> Select the product using the filters and the search field -> Open the product page -> The "Configure" button to the right of the product image opens the Product Configurator.</p>
W@M	<p>Life cycle management for your plant</p> <p>W@M supports you with a wide range of software applications over the entire process: from planning and procurement, to the installation, commissioning and operation of the measuring devices. All the relevant device information, such as the device status, spare parts and device-specific documentation, is available for every device over the entire life cycle.</p> <p>The application already contains the data of your Endress+Hauser device. Endress+Hauser also takes care of maintaining and updating the data records.</p> <p>W@M is available: Via the Internet: www.endress.com/lifecyclemanagement</p>
FieldCare SFE500	<p>FDT-based plant asset management tool from Endress+Hauser. It can configure all smart field units in your system and helps you manage them. By using the status information, it is also a simple but effective way of checking their status and condition.</p> <p> For details, see Operating Instructions BA00027S and BA00065S</p>
DeviceCare SFE100	<p>Configuration tool for devices via fieldbus protocols and Endress+Hauser service protocols.</p> <p>DeviceCare is the tool developed by Endress+Hauser for the configuration of Endress+Hauser devices. All smart devices in a plant can be configured via a point-to-point or point-to-bus connection. The user-friendly menus enable transparent and intuitive access to the field devices.</p> <p> For details, see Operating Instructions BA00027S</p>

System components

Advanced Data Manager Memograph M	<p>The Advanced Data Manager Memograph M is a flexible and powerful system for organizing process values. The measured process values are clearly presented on the display and logged safely, monitored for limit values and analyzed. Via common communication protocols, the measured and calculated values can be easily communicated to higher-level systems or individual plant modules can be interconnected.</p> <p> For details, see Technical Information TI01180R/09</p>
RN221N	<p>Active barrier with power supply for safe separation of 4-20 mA standard signal circuits. Offers bidirectional HART transmission.</p> <p> For details, see "Technical Information" TI00073R and Operating Instructions BA00202R</p>
RNS221	<p>Supply unit for powering two 2-wire measuring devices in the non-Ex area. Bidirectional communication is possible via the HART communication jacks.</p> <p> For details, see "Technical Information" TI00081R and Brief Operating Instructions KA00110R</p>

Documentation

- iTHERM TrustSens TM371, TM372 operating instructions (BA01581T/09) and associated printed brief operating instructions (KA01272T/09)
- Components of the application example:
 - RIA15 loop powered process display - Technical information (TI01043K/09)
 - Active barrier RN221N - Technical information (TI00073R/09)

www.addresses.endress.com
