Technical Information Proline Promass Q 300

Coriolis flowmeter



The innovative specialist for challenging applications with a compact, easily accessible transmitter

Application

- Measuring principle operates independently of physical fluid properties such as viscosity or density
- Highest measurement performance for custody transfer, density and challenging applications

Device properties

- Mass flow: Measured error ±0.05 % (PremiumCal)
- Density: Measured error ±0.2 kg/m³
- High turndown due to low pressure loss/zero point
- Compact dual-compartment housing with up to 3 I/Os
- Backlit display with touch control and WLAN access
- Remote display available

Your benefits

- Guaranteed measurement quality premium accuracy for mass flow, volume flow and density
- Optimized performance for liquids with entrained gas MFT (multi-frequency technology)
- Fewer process measuring points multivariable measurement (flow, density, temperature)
- Space-saving installation no in/outlet run needs
- Full access to process and diagnostic information numerous, freely combinable I/Os and fieldbuses
- Reduced complexity and variety freely configurable I/O functionality
- Integrated verification Heartbeat Technology



Table of contents

Document information	
Function and system design	5
Measuring principle	
Measuring system	
Equipment architecture	
Safety	
Input	
Measured variable	
Measuring range	• -
Input signal	10
Output	12
Output and input variants	12
Output signal	13
Signal on alarm	16
Ex connection data	18 19
Galvanic isolation	19
Protocol-specific data	19
Power supply	25
Terminal assignment	25
Device plugs available	26
Pin assignment, device plug	26
Supply voltage	26 27
Power consumption	27
Power supply failure	27
Electrical connection	27
Potential equalization	33
Terminals	33
Cable entries	34
Cable specification	34
Performance characteristics	36
reference operating conditions	36
Maximum measured error	36
Repeatability	37
Response time	37
Influence of ambient temperature	37
Influence of medium temperature	38
Influence of medium pressure	38 39
Design fundamentals	29
Installation	39
Mounting location	40
Orientation	40
Inlet and outlet runs	41
Special mounting instructions	41
E	4.2
Environment	43
Ambient temperature rangeStorage temperature	43
competatate	.)

Climate class . Degree of protection . Vibration resistance . Shock resistance . Impact resistance . Interior cleaning . Electromagnetic compatibility (EMC) .	43 43 43 43 43 44 44
Process	44 45 45 45
Rupture disk .Flow limit .Pressure loss .System pressure .Thermal insulation .Heating .Vibrations .	47 47 47 47 47 47 48 48
Custody transfer measurement	48
Mechanical construction	49 60 65 66 68 68
Operability . Operating concept . Languages . Local operation . Remote operation . Service interface . Supported operating tools . HistoROM data management .	68 68 68 70 73 74 75
Certificates and approvals . CE mark . C-Tick symbol . Ex approval . Sanitary compatibility . Functional safety . HART certification . FOUNDATION Fieldbus certification . Certification PROFIBUS . Modbus RS485 certification . Radio approval . Measuring instrument approval . Additional certification . Other standards and guidelines .	76 76 76 77 77 78 78 78 78 78 78 78 78 78 78
Ordering information	80

Application packagesDiagnostics functionsHeartbeat TechnologyConcentration	80 80 80 81
Accessories	81 82 82 83
Supplementary documentation	83 83 84
Registered trademarks	85

Document information

Symbols used

Electrical symbols

Symbol	Meaning	
	Direct current	
\sim	Alternating current	
\sim	Direct current and alternating current	
<u>+</u>	Ground connection A grounded terminal which, as far as the operator is concerned, is grounded via a grounding system.	
	Protective ground connection A terminal which must be connected to ground prior to establishing any other connections.	
Ą	Equipotential connection A connection that has to be connected to the plant grounding system: This may be a potential equalization line or a star grounding system depending on national or company codes of practice.	

Communication symbols

Symbol	Meaning
((:-	Wireless Local Area Network (WLAN) Communication via a wireless, local network.
*	Bluetooth Wireless data transmission between devices over a short distance.
	LED Light emitting diode is off.
-×-	LED Light emitting diode is on.
	LED Light emitting diode is flashing.

Symbols for certain types of information

Symbol	Meaning	
	Permitted Procedures, processes or actions that are permitted.	
	Preferred Procedures, processes or actions that are preferred.	
	Forbidden Procedures, processes or actions that are forbidden.	
i	Tip Indicates additional information.	
	Reference to documentation	
	Reference to page	
	Reference to graphic	
	Visual inspection	

Symbols in graphics

Symbol	Meaning	
1, 2, 3,	Item numbers	
1., 2., 3	Series of steps	
A, B, C,	Views	
A-A, B-B, C-C,	Sections	
EX	lazardous area	
X	Safe area (non-hazardous area)	
≈➡	Flow direction	

Function and system design

Measuring principle


The measuring principle is based on the controlled generation of Coriolis forces. These forces are always present in a system when both translational and rotational movements are superimposed.

- $F_c = 2 \cdot \Delta m (v \cdot \omega)$
- F_c = Coriolis force
- $\Delta m = moving mass$
 - ω = rotational velocity
 - v = radial velocity in rotating or oscillating system

The amplitude of the Coriolis force depends on the moving mass Δm , its velocity v in the system and thus on the mass flow. Instead of a constant rotational velocity ω , the sensor uses oscillation.

In the sensor, two parallel measuring tubes containing flowing fluid oscillate in antiphase, acting like a tuning fork. The Coriolis forces produced at the measuring tubes cause a phase shift in the tube oscillations (see illustration):

- At zero flow (when the fluid is at a standstill) the two tubes oscillate in phase (1).
- Mass flow causes deceleration of the oscillation at the inlet of the tubes (2) and acceleration at the outlet (3).

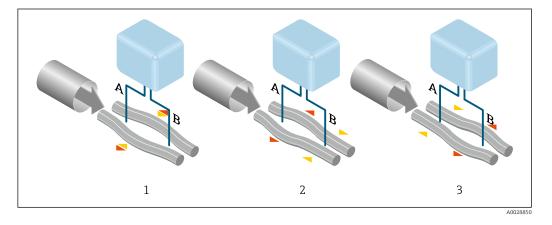

The phase difference (A-B) increases with increasing mass flow. Electrodynamic sensors register the tube oscillations at the inlet and outlet. System balance is ensured by the antiphase oscillation of the two measuring tubes. The measuring principle operates independently of temperature, pressure, viscosity, conductivity and flow profile.

Density measurement

The measuring tube is continuously excited at its resonance frequency. A change in the mass and thus the density of the oscillating system (comprising measuring tube and fluid) results in a corresponding, automatic adjustment in the oscillation frequency. Resonance frequency is thus a function of medium density. The microprocessor utilizes this relationship to obtain a density signal.

Volume measurement

Together with the measured mass flow, this is used to calculate the volume flow.


Temperature measurement

The temperature of the measuring tube is determined in order to calculate the compensation factor due to temperature effects. This signal corresponds to the process temperature and is also available as an output signal.


Measuring system The device consists of a transmitter and a sensor.

The device is available as a compact version: The transmitter and sensor form a mechanical unit.


Transmitter

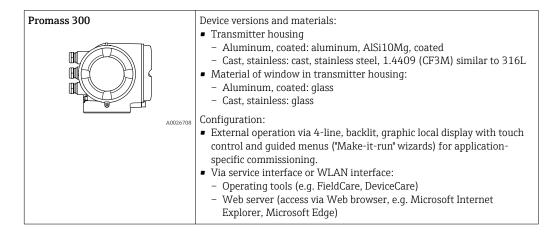

Sensor

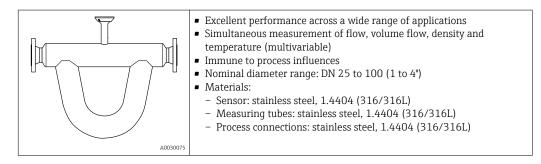

Equipment architecture

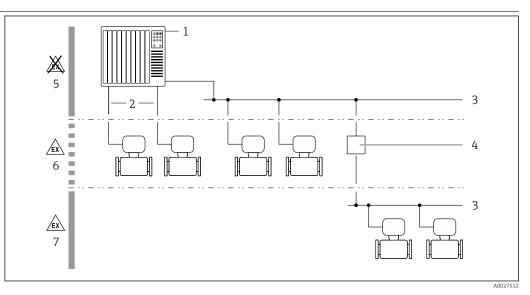

I Possibilities for integrating measuring devices into a system

- 1 Control system (e.g. PLC)
- 2 Connecting cable (0/4 to 20 mA HART etc.)
- 3 Fieldbus
- 4 Segment coupler
- 5 Non-hazardous area
- 6 Non-hazardous area and Zone 2/Div. 2
- 7 Hazardous area and Zone 1/Div. 1

Safety

IT security

We only provide a warranty if the device is installed and used as described in the Operating Instructions. The device is equipped with security mechanisms to protect it against any inadvertent changes to the device settings.

IT security measures in line with operators' security standards and designed to provide additional protection for the device and device data transfer must be implemented by the operators themselves.

Device-specific IT security

The device offers a range of specific functions to support protective measures on the operator's side. These functions can be configured by the user and guarantee greater in-operation safety if used correctly. An overview of the most important functions is provided in the following section.

Protecting access via hardware write protection

Write access to the device parameters via the local display, Web browser or operating tool (e.g. FieldCare, DeviceCare) can be disabled via a write protection switch (DIP switch on the motherboard). When hardware write protection is enabled, only read access to the parameters is possible.

Hardware write protection is disabled when the device is delivered.

Protecting access via a password

Different passwords are available to protect write access to the device parameters or access to the device via the WLAN interface.

User-specific access code

Protect write access to the device parameters via the local display, Web browser or operating tool (e.g. FieldCare, DeviceCare). Is equivalent to hardware write protection in terms of functionality.
WLAN passphrase

The network key protects a connection between an operating unit (e.g. notebook or tablet) and the device via the WLAN interface which can be ordered as an option.

User-specific access code

Write access to the device parameters via the local display, Web browser or operating tool (e.g. FieldCare, DeviceCare) can be protected by the modifiable, user-specific access code.

When the device is delivered, the device does not have an access code and is equivalent to 0000 (open).

WLAN passphrase

A connection between an operating unit (e.g. notebook or tablet) and the device via the WLAN interface which can be ordered as an option is protected by the network key. The WLAN authentication of the network key complies with the IEEE 802.11 standard.

When the device is delivered, the network key is pre-defined depending on the device. It can be changed via the **WLAN settings** submenu in the **WLAN passphrase** parameter.

General notes on the use of passwords

- The access code and network key supplied with the device should be changed during commissioning.
- Follow the general rules for generating a secure password when defining and managing the access code or network key.
- The user is responsible for the management and careful handling of the access code and network key.

Access via fieldbus

When communicating via fieldbus, access to the device parameters can be restricted to "Read only" access. The option can be changed in the **Fieldbus writing access** parameter.

This does not affect cyclic measured value transmission to the higher-order system, which is always guaranteed.

Additional information: "Description of Device Parameters" document pertaining to the device $\rightarrow \cong 84$.

Access via Web server

The device can be operated and configured via a Web browser with the integrated Web server . The connection is via the service interface (CDI-RJ45) or the WLAN interface.

The Web server is enabled when the device is delivered. The Web server can be disabled if necessary (e.g. after commissioning) via the **Web server functionality** parameter.

The device and status information can be hidden on the login page. This prevents unauthorized access to the information.

Additional information: "Description of Device Parameters" document pertaining to the device $\rightarrow \cong 84$.

Input

Measured variable	Direct measured variables		
	Mass flowDensityTemperature		
	Calculated measured variables		
	Volume flowCorrected volume flowReference density		

Measuring range

Measuring ranges for liquids

DN Measuring device		DN Compatible pipe diameter		Measuring range full scale values $\dot{m}_{min(F)}$ to $\dot{m}_{max(F)}$	
[mm]	[in]	[mm]	[in]	[kg/h]	[lb/min]
25	1	25/40	1/1½	0 to 20000	0 to 736
50	2	50/80	2/3	0 to 80 000	0 to 2 944
80	3	80/100	3/4	0 to 200000	0 to 7 360
100	4	100/150	4/6	0 to 550000	0 to 20240

Measuring ranges for gases

The full scale values depend on the density of the gas and can be calculated with the formula below: $\dot{m}_{max(G)} = \dot{m}_{max(F)} \cdot \rho_G$:x

m _{max(G)}	Maximum full scale value for gas [kg/h]	
m _{max(F)}	Maximum full scale value for liquid [kg/h]	
$\dot{m}_{\max(G)} < \dot{m}_{\max(F)}$	$\dot{m}_{max(G)}$ can never be greater than $\dot{m}_{max(F)}$	
ρ _G	Gas density in [kg/m³] at operating conditions	
x	Constant dependent on nominal diameter	

D	x	
[mm]	[in]	[kg/m ³]
25	1	100
50	2	100
80	3	120
100	4	200

To calculate the measuring range, use the Applicator sizing tool $\rightarrow \cong 82$

Calculation example for gas

- Sensor: Promass Q, DN 50
- Gas: Air with a density of 60.3 kg/m³ (at 20 °C and 50 bar)
- Measuring range (liquid): 80 000 kg/h
- x = 100 kg/m³ (for Promass Q, DN 50)

Maximum possible full scale value:

 $\dot{m}_{max(G)} = \dot{m}_{max(F)} \cdot \rho_{G}$: x = 80 000 kg/h \cdot 60.3 kg/m³: 100 kg/m³ = 48 240 kg/h

	Recommended measuring range "Flow limit" section $\rightarrow \cong 47$			
Operable flow range	Over 1000 : 1. Flow rates above the preset full scale value do not override the electronics unit, with the result that the totalizer values are registered correctly.			
Input signal	Input and output versions → 12			
	External measured values			
	Various pressure tran +Hauser: see "Access	nsmitters and temperature measuring devices can be ordered from Endress ories" section $\rightarrow \cong 83$		
	It is recommended to read in external measured values to calculate the following measured variables for gases: • Mass flow • Corrected volume flow			
	HART protocol			
	The measured values are written from the automation system to the measuring device via the HART protocol. The pressure transmitter must support the following protocol-specific functions: • HART protocol • Burst mode			
	Current input			
	The measured values are written from the automation system to the measuring device via the current input $\rightarrow \cong 10$.			
	Digital communication The measured values can be written from the automation system to the measuring via: • FOUNDATION Fieldbus • PROFIBUS PA • Modbus RS485			
	Current input 0/4 to 20 mA			
	Current input	0/4 to 20 mA (active/passive)		
	Current span	 4 to 20 mA (active) 0/4 to 20 mA (passive) 		
	Resolution	1 µA		
	Voltage drop	Typically: 0.6 to 2 V for 3.6 to 22 mA (passive)		
	Maximum input voltage	< 30 V (passive)		
	Open-circuit voltage	< 28.8 V (active)		
	Possible input variables	PressureTemperatureDensity		

Status input

Maximum input values	 DC -3 to 30 V If status input is active (ON): R_i >3 kΩ
Response time	Adjustable: 5 to 200 ms

Input signal level	 Low signal: DC -3 to +5 V High signal: DC 12 to 30 V
Assignable functions	OffReset the individual totalizers separatelyReset all totalizersFlow override

Output

Output and input variants

Depending on the option selected for output/input 1, different options are available for the other outputs and inputs. Only one option can be selected for each output/input 1 to 3. The table must be read vertically (\downarrow) .

Example: If the option **BA** (current output 4 to 20 mA HART) was selected for output/input 1, one of the options **A**, **B**, **D**, **E**, **F**, **H**, **I** or **J** is available for output 2 and one of the options **A**, **B**, **D**, **E**, **F**, **H**, **I** or **J** is available for output 3.

Order code for "Output; input 1" (020) \rightarrow		Possible options					
Current output 4 to 20 mA HART	BA						
Current output 4 to 20 mA HART Ex i	\downarrow	CA					
FOUNDATION Fieldbus		\downarrow	SA				
FOUNDATION Fieldbus Ex i			\downarrow	TA			
PROFIBUS PA				\downarrow	GA		
PROFIBUS PA Ex i					\downarrow	HA	
Modbus RS485						\downarrow	MA
Order code for "Output; input 2" (021) →	\downarrow	\downarrow	\downarrow	\downarrow	\downarrow	\downarrow	\downarrow
Not assigned	A	A	A	A	A	A	A
Current output 0/4 to 20 mA	В		В		В		В
Current output 0/4 to 20 mA (Ex i)		С		С		С	
User configurable input/output ¹⁾	D		D		D		D
Pulse/frequency/switch output	E		E		E		E
Double pulse output ²⁾	F						F
Pulse/frequency/switch output (Ex i)		G		G		G	
Relay output	Н		н		н		Н
Current input 0/4 to 20 mA	I		I		I		I
Status input	J		J		J		J
Order code for "Output; input 3" (022) \rightarrow	\downarrow	\downarrow	\downarrow	\downarrow	\downarrow	\downarrow	\downarrow
Not assigned	A	Α	A	A	A	A	A
Current output 0/4 to 20 mA	В						В
Current output 0/4 to 20 mA (Ex i)		С					
User configurable input/output	D						D
Pulse/frequency/switch output	E						E
Double pulse output (slave) ²⁾	F						F
Pulse/frequency/switch output (Ex i)		G					
Relay output	Н						н
Current input 0/4 to 20 mA	I						I
Status input	J						J

1) A specific input or output can be assigned to a user configurable input/output $\rightarrow \square$ 16.

2) If double pulse output (F) is selected for output/input 2 (021), only the double pulse output (F) option is available for selection for output/input 3 (022).

Output signal

HART current output

Current output	4 to 20 mA HART
Current span	Can be set to: 4 to 20 mA (active/passive)
Open-circuit voltage	DC 28.8 V (active)
Maximum input voltage	DC 30 V (passive)
Load	250 to 700 Ω
Resolution	0.38 μΑ
Damping	Adjustable: 0.07 to 999 s
Assignable measured variables	 Mass flow Volume flow Corrected volume flow Density Reference density Temperature The range of options increases if the measuring device has one or more application packages.

PROFIBUS PA

PROFIBUS PA	In accordance with EN 50170 Volume 2, IEC 61158-2 (MBP), galvanically isolated
Data transfer	31.25 KBit/s
Current consumption	10 mA
Permitted supply voltage	9 to 32 V
Bus connection	With integrated reverse polarity protection

FOUNDATION Fieldbus

FOUNDATION Fieldbus	H1, IEC 61158-2, galvanically isolated
Data transfer	31.25 KBit/s
Current consumption	10 mA
Permitted supply voltage	9 to 32 V
Bus connection	With integrated reverse polarity protection

Modbus RS485

Physical interface	RS485 in accordance with EIA/TIA-485 standard
Terminating resistor	Integrated, can be activated via DIP switches

Current output 0/4 to 20 mA

Current output	0/4 to 20 mA
Maximum output values	22.5 mA
Current span	Can be set to:
	 4 to 20 mA (active) 0/4 to 20 mA (passive)
Open-circuit voltage	DC 28.8 V (active)
Maximum input voltage	DC 30 V (passive)

Load	0 to 700 Ω
Resolution	0.38 μΑ
Damping	Adjustable: 0.07 to 999 s
Assignable measured variables	 Mass flow Volume flow Corrected volume flow Density Reference density Temperature The range of options increases if the measuring device has one or more application packages.

Pulse/frequency/switch output

Function	Can be set to pulse, frequency or switch output
Version	Open collector
	Can be set to: • Active • Passive
Maximum input values	DC 30 V, 250 mA (passive)
Open-circuit voltage	DC 28.8 V (active)
Voltage drop	For 22.5 mA: \leq DC 2 V
Pulse output	
Maximum input values	DC 30 V, 250 mA (passive)
Maximum output current	22.5 mA (active)
Open-circuit voltage	DC 28.8 V (active)
Pulse width	Adjustable: 0.05 to 2 000 ms
Maximum pulse rate	10 000 Impulse/s
Pulse value	Adjustable
Assignable measured variables	 Mass flow Volume flow Corrected volume flow Density Reference density Temperature
Frequency output	
Maximum input values	DC 30 V, 250 mA (passive)
Maximum output current	22.5 mA (active)
Open-circuit voltage	DC 28.8 V (active)
Output frequency	Adjustable: end value frequency 2 to 10000 Hz (f $_{\rm max}$ = 12500 Hz)
Damping	Adjustable: 0 to 999 s
Pulse/pause ratio	1:1
Assignable measured variables	 Mass flow Volume flow Corrected volume flow Density Reference density Temperature The range of options increases if the measuring device has one or more application packages.
Switch output	
Maximum input values	DC 30 V, 250 mA (passive)

Open-circuit voltage	DC 28.8 V (active)
Switching behavior	Binary, conductive or non-conductive
Switching delay	Adjustable: 0 to 100 s
Number of switching cycles	Unlimited
Assignable functions	 Off On Diagnostic behavior Limit value Mass flow Volume flow Corrected volume flow Density Reference density Temperature Totalizer 1-3 Flow direction monitoring Status Partially filled pipe detection Low flow cut off The range of options increases if the measuring device has one or more application packages.

Double pulse output

Function	Double pulse
Version	Open collector
	Can be set to: • Active • Passive
Maximum input values	DC 30 V, 250 mA (passive)
Open-circuit voltage	DC 28.8 V (active)
Voltage drop	For 22.5 mA: ≤ DC 2 V
Output frequency	Adjustable: 0 to 1 000 Hz
Damping	Adjustable: 0 to 999 s
Pulse/pause ratio	1:1
Assignable measured variables	 Mass flow Volume flow Corrected volume flow Density Reference density Temperature The range of options increases if the measuring device has one or more application packages.

Relay output

Function	Switch output
Version	Relay output, galvanically isolated
Switching behavior	Can be set to: • NO (normally open), factory setting • NC (normally closed)

Maximum switching capacity (passive)	 DC 30 V, 0.1 A AC 30 V, 0.5 A
Assignable functions	 Off On Diagnostic behavior Limit value Mass flow Volume flow Corrected volume flow Density Reference density Temperature Totalizer 1-3 Flow direction monitoring Status Partially filled pipe detection Low flow cut off The range of options increases if the measuring device has one or more application packages.

User configurable input/output

One specific input or output is assigned to a user-configurable input/output (configurable I/O) during device commissioning.

The following inputs and outputs are available for assignment:

- Choice of current output: 4 to 20 mA (active), 0/4 to 20 mA (passive)
- Pulse/frequency/switch output
- Choice of current input: 4 to 20 mA (active), 0/4 to 20 mA (passive)
- Status input

The technical values correspond to those of the inputs and outputs described in this section.

Signal on alarm Depending on the interface, failure information is displayed as follows:

HART current output

Device diagnostics	Device condition can be read out via HART Command 48
--------------------	--

PROFIBUS PA

Status and alarm messages	Diagnostics in accordance with PROFIBUS PA Profile 3.02
Error current FDE (Fault Disconnection Electronic)	0 mA

FOUNDATION Fieldbus

Status and alarm messages	Diagnostics in accordance with FF-891
Error current FDE (Fault Disconnection Electronic)	0 mA

Modbus RS485

Failure mode	Choose from:
	NaN value instead of current valueLast valid value

Current output 0/4 to 20 mA

4 to 20 mA

Failure mode Choose from: 4 to 20 mA in accordance with NAMUR recommendation NE 43 4 to 20 mA in accordance with US Min. value: 3.59 mA Max. value: 22.5 mA Freely definable value between: 3.59 to 22.5 mA Actual value Last valid value

0 to 20 mA

Failure mode	Choose from:
	 Maximum alarm: 22 mA
	 Freely definable value between: 0 to 20.5 mA

Pulse/frequency/switch output

Pulse output	
Failure mode	Choose from: • Actual value • No pulses
Frequency output	
Failure mode	Choose from: • Actual value • 0 Hz • Defined value (f _{max} 2 to 12 500 Hz)
Switch output	
Failure mode	Choose from: • Current status • Open • Closed

Relay output

Failure mode	Choose from:
	 Current status
	 Open
	 Closed

Local display

Plain text display	With information on cause and remedial measures
Backlight	Red backlighting indicates a device error.



Status signal as per NAMUR recommendation NE 107

Interface/protocol

- Via digital communication:
 - HART protocol
 - FOUNDATION Fieldbus
 - PROFIBUS PA
 - Modbus RS485
- Via service interface

Plain text display	With information on cause and remedial measures
--------------------	---



Additional information on remote operation \rightarrow 🗎 70

Web server

Plain text display	With information on cause and remedial measures
--------------------	---

Light emitting diodes (LED)

Status information	Status indicated by various light emitting diodes	
	 The following information is displayed depending on the device version: Supply voltage active Data transmission active Device alarm/error has occurred 	

Ex connection data

Safety-related values

Order code for "Output; input 1"	Output type	Safety-related values "Output; input 1"	
		26 (+)	27 (-)
Option BA	Current output 4 to 20 mA HART	U _{nom} = 30 V U _{max} = 250 V	
Option GA	PROFIBUS PA	U _{nom} = 32 V U _{max} = 250 V	
Option MA	Modbus RS485	U _{nom} = 30 V U _{max} = 250 V	
Option SA	FOUNDATION Fieldbus	U _{nom} = 32 V U _{max} = 250 V	

Order code for	Output type Safety-related values					
"Output; input 2"; "Output; input 3"		Output; input 2		Output;	Output; input 3	
• • •		24 (+)	25 (-)	22 (+)	23 (-)	
Option B	Current output 4 to 20 mA	$U_{nom} = 30 V$ $U_{max} = 250 V$				
Option D	User configurable input/ output	$U_{nom} = 30 V$ $U_{max} = 250 V$				
Option E	Pulse/frequency/switch output	$U_{nom} = 30 V$ $U_{max} = 250 V$				
Option F	Double pulse output	$U_{nom} = 30 V$ $U_{max} = 250 V$				
Option H	Relay output	$U_{nom} = 30 V$ $I_{nom} = 100 mL$ $U_{max} = 250 V$	A DC/500 mA	AC		
Option I	Current input 4 to 20 mA	$U_{nom} = 30 V$ $U_{max} = 250 V$				
Option J	Status input	$U_{nom} = 30 V$ $U_{max} = 250 V$				

Order code for "Output; input 1"	Output type	Intrinsically safe values "Output; input 1"	
		26 (+)	27 (-)
Option CA	Current output 4-20 mA HART Ex i	$ \begin{array}{l} U_{i} = 30 \ V \\ l_{i} = 100 \ mA \\ P_{i} = 1.25 \ W \\ L_{i} = 0 \\ C_{i} = 0 \end{array} $	
Option HA	PROFIBUS PA Ex i	Ex ia ¹⁾ $U_i = 30 V$ $l_i = 570 mA$ $P_i = 8.5 W$ $L_i = 10 \mu H$ $C_i = 5 nF$	Ex ic ²⁾ $U_i = 32 V$ $l_i = 570 mA$ $P_i = 8.5 W$ $L_i = 10 \mu H$ $C_i = 5 nF$
Option TA	FOUNDATION Fieldbus Ex i		$Ex ic^{2}$ $U_{i} = 32 V$ $l_{i} = 570 mA$ $P_{i} = 8.5 W$ $L_{i} = 10 \mu H$ $C_{i} = 5 nF$

Intrinsically safe values Intrinsically safe values Intrinsically safe or NIFW values

1)

Only available for the Zone 1, Class I, Division 1 version Only available for the Zone 2, Class I, Division 2 version transmitter 2)

Order code for "Output; input 2";	Output type	Intrinsically safe values Intrinsically safe values Intrinsically safe or NIFW values			
"Output; input 3"		Output; input 2		Output; input 3	
		24 (+)	25 (-)	22 (+)	23 (-)
Option C	Current output 4-20 mA Ex i	$\begin{array}{l} U_i = 30 \ V \\ l_i = 100 \ mA \\ P_i = 1.25 \ W \\ L_i = 0 \\ C_i = 0 \end{array}$			
Option G	Pulse/frequency/switch output Ex i	$\begin{array}{l} U_{i} = 30 \ V \\ l_{i} = 100 \ mA \\ P_{i} = 1.25 \ W \\ L_{i} = 0 \\ C_{i} = 0 \end{array}$			

Low flow cut off	The switch points for low flow cut off are user-selectable.		
Galvanic isolation	The outputs are galvanically isolated from one another and from earth (PE).		
Protocol-specific data	-specific data HART		
	Manufacturer ID	0x11	
	Device type ID	0x3B	
	HART protocol revision	7	
	Device description files (DTM, DD)	Information and files under: www.endress.com	
	HART load	Min. 250 Ω	

Dynamic variables	Read out the dynamic variables: HART command 3 The measured variables can be freely assigned to the dynamic variables.
	Measured variables for PV (primary dynamic variable) Mass flow Volume flow Corrected volume flow Density Reference density Temperature
	Measured variables for SV, TV, QV (secondary, tertiary and quaternary dynamic variable) Mass flow Volume flow Corrected volume flow Density Reference density Temperature Totalizer 1 Totalizer 2 Totalizer 3
	The range of options increases if the measuring device has one or more application packages.
	Heartbeat Technology Application Package Additional measured variables are available with the Heartbeat Technology application package: Oscillation amplitude 0
	$fin Heartbeat Technology Special Documentation \rightarrow \textcircled{B} 84$
Device variables	Read out the device variables: HART command 9 The device variables are permanently assigned.
	A maximum of 8 device variables can be transmitted: • 0 = mass flow • 1 = volume flow • 2 = corrected volume flow • 3 = density • 4 = reference density • 5 = temperature • 6 = totalizer 1 • 7 = totalizer 2 • 8 = totalizer 3 • 13 = target mass flow • 14 = carrier mass flow

PROFIBUS PA

Manufacturer ID	0x11
Ident number	0x156D
Profile version	3.02
Device description files (GSD, DTM, DD)	Information and files under: • www.endress.com • www.profibus.org

Output values (from measuring device to automation system)	Analog input 1 to 8 Mass flow Volume flow Corrected volume flow Carrier mass flow Target mass flow Density Reference density Reference density Carrier pipe temperature Carrier pipe temperature Carrier pipe temperature Carrier pipe temperature The range of options increases if the measuring device has one or more
	 The range of options increases if the measuring device has one or more application packages. Heartbeat Technology Application Package Additional measured variables are available with the Heartbeat Technology application package: Oscillation frequency 0 Frequency fluctuation 0 Oscillation amplitude 0 Oscillation damping 1 Oscillation damping fluctuation 0 Exciter current 0 Heartbeat Technology Special Documentation → 84
	Digital input 1 to 2 Empty pipe detection Low flow cut off Status verification Totalizer 1 to 3 Mass flow Volume flow Corrected volume flow Target mass flow Carrier mass flow
Input values (from automation system to measuring device)	 Analog output 1 to 3 (fixed assignment) Analog output 1: external pressure Analog output 2: external temperature Analog output 3: external reference density Digital output 1 to 4: (fixed assignment) Digital output 1: switch positive zero return on/off Digital output 2: switch zero point adjustment on/off Digital output 3: start verification Digital output 4: relay output non-conductive/conductive
	Totalizer 1 to 3 • Totalize • Reset and hold • Preset and hold • Operating mode configuration: - Net flow total - Forward flow total - Reverse flow total - Last valid value
Supported functions	 Identification & Maintenance Simplest device identification on the part of the control system and nameplate PROFIBUS upload/download Reading and writing parameters is up to ten times faster with PROFIBUS upload/download Condensed status Simplest and self-explanatory diagnostic information by categorizing diagnostic messages that occur

Configuration of the device address	 DIP switches on the I/O electronics module Local display Via operating tools (e.g. FieldCare)
Compatibility with earlier model	If the device is replaced, the Promass 300 measuring device supports the compatibility of the cyclic data with earlier models. It is not necessary to adjust the engineering parameters of the PROFIBUS network with the Promass 300 GSD file.
	 Earlier models: Promass 80 PROFIBUS PA ID No.: 1528 (hex) Extended GSD file: EH3x1528.gsd Standard GSD file: EH3_1528.gsd Promass 83 PROFIBUS PA ID No.: 152A (hex) Extended GSD file: EH3x152A.gsd Standard GSD file: EH3_152A.gsd Description of the function scope of compatibility: Operating Instructions → 84.

FOUNDATION Fieldbus

Manufacturer ID	0x452B48
Ident number	0x103B
Device revision	1
DD revision	Information and files under:
CFF revision	www.endress.comwww.fieldbus.org
Interoperability Test Kit (ITK)	Version 6.1.2
ITK Test Campaign Number	Information: • www.endress.com • www.fieldbus.org
Link Master capability (LAS)	Yes
Choice of "Link Master" and "Basic Device"	Yes Factory setting: Basic Device
Node address	Factory setting: 247 (0xF7)
Supported functions	The following methods are supported: • Restart • ENP Restart • Diagnostic
Virtual Communication Relation	nships (VCRs)
Number of VCRs	44
Number of link objects in VFD	50
Permanent entries	1
Client VCRs	0
Server VCRs	10
Source VCRs	43
Sink VCRs	0
Subscriber VCRs	43
Publisher VCRs	43
Device Link Capabilities	
Slot time	4
Min. delay between PDU	8
Max. response delay	20

Transducer Blocks

Block	Contents	Output values
Setup Transducer Block (TRDSUP)	All parameters for standard commissioning.	No output values
Advanced Setup Transducer Block (TRDASUP)	All parameters for more accurate measurement configuration.	No output values
Display Transducer Block (TRDDISP)	Parameters for configuring the local display.	No output values
HistoROM Transducer Block (TRDHROM)	Parameters for using the HistoROM function.	No output values
Diagnostic Transducer Block (TRDDIAG)	Diagnostics information.	Process variables (AI Channel) • Temperature (7) • Volume flow (9) • Mass flow (11) • Corrected volume flow (13) • Density (14) • Reference density (15) • Carrier pipe temperature (51) • Carrier mass flow (57) • Target mass flow (58) • Electronic temperature (65) • Current input 1 (99)
Expert Configuration Transducer Block (TRDEXP)	Parameters that require the user to have in- depth knowledge of the operation of the device in order to configure the parameters appropriately.	No output values
Expert Information Transducer Block (TRDEXPIN)	Parameters that provide information about the state of the device.	No output values
Service Sensor Transducer Block (TRDSRVS)	Parameters that can only be accessed by Endress +Hauser Service.	No output values
Service Information Transducer Block (TRDSRVIF)	Parameters that provide Endress+Hauser Service with information about the state of the device.	No output values
Total Inventory Counter Transducer Block (TRDTIC)	Parameters for configuring all the totalizers and the inventory counter.	Process variables (AI Channel) • Totalizer 1 (16) • Totalizer 2 (17) • Totalizer 3 (18)
Heartbeat Technology Transducer Block (TRDHBT)	Parameters for the configuration and comprehensive information about the results of the verification.	No output values
Heartbeat Results 1 Transducer Block (TRDHBTR1)	Information about the results of the verification.	No output values
Heartbeat Results 2 Transducer Block (TRDHBTR2)	Information about the results of the verification.	No output values
Heartbeat Results 3 Transducer Block (TRDHBTR3)	Information about the results of the verification.	No output values
Heartbeat Results 4 Transducer Block (TRDHBTR4)	Information about the results of the verification.	No output values

Function blocks

Block	Number blocks	Execution times	Process variables (Channel)		
Resource Block (RB)	1	This Block (extended functionality) contains all the data that uniquely identify the device; it is the equivalent of an electronic nameplate for the device.	-		
Analog Input Block (AI)	8	7 ms	Process variables (AI Channel) Temperature (7) Volume flow (9) Mass flow (11) Corrected volume flow (13) Density (14) Reference density (15) Totalizer 1 (16) Totalizer 2 (17) Totalizer 3 (18) Carrier pipe temperature (51) Carrier mass flow (57) Target mass flow (58) Electronic temperature (65) Current input 1 (99)		
Discrete Input Block (DI)	2	5 ms	 Switch output state (101) Low flow cut off (103) Empty pipe detection (104) Status verification (105) 		
PID Block (PID)	1	6 ms	-		
Multiple Analog Output Block (MAO)	1	5 ms	 Channel_0 (121) Value 1: External compensation variable, pressure Value 2: External compensation variable, temperature Value 3: External compensation variable, reference density The compensation 		
			In the compensation variables must be transmitted to the device in the SI basic units.		
Multiple Digital Output Block (MDO)	1	5 ms	Channel_DO (122) Value 1: Reset totalizer 1 Value 2: Reset totalizer 2 Value 3: Reset totalizer 3 Value 4: Flow override Value 5: Start heartbeat verification Value 6: Status switch output Value 7: Start zero point adjustment Value 8: Not assigned		
Integrator Block (IT)	1	6 ms	_		

Modbus RS485

Protocol	Modbus Applications Protocol Specification V1.1
Response times	Direct data access: typically 25 to 50 msAuto-scan buffer (data range): typically 3 to 5 ms

Device type	Slave
Slave address range	1 to 247
Broadcast address range	0
Function codes	 03: Read holding register 04: Read input register 06: Write single registers 08: Diagnostics 16: Write multiple registers 23: Read/write multiple registers
Broadcast messages	 Supported by the following function codes: 06: Write single registers 16: Write multiple registers 23: Read/write multiple registers
Supported baud rate	 1 200 BAUD 2 400 BAUD 4 800 BAUD 9 600 BAUD 19 200 BAUD 38 400 BAUD 57 600 BAUD 115 200 BAUD
Data transfer mode	ASCII RTU
Data access	Each device parameter can be accessed via Modbus RS485.
Compatibility with earlier model	If the device is replaced, the Promass 300 measuring device supports the compatibility of the Modbus registers for process variables and diagnostic information with the earlier Promass 83 model. It is not necessary to change the engineering parameters in the automation system. Description of the function scope of compatibility: Operating Instructions → 🗎 84.

Power supply

Terminal assignment

Transmitter: supply voltage, input/outputs

HART

Supply	voltage	Input/output 1		Input/output 2		Input/output 3		
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (+)	23 (-)	
		The terminal assignment depends on the specific device version ordered $\rightarrow \square$ 12.						

FOUNDATION Fieldbus

Supply voltage		Input/output 1		Input/output 2		Input/output 3		
1 (+)	2 (-)	26 (A)	27 (B)	24 (+)	25 (-)	22 (+)	23 (-)	
		The terminal assignment depends on the specific device version ordered $\rightarrow \cong 12$.						

PROFIBUS PA

Supply	Supply voltage		Input/output 1		Input/output 2		Input/output 3	
1 (+)	2 (-)	26 (B)	27 (A)	24 (+)	25 (-)	22 (+)	23 (-)	
		The terminal assignment depends on the specific device version ordered $\rightarrow \square 12$.						

Modbus RS485

Supply	voltage	Input/output 1		Input/output 2		Input/output 3		
1 (+)	2 (-)	26 (B)	27 (A)	24 (+)	25 (-)	22 (+)	23 (-)	
		The terminal assignment depends on the specific device version ordered $\rightarrow \square 12$.						

Terminal assignment of the remote display and operating module: \rightarrow 🗎 27

Device plugs available

P Device plugs may not be used in hazardous areas!

Device plugs are only available for the following device versions:

Order code for "Input; output 1"

- Option GA "PROFIBUS PA" \rightarrow \cong 26
- Option SA "FOUNDATION Fieldbus" $\rightarrow \cong 26$

Order code for "Input; output 1", option GA "PROFIBUS PA"

Order code for	Cable entry	Cable entry	
"Electrical connection"	2	3	
L, N, P, U	Plug M12 × 1	-	

Order code for "Input; output 1", option SA "FOUNDATION Fieldbus"

Order code for	Cable entry	Cable entry	
"Electrical connection"	2	3	
M, 3, 4, 5	7/8" plug	-	

Pin assignment, device plug

PROFIBUS PA

Pin		Assignment	Coding	Plug/socket
1	+	PROFIBUS PA +	А	Plug
2		Grounding		
3	-	PROFIBUS PA -		
4		Not assigned		

FOUNDATION Fieldbus

Pin		Assignment	Coding	Plug/socket
1	+	Signal +	А	Plug
2	-	Signal –		
3		Grounding		
4		Not assigned		


Supply voltage

Order code for "Power supply"	terminal voltage		Frequency range	
Option D	DC 24 V	±20%	-	
Option E	AC100 to 240 V	-15+10%	50/60 Hz	
Option I	DC 24 V	±20%	-	
	AC100 to 240 V	-15+10%	50/60 Hz	

Power consumption	Transmitter		
	Max. 10 W (active power)		
Current consumption	Transmitter		
	 Max. 400 mA (24 V) Max. 200 mA (110 V, 50/60 Hz; 230 V, 50/60 Hz) 		
Power supply failure	 Totalizers stop at the last value measured. Configuration is retained in the plug-in memory (HistoROM DAT). Error messages (incl. total operated hours) are stored. 		
Electrical connection	Connecting the transmitter ■ Terminal assignment → ■ 25 ■ Device plugs available → ■ 26		

- Cable entry for supply voltage 1
- Cable entry for input/output signal transmission
- 2 3 Cable entry for input/output signal transmission; Optional: connection of external WLAN antenna, connection of remote display and operating module DKX001 or service plug

Connection of remote display and operating module DKX001

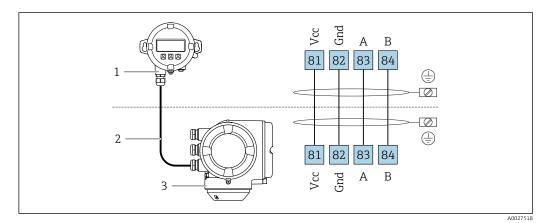

- Remote display and operating module DKX001 1
- 2 Connecting cable
- 3 Measuring device




Remote display and operating module DKX001 \rightarrow 🗎 81

A0026783


Connection examples

Current output 4 to 20 mA HART

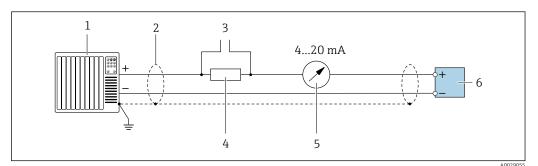


■ 2 Connection example for 4 to 20 mA HART current output (active)

- 1 Automation system with current input (e.g. PLC)
- 2 Cable shield: the cable shield must be grounded at both ends to comply with EMC requirements; observe cable specifications → 🗎 34
- 3 Connection for HART operating devices $\rightarrow \square 70$
- 4 Resistor for HART communication ($\geq 250 \Omega$): observe maximum load $\rightarrow \square 13$
- 5 Analog display unit: observe maximum load $\rightarrow \equiv 13$
- 6 Transmitter

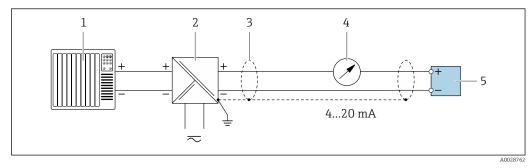


- ☑ 3 Connection example for 4 to 20 mA HART current output (passive)
- 1 Automation system with current input (e.g. PLC)
- 2 Power supply
- 3 Cable shield: the cable shield must be grounded at both ends to comply with EMC requirements; observe cable specifications → 🗎 34
- 4 Analog display unit: observe maximum load $\rightarrow \equiv 13$
- 5 Transmitter

HART input

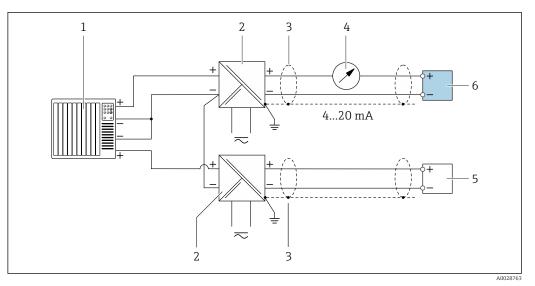


- Connection example for HART input with a common negative (passive)
- 1 Automation system with HART output (e.g. PLC)
- 2 Active barrier for power supply (e.g. RN221N)
- 3 Cable shield: the cable shield must be grounded at both ends to comply with EMC requirements; observe cable specifications
- 4 Analog display unit: observe maximum load
- 5 Pressure transmitter (e.g. Cerabar M, Cerabar S): see requirements
- 6 Transmitter

PROFIBUS-PA

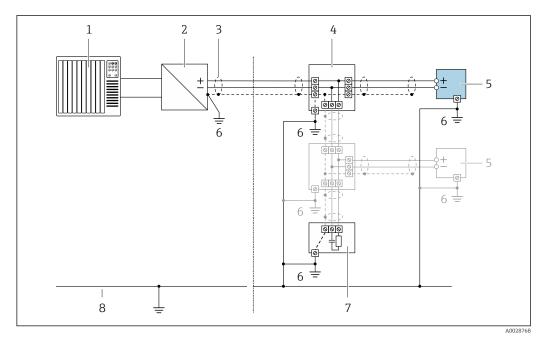

- 5 Connection example for PROFIBUS-PA
- 1 Control system (e.g. PLC)
- 2 PROFIBUS PA segment coupler
- 3 Cable shield: the cable shield must be grounded at both ends to comply with EMC requirements; observe cable specifications
- 4 T-box
- 5 Measuring device
- 6 Local grounding
- 7 Bus terminator
- 8 Potential matching line


FOUNDATION Fieldbus

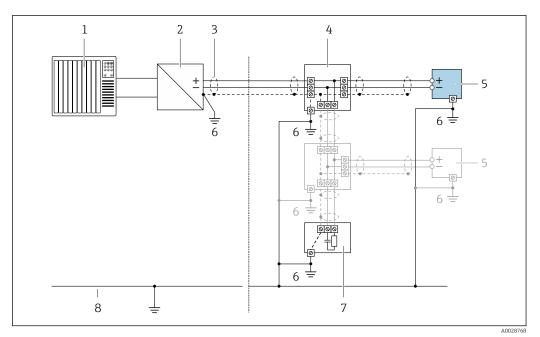

፼ 6 Connection example for FOUNDATION Fieldbus

- 1
- Control system (e.g. PLC) Power Conditioner (FOUNDATION Fieldbus) 2
- Cable shield: the cable shield must be grounded at both ends to comply with EMC requirements; observe cable 3 specifications
- . T-box 4
- Measuring device Local grounding 5
- 6
- Bus terminator 7
- 8 Potential matching line


Modbus RS485

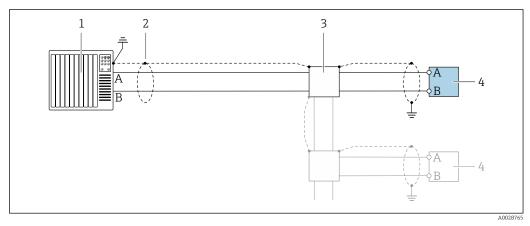

₽ 7 Connection example for Modbus RS485, non-hazardous area and Zone 2/Div. 2


- Control system (e.g. PLC) 1
- 2 Cable shield: the cable shield must be grounded at both ends to comply with EMC requirements; observe cable specifications
- 3 Distribution box
- Transmitter 4

Current output 4-20 mA

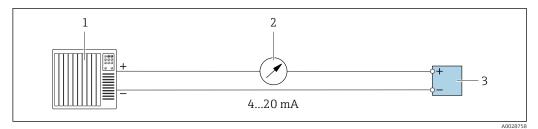

Connection example for 4-20 mA current output (active)


- 1 Automation system with current input (e.g. PLC)
- 2 Analog display unit: observe maximum load
- 3 Transmitter

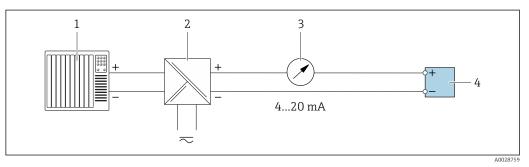

Connection example for 4-20 mA current output (passive)


- 1 Automation system with current input (e.g. PLC)
- 2 Active barrier for power supply (e.g. RN221N)
- 3 Analog display unit: observe maximum load
- 4 Transmitter


Pulse/frequency output

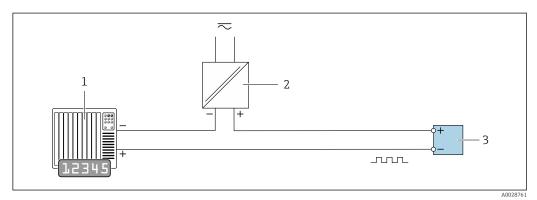

- 10 Connection example for pulse/frequency output (passive)
- 1 Automation system with pulse/frequency input (e.g. PLC)
- Power supply
 Transmitter: 0
- 3 Transmitter: Observe input values $\rightarrow \square 14$


Switch output

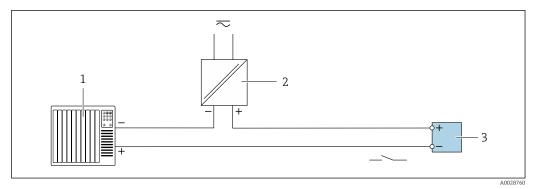




- 1 Automation system with switch input (e.g. PLC)
- 2 Power supply
- 3 Transmitter: Observe input values $\rightarrow \square 14$

Double pulse output

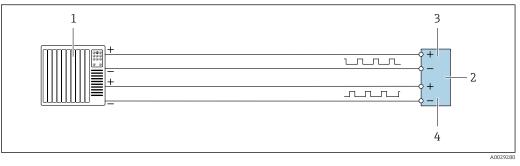

■ 12 Connection example for double pulse output (active)


- 1 Automation system with double pulse input (e.g. PLC)
- *2* Transmitter: Observe input values $\rightarrow \square 15$
- 3 Double pulse output
- 4 Double pulse output (slave), phase-shifted

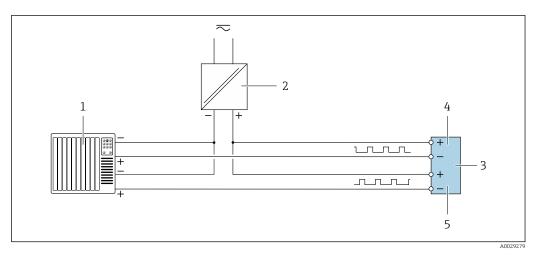

13 Connection example for double pulse output (passive)

- 1 Automation system with double pulse input (e.g. PLC)
- 2 Power supply
- 3 Transmitter: Observe input values $\rightarrow \square 15$
- 4 Double pulse output
- 5 Double pulse output (slave), phase-shifted


Relay output

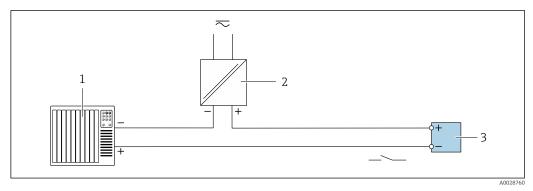

14 Connection example for relay output (passive)


- 1 Automation system with relay input (e.g. PLC)
- 2 Power supply
- 3 Transmitter: Observe input values $\rightarrow \cong 15$

Current input

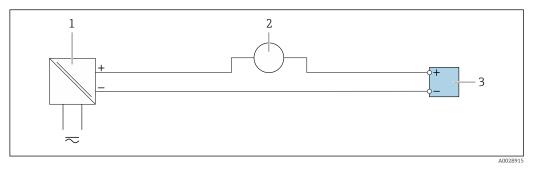

- Connection example for 4 to 20 mA current input
- 1 Power supply
- 2 External measuring device (for reading in pressure or temperature, for instance)
- 3 Transmitter: Observe input values

Status input

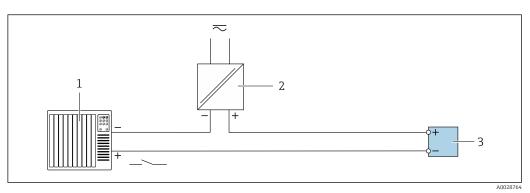

🖻 16 Connection example for status input

- 1 Automation system with status output (e.g. PLC)
- 2 Power supply
- 3 Transmitter: Observe input values

 Potential equalization
 Requirements No special measures for potential equalization are required.

 Terminals
 Transmitter Spring terminals for conductor cross-section 0.2 to 2.5 mm² (24 to 12 AWG)

Cable entries	 Cable gland: M20 × 1.5 with cable Ø 6 to 12 mm (0.24 to 0.47 in) Thread for cable entry: NPT ½" G ½" M20 Device plug for digital communication: M12 Only available for certain device versions → ⁽¹⁾/₂ 26. 			
Cable specification	Permitted temperature range			
	Minimum requirement: cable temperature range \geq ambient temperature +20 K			
	Power supply cable			
	Standard installation cable is sufficient.			
	Protective ground cable			
	Cable: 2.1 mm ² (14 AWG)			
	The grounding impedance must be less than 1 Ω .			
	Signal cable			
	Current output 4 to 20 mA HART			
	A shielded cable is recommended. Observe grounding concept of the plant.			
	PROFIBUS PA			
	Twisted, shielded two-wire cable. Cable type A is recommended .			
	For further information on planning and installing PROFIBUS PA networks see:			
	 Operating Instructions "PROFIBUS DP/PA: Guidelines for planning and commissioning" (BA00034S) PNO Directive 2.092 "PROFIBUS PA User and Installation Guideline" IEC 61158-2 (MBP) 			
	FOUNDATION Fieldbus			
	Twisted, shielded two-wire cable.			
	For further information on planning and installing FOUNDATION Fieldbus networks see:			
	 Operating Instructions for "FOUNDATION Fieldbus Overview" (BA00013S) FOUNDATION Fieldbus Guideline IEC 61158-2 (MBP) 			
	Modbus RS485			
	The EIA/TIA-485 standard specifies two types of cable (A and B) for the bus line which can be use for every transmission rate. Cable type A is recommended.			

Cable type	A
Characteristic impedance	135 to 165 Ω at a measuring frequency of 3 to 20 MHz
Cable capacitance	< 30 pF/m
Wire cross-section	> 0.34 mm ² (22 AWG)
Cable type	Twisted pairs
Loop resistance	<110 Ω/km
Signal damping	Max. 9 dB over the entire length of the cable cross-section
Shield	Copper braided shielding or braided shielding with foil shield. When grounding the cable shield, observe the grounding concept of the plant.

Current output 0/4 to 20 mA

Standard installation cable is sufficient.

Pulse/frequency/switch output Standard installation cable is sufficient.

Double pulse output

Standard installation cable is sufficient.

Relay output Standard installation cable is sufficient.

Current input 0/4 to 20 mA Standard installation cable is sufficient.

Status input Standard installation cable is sufficient.

Connecting cable for transmitter - remote display and operating module DKX001

Standard cable

A standard cable can be used as the connecting cable.

Standard cable	4 cores (2 pairs); pair-stranded with common shield	
Shielding	Tin-plated copper-braid, optical cover \geq 85 %	
Capacitance: core/shield	Maximum 1 000 nF for Zone 1, Class I, Division 1	
L/R	Maximum 24 $\mu H/\Omega$ for Zone 1, Class I, Division 1	
Cable length	Maximum 300 m (1000 ft), see the following table	

Cross-section	Cable length for use in non-hazardous area, Ex Zone 2, Class I, Division 2 Ex Zone 1, Class I, Division 1		
0.34 mm ² (22 AWG)	80 m (270 ft)		
0.50 mm ² (20 AWG)	120 m (400 ft)		
0.75 mm ² (18 AWG)	180 m (600 ft)		
1.00 mm ² (17 AWG)	240 m (800 ft)		
1.50 mm ² (15 AWG)	300 m (1000 ft)		

Optionally available connecting cable

Standard cable	$2\times2\times0.34~mm^2$ (22 AWG) PVC cable with common shield (2 pairs, pair-stranded)		
Flame resistance	According to DIN EN 60332-1-2		
Oil-resistance	According to DIN EN 60811-2-1		
Shielding	Tin-plated copper-braid, optical cover \ge 85 %		
Capacitance: core/shield	<200 pF/m		
L/R	<24 μH/Ω		
Available cable length	10 m (35 ft)		
Operating temperatureWhen mounted in a fixed position: -50 to +105 °C (-58 to +221 °F); while the can move freely: -25 to +105 °C (-13 to +221 °F)			

reference operating	 Error limits based on IS Water with 115 to 145 		a 6 har (20 to 97 noi)			
conditions	 Water with +15 to +45 °C (+59 to +113 °F) at2 to 6 bar (29 to 87 psi) Specifications as per calibration protocol 					
	 Accuracy based on accredited calibration rigs that are traced to ISO 17025. To obtain measured errors, use the <i>Applicator</i> sizing tool → 					
Maximum measured error	o.r. = of reading; $1 \text{ g/cm}^3 = 1 \text{ kg/l}$; T = medium temperature					
	Base accuracy					
	Design fundamentals $\rightarrow \cong 39$					
	Mass flow and volume flo	w (liquids)				
	± 0.05 % o.r. (PremiumCal; order code for "Calibration flow", option D , for mass flow) ± 0.10 % o.r.					
	Mass flow (gases)					
	±0.35 % o.r.					
	Density (liquids)					
	±0.2 kg/m ³ / ±0.0002 g/cm ³					
	Valid between 20 °C and 60 °C. The measured error increases by 0.015 kg/(m ^{3.} °C) outside the temperature range.					
	Valid range for density calibration: 0 to 2 000 kg/m ³ , +20 to +60 $^\circ$ C (+68 to +140 $^\circ$ F)					
	The density specification only applies as of a minimum flow velocity of 0.2 m/s in relation to the nominal diameter.					
	For the highest density measurement accuracy avoid significant tensile stresses due to the installation					
	Temperature					
	±0.1 ℃ ± 0.003 · T ℃ (±0.18 ℉ ± 0.003 · (T − 32) ℉)					
	Zero point stability					
	D	DN Zero point stability				
	[mm]	[in]	[kg/h]	[lb/min]		
	25	1	0.36	0.013		
	50	2	1.8	0.066		
	80	3	5.4	0.20		
	100	4	11.5	0.42		

Performance characteristics

Flow values

Flow values as turndown parameter depending on nominal diameter.

SI units

DN	1:1	1:10	1:20	1:50	1:100	1:500
[mm]	[kg/h]	[kg/h]	[kg/h]	[kg/h]	[kg/h]	[kg/h]
25	20000	2 000	1000	400	200	40
50	80000	8000	4000	1600	800	160

DN	1:1	1:10	1:20	1:50	1:100	1:500
[mm]	[kg/h]	[kg/h]	[kg/h]	[kg/h]	[kg/h]	[kg/h]
80	200000	20000	10000	4000	2 000	400
100	550000	55000	27500	11000	5 500	1100

US units

DN	1:1	1:10	1:20	1:50	1:100	1:500
[inch]	[lb/min]	[lb/min]	[lb/min]	[lb/min]	[lb/min]	[lb/min]
1	736	73.6	36.8	14.7	7.4	1.5
2	2944	294.4	147.2	58.9	29.5	5.9
3	7360	736	368	147.2	73.6	14.7
4	20240	2024	1012	404.8	202.4	40.5

Accuracy of outputs

The outputs have the following base accuracy specifications.

Current output

Accuracy

±5 μA

Pulse/frequency output

o.r. = of reading

Accuracy	Max. ± 50 ppm o.r. (across the entire ambient temperature range)				
o.r. = of reading; $1 \text{ g/cm}^3 = 1 \text{ kg/l}$; T = medium temperature					
Base repeatability					
Mass flow and volume f ± 0.025 % o.r.	low (liquids)				
Mass flow (gases) $\pm 0.25 \%$ o.r.					
Design fundamentals → 🗎 39					
Density (liquids) $\pm 0.1 \text{ kg/m}^3 / \pm 0.0001 \text{ g/cm}^3$					
Temperature ±0.05 ℃ ± 0.0025 · T ℃ (±0.09 °F ± 0.0015 · (T-32) °F)				
The response time depen	ds on the configuration (damping).				
Current output					
Temperature coefficient	Max. 1 µA/°C				
Pulse/frequency output					
Temperature coefficient	No additional effect. Included in accuracy.				
	 o.r. = of reading; 1 g/cm³ Base repeatability Mass flow and volume f ±0.025 % o.r. Mass flow (gases) ±0.25 % o.r. Design fundamentation Density (liquids) ±0.1 kg/m³ / ±0.0001 g/ Temperature ±0.05 °C ± 0.0025 · T °C (The response time depen Current output Temperature coefficient Pulse/frequency output 				

Influence of medium temperature


Mass flow and volume flow

o.f.s. = of full scale value

When there is a difference between the temperature at zero point adjustment and the process temperature, the typical measured error of the sensor is DN 25 (1"): $\pm 0.0001 \% \text{ o.f.s./°C} (\pm 0.00005 \% \text{ o.f.s./°F})$ DN 50, 80, 100 (2", 3", 4"): $\pm 0.00015 \% \text{ o.f.s./°C} (\pm 0.000075 \% \text{ o.f.s./°F})$

Density

When there is a difference between the density calibration temperature and the process temperature, the typical measured error of the sensor is $\pm 0.015 \text{ kg/m}^3$ /°C ($\pm 0.0075 \text{ kg/m}^3$ /°F)

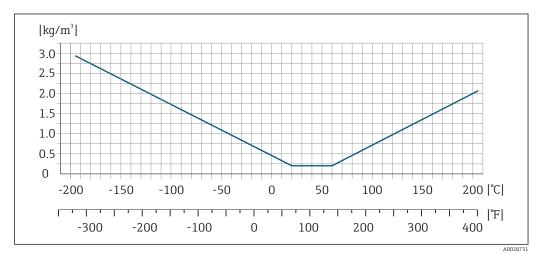

Temperature

±0.005 · T °C (± 0.005 · (T – 32) °F)

Mass flow							
D	N	[% o.r./bar]	[% o.r./psi]				
[mm]	[in]						
25	1	-0.004	-0.00028				
50	2	-0.003	-0.00021				
80	3	-0.0085	-0.00059				
100	4	-0.0065	-0.00045				

Volume flow

DN		[% o.r./bar]	[% o.r./psi]
[mm]	[in]		
25	1	-0.0035	-0.00024
50	2	+0.0005	+0.00003
80	3	-0.008	-0.00055
100	4	-0.0065	-0.00045

Density

DN		[% o.r./bar]	[% o.r./psi]
[mm]	[in]		
25	1	-0.0005	-0.00003
50	2	-0.0035	-0.00024

Influence of medium pressure

DN		[% o.r./bar]	[% o.r./psi]
[mm]	[in]		
80	3	-0.0005	-0.00003
100	4	-0.0005	-0.00003

Design fundamentals

o.r. = of reading, o.f.s. = of full scale value

BaseAccu = base accuracy in % o.r., BaseRepeat = base repeatability in % o.r.

MeasValue = measured value; ZeroPoint = zero point stability


Calculation of	f the maximum	measured err	or as a fur	nction of the	flow rate

Flow rate		Maximum measured error in % o.r.
$\geq \frac{\text{ZeroPoint}}{\text{BaseAccu}} \cdot 100$		± BaseAccu
	A0021332	
$< \frac{\text{ZeroPoint}}{\text{BaseAccu}} \cdot 100$		$\pm \frac{\text{ZeroPoint}}{\text{MeasValue}} \cdot 100$
	A0021333	A0021334

Calculation of the maximum repeatability as a function of the flow rate

Flow rate	Maximum repeatability in % o.r.
$\geq \frac{\frac{1}{2} \cdot \text{ZeroPoint}}{\text{BaseRepeat}} \cdot 100$	± BaseRepeat
A0021335	10046210
$< \frac{\frac{1}{2} \cdot \text{ZeroPoint}}{\text{BaseRepeat}} \cdot 100$	$\pm \frac{1}{2} \cdot \frac{\text{ZeroPoint}}{\text{MeasValue}} \cdot 100$
A0021336	A0021337

Example for max. measured error

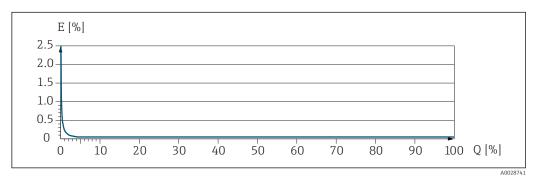


E Error: Maximum measured error as % o.r. (example using PremiumCal)

Q Flow rate as %

Installation

No special measures such as supports etc. are necessary. External forces are absorbed by the construction of the device.

Mounting location

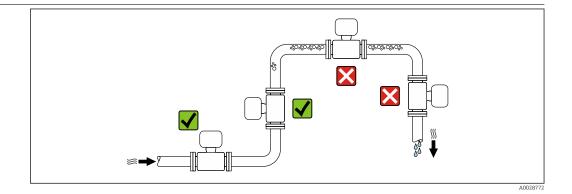


To prevent measuring errors arising from accumulation of gas bubbles in the measuring tube, avoid the following mounting locations in the pipe:

- Highest point of a pipeline.
- Directly upstream of a free pipe outlet in a down pipe.

Installation in down pipes

However, the following installation suggestion allows for installation in an open vertical pipeline. Pipe restrictions or the use of an orifice with a smaller cross-section than the nominal diameter prevent the sensor running empty while measurement is in progress.

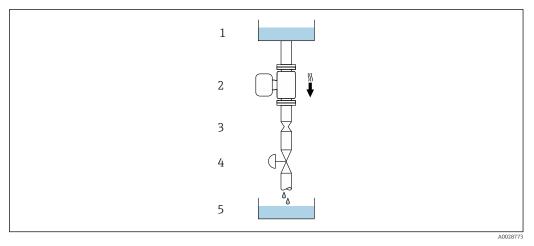

Installation in a down pipe (e.g. for batching applications)

- 1 Supply tank
- 2 Sensor
- 3 Orifice plate, pipe restriction
- 4 Valve
- 5 Batching tank

D	N	Ø orifice plate, pipe restriction		
[mm]	[in]	[mm]	[in]	
25	1	14	0.55	
50	2	28	1.10	
80	3	50	1.97	
100	4	65	2.60	


Orientation

The direction of the arrow on the sensor nameplate helps you to install the sensor according to the flow direction (direction of medium flow through the piping).

	Orientatio	Recommendation	
A	Vertical orientation	A0015591	
В	Horizontal orientation, transmitter at top	A0015589	Z Z ¹⁾ Exceptions: → E 18, B 41
С	Horizontal orientation, transmitter at bottom	A0015590	Exceptions: $\rightarrow \blacksquare 18, \boxminus 41$
D	Horizontal orientation, transmitter at side	A0015592	$\mathbf{V}\mathbf{V} \neq \mathbf{E} 41^{3)}$

1) Applications with low process temperatures may decrease the ambient temperature. To maintain the minimum ambient temperature for the transmitter, this orientation is recommended.

- 2) Applications with high process temperatures may increase the ambient temperature. To maintain the maximum ambient temperature for the transmitter, this orientation is recommended.
- 3) Not recommended for inhomogeneous media.

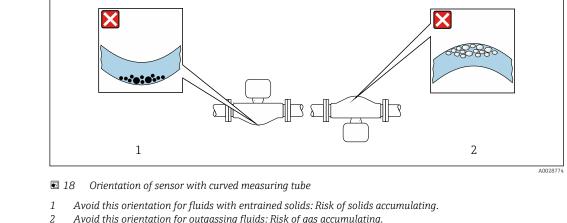

Avoid this orientation for outgassing fluids: Risk of gas accumulating.

or T-pieces, as long as no cavitation occurs $\rightarrow \cong 47$.

Inlet and outlet runs

Special mounting instructions

Drainability

The measuring tubes can be completely drained and protected against solids build-up in vertical orientation.

No special precautions need to be taken for fittings which create turbulence, such as valves, elbows


Rupture disk

The position of the rupture disk is indicated on a sticker beside it.

The transportation guard must be removed.

The existing connecting nozzles are not intended for the purpose of rinsing or pressure monitoring, but instead serve as the mounting location for the rupture disk.

In the event of a failure of the rupture disk, a discharge device can be screwed onto the internal thread of the rupture disk in order to drain off any escaping medium.

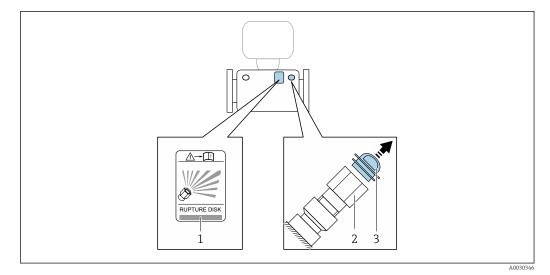

- 1 Rupture disk label
- 2 Rupture disk with 1/2" NPT internal thread with 1" width across flat
- 3 Transport protection

For information on the dimensions: see the "Mechanical construction -> Accessories" section


Zero point adjustment

All measuring devices are calibrated in accordance with state-of-the-art technology. Calibration takes place under reference conditions $\rightarrow \cong$ 36. Therefore, a zero point adjustment in the field is generally not required.

Experience shows that zero point adjustment is advisable only in special cases:

- To achieve maximum measuring accuracy even with low flow rates
- Under extreme process or operating conditions (e.g. very high process temperatures or very highviscosity fluids).

Protective cover

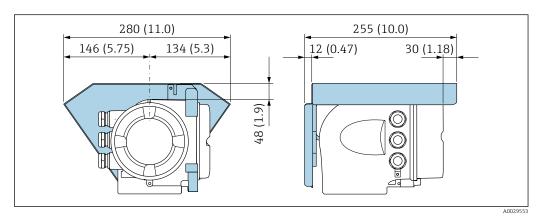


Determining the pitch angle and roll angle

For correct measurement, the pitch angle and roll angle must be determined and entered .



ň

The angle can be entered with an accuracy of ± 10 °.

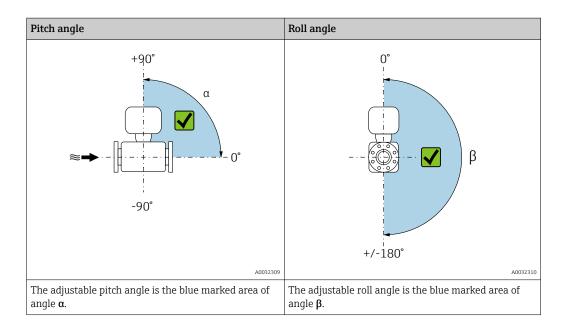


Environment

Ambient temperature range	The) to +60 °C (-4 to +140 °F) readability of the display may be impaired at temperatures outside the perature range.						
	 If operating outdoors: Avoid direct sunlight, particularly in warm climatic regions. You can order a weather protection cover from Endress+Hauser : → ≅ 81 							
Storage temperature	–50 to +80 °C (–58 to +176 °F)							
Climate class	DIN EN 60068-2-38 (test Z/AD)							
Degree of protection	 Transmitter and sensor As standard: IP66/67, type 4X e When housing is open: IP20, type Display module: IP20, type 1 end External WLAN antenna IP67 	be 1 enclosure						
Vibration resistance	 Vibration, sinusoidal according t 2 to 8.4 Hz, 3.5 mm peak 8.4 to 2 000 Hz, 1 g peak Vibration broad-band random, a 10 to 200 Hz, 0.003 g²/Hz 200 to 2 000 Hz, 0.001 g²/Hz Total: 1.54 g rms 	ccording to IEC 60068-2-64						
Shock resistance	Shock, half-sine according to IEC 6 6 ms 30 g	0068-2-27						
Impact resistance	Rough handling shocks according	to IEC 60068-2-31						

Interior cleaning	Cleaning in place (CIP)Sterilization in place (SIP)
	 Options Oil- and grease-free version for wetted parts, without inspection certificate Order code for "Service", option HA Oil- and grease-free version for wetted parts, with inspection certificate according to British Standard – BS IEC 60877:1999+ British Oxygen Cleaning – BOC degreasing specifications 00000- N-S-430-00-01 Order code for "Service", option HB
Electromagnetic compatibility (EMC)	As per IEC/EN 61326 and NAMUR Recommendation 21 (NE 21) For details, refer to the Declaration of Conformity.

Process

Medium temperature range	Standard	-50 to +205 °C (-58 to +401 °F)	
	Low temperature	−196 to +150 °C (−320 to +302 °F)	Order code for "Measuring tube material", option LA

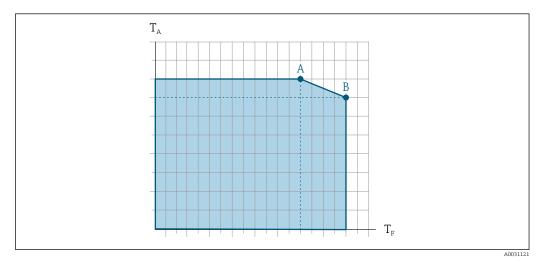

- *T_A Ambient temperature*
- T_F Medium temperature
- Maximum permissible medium temperature at $T_{A max}$ = 60 °C (140 °F); higher medium temperatures require a Α reduction of the ambient temperature T_A (derating)
- В Maximum permitted ambient temperature at the maximum specified medium temperature of the sensor

Sensor	Ν	lot insulated			Insulated						
	А			B A			В				
	T _A	T _F	T _A	T _F	T _A	T _F	T _A	T _F			
Promass Q 300 ¹⁾	60 °C (140 °F)	205 °C (401 °F)	-	-	60 °C (140 °F)	110 °C (230 °F)	50 °C (122 °F)	205 °C (401 °F)			
Promass Q 300 ²⁾	60 °C (140 °F)	150 °C (302 °F)	-	-	60 °C (140 °F)	110 °C (230 °F)	50 °C (122 °F)	150 °C (302 °F)			

Standard version (order code for "Measuring tube mat., wetted surface", option SA) Standard version (order code for "Measuring tube mat., wetted surface", option SB) 1)

2)

Seals No internal seals


Density

0 to 5000 kg/m³ (0 to 312 lb/cf)

Pressure-temperature ratings


The following pressure/temperature diagrams apply to all pressure-bearing parts of the device and not just the process connection.

Flange according to EN 1092-1 (DIN 2501)

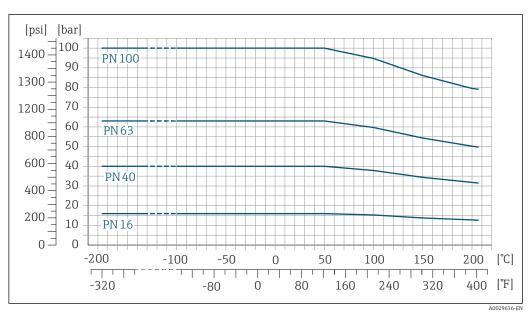




Flange according to ASME B16.5

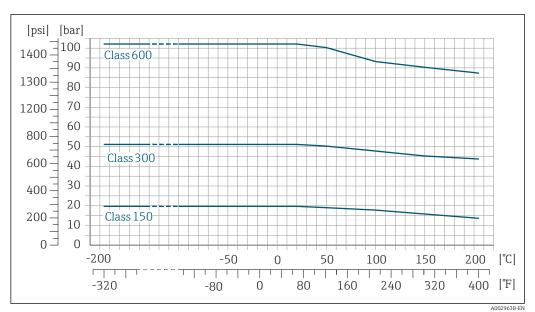

■ 20 With flange material 1.4404 (F316/F316L)

Flange JIS B2220

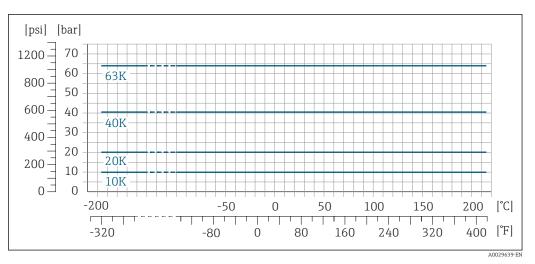

■ 21 With flange material 1.4404 (F316/F316L)

Secondary containment

The sensor housing is filled with helium and protects the electronics and mechanics inside.

The following secondary containment pressure ratings/burst pressures are only valid for standard devices and/or devices equipped with closed purge connections (never opened/as delivered).

If a device fitted with purge connections (order code for "Sensor option", option **CH** "Purge connection") is connected to the purge system, the maximum nominal pressure is determined by the purge system itself or by the device, depending on which component has the lower nominal pressure classification.

If the device is fitted with a rupture disk (order code for "Sensor option", option **CA** "Rupture disk"), the rupture disk trigger pressure is decisive for the maximum nominal pressure $\rightarrow \triangleq 47$.

The secondary containment burst pressure refers to a typical internal pressure achieved prior to mechanical failure of the secondary containment as determined during type testing. The corresponding type test declaration can be ordered with the device (order code for "Additional Approval", option **LN** "Type test containment").

D	N	pressur	ontainment e rating a safety factor 4)	Secondary containment burst pressure			
[mm]	[in]	[bar] [psi]		[bar]	[psi]		
25	1	40	580	290	4205		
50	2	40	580	160	2320		
80	3	25	362	150	2 175		
100	4	25	362	120	1740		

If a measuring tube fails (e.g. due to process characteristics like corrosive or abrasive fluids), the fluid will be contained by the secondary containment.

If there is a need to drain the leaking medium into a discharge device, the sensor should be fitted with a rupture disk. Connect the discharge to the additional threaded connection $\rightarrow \cong 58$.

If the sensor is to be purged with gas (gas detection), it should be equipped with purge connections.

Do not open the purge connections unless the secondary containment can be filled immediately with a dry, inert gas. Use only low pressure to purge. Maximum pressure: 5 bar (72.5 psi).

In case of a tube failure, the pressure level inside the secondary containment will rise according to the operating process pressure. If the user judges that the secondary containment pressure rating/ burst pressure does not provide an adequate safety margin, the device can be fitted with a rupture disk. This will prevent extensive pressure buildup inside the secondary containment and is strongly recommended in high pressure gas applications, especially where the process pressure is higher than the secondary containment burst pressure.

	For information on the dimensions: see the "Mechanical construction" section $\rightarrow \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ $
Rupture disk	To increase the level of safety, a device version with a rupture disk with a trigger pressure of can be used (order code for "Sensor option", option CA "rupture disk").
	Special mounting instructions: → 🗎 41
	For information on the dimensions: $\rightarrow \square 58$
Flow limit	Select the nominal diameter by optimizing between the required flow range and permissible pressure loss.
	For an overview of the full scale values for the measuring range, see the "Measuring range" section
	 The minimum recommended full scale value is approx. 1/20 of the maximum full scale value In most applications, 20 to 50 % of the maximum full scale value can be considered ideal A low full scale value must be selected for abrasive media (such as liquids with entrained solids): flow velocity < 1 m/s (< 3 ft/s).
Pressure loss	To calculate the pressure loss, use the <i>Applicator</i> sizing tool $\rightarrow \cong 82$
System pressure	It is important that cavitation does not occur, or that gases entrained in the liquids do not outgas. This is prevented by means of a sufficiently high system pressure.
	 For this reason, the following mounting locations are recommended: At the lowest point in a vertical pipe Downstream from pumps (no danger of vacuum)
	A002877

Thermal insulation

In the case of some fluids, it is important that the heat radiated from the sensor to the transmitter is kept to a minimum. A wide range of materials can be used for the required insulation.

NOTICE


Danger of overheating with insulation

 Ensure that the temperature at the lower end of the transmitter housing does not exceed 80 °C (176 °F)


NOTICE

The insulation can also be thicker than the maximum recommended insulation thickness. Prerequisite:

- Ensure that convection takes place on a sufficiently large scale at the transmitter neck.
- Ensure that a sufficiently large area of the housing support remains exposed. The uncovered part serves as a radiator and protects the electronics from overheating and excessive cooling.

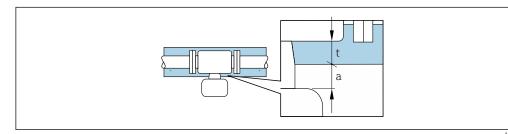

- t Maximum insulation thickness
- a Minimum distance to insulation

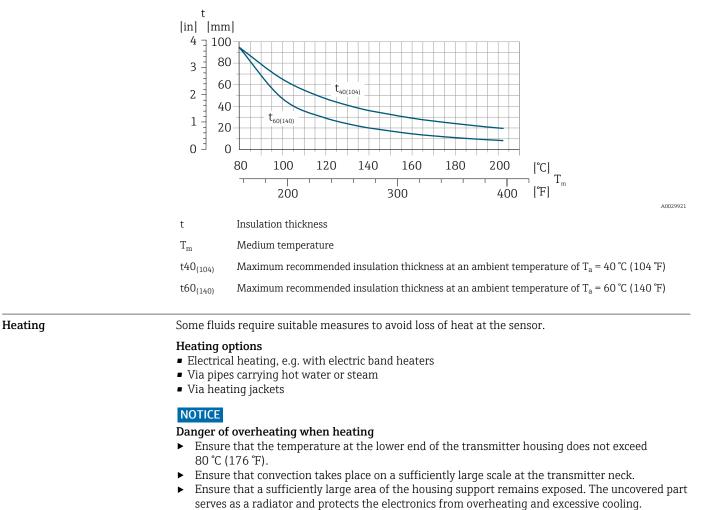

The minimum distance a between the transmitter and the insulation is 10 mm (0.39 in). This is to ensure that the transmitter remains completely exposed.

Vibrations

The operational reliability of the measuring system is not affected by plant vibrations.

Custody transfer measurement


The measuring device is optionally tested in accordance with OIML R81/R117 and has an EC evaluation certificate according to Measuring Instruments Directive 2014/32/EU (MID) for service subject to legal metrological control ("custody transfer") for liquids other than water and cryogenic liquids (Annex MI-005).

The permitted fluid temperature in these applications is -196 to +80 °C (-321 to +176 °F).

The device is used with a legally controlled totalizer on the local display and optionally with legally controlled outputs.


Measuring devices subject to legal metrological control totalize in both directions, i.e. all the outputs consider flow components in the positive (forward) and negative (reverse) flow direction.

Generally a measuring device subject to legal metrological control is secured against tampering by seals on the transmitter or sensor. These seals may normally only be opened by a representative of the competent authority for legal metrology controls.




 Detailed ordering information is available from your local Endress+Hauser sales center for national approvals, which are based on the OIML certificates, for applications with liquids other than water or cryogenic liquids.

Mechanical construction



Compact version

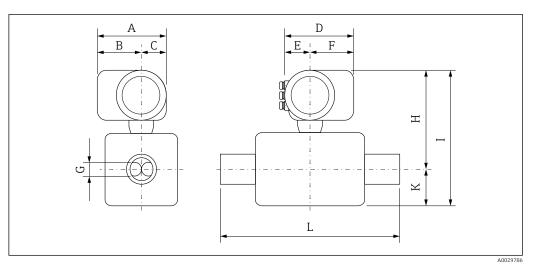

Order code for "Housing", option A "Aluminum, coated"

DN	A 1)	B 1)	С	D ²⁾	E ²⁾	F	G	Н	I	К	L
[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
25	200	141	59	169	68	101	15.2	331.5	548.5	217	3)
50	200	141	59	169	68	101	28.0	352	760	408	3)
80	200	141	59	169	68	101	43.3	379	903	524	3)
100	200	141	59	169	68	101	68.9	405	1060	655	3)

1) For version without local display: values - 30 mm

2) Depending on the cable gland used: values up to + 30 mm

3) dependent on respective process connection

Order code for "Housing", option A "Aluminum, coated"; Ex d

DN	A 1)	B 1)	С	D ²⁾	E ²⁾	F	G	Н	Ι	К	L
[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
25	200	141	59	169	68	101	15.2	361.5	578.5	217	3)
50	200	141	59	169	68	101	28.0	382	790	408	3)
80	200	141	59	169	68	101	43.5	409	933	524	3)
100	200	141	59	169	68	101	68.9	435	1090	655	3)

1) For version without local display: values - 38 mm

2) Depending on the cable gland used: values up to + 30 mm

3) Dependent on the respective process connection

Order code for "Housing", option B "Stainless, hygienic"

DN	A 1)	B 1)	С	D ²⁾	E ²⁾	F	G	Н	I	К	L
[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
25	200	141	59	169	68	101	15.2	330.5	547.5	217	3)
50	200	141	59	169	68	101	28.0	351	759	408	3)

DN	A ¹⁾	B ¹⁾	С	D 2)	E ²⁾	F	G	Н	Ι	К	L
[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
80	200	141	59	169	68	101	43.5	378	902	524	3)
100	200	141	59	169	68	101	68.9	404	1059	655	3)

For version without local display: values - 16 mm 1)

2) 3) Depending on the cable gland used: values up to + 30 mm

Dependent on the respective process connection

Order code	for "Housing",	option L	"Cast,	stainless"


DN	A	В	С	D 1)	Е	F	G	Н	I	К	L
[mm]	[mm]	[mm]	[mm]								
25	200	141	59	169	68	101	15.2	361.5	578.5	217	2)
50	200	141	59	169	68	101	28.0	382	790	408	2)
80	200	141	59	169	68	101	43.5	409	933	524	2)
100	200	141	59	169	68	101	68.9	435	1090	655	2)

Depending on the cable gland used: values up to + 30 mm1)

2) Dependent on the respective process connection

Flange connections

Fixed flange connections EN 1092-1, ASME B16.5, JIS B2220

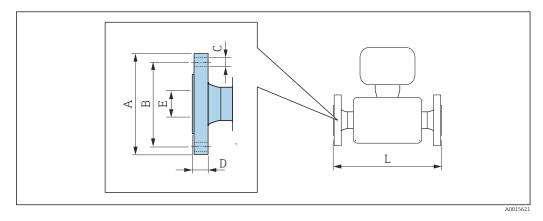

Length tolerance for dimension L in mm: +1.5 / -2.0

Flange according to EN 1092-1 (DIN 2501 / DIN 2512N): PN16 1.4404 (F316/F316L): order code for "Process connection", option D1S									
Flange with groove according to EN 1092-1 Form D (DIN 2512N): PN16 1.4404 (F316/F316L): order code for "Process connection", option D5S									
DN [mm]						L [mm]			
100	220	180	8ר18	20	107.1	1 128			
Surface roughr	Surface roughness (flange): EN 1092-1 Form B1 (DIN 2526 Form C), Ra 3.2 to 12.5 µm								

	Flange according to EN 1092-1 (DIN 2501): PN16 with reduction in nominal diameter 1.4404 (F316/F316L)										
DN [mm]	reduction to DN [mm]	Order code for "Process connection", Option	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]			
100	80	DHS	220	180	8ר18	20	107.1	874			
150	100	DJS	285	240	8 × Ø 22	22	159.3	1167			
Surface	Surface roughness (flange): EN 1092-1 Form B1 (DIN 2526 Form C), Ra 3.2 to 12.5 µm										

Flange according to EN 1092-1 (DIN 2501 / DIN 2512N): PN 40 1.4404 (F316/F316L): order code for "Process connection", option D2S

Flange with groove according to EN 1092-1 Form D (DIN 2512N): PN 40 1.4404 (F316/F316L): order code for "Process connection", option D6S

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]		
25	115	85	$4 \times Ø14$	18	28.5	440
50	165	125	4 × Ø18	20	54.5	715
80	200	160	8 × Ø18	24	82.5	840
100	235	190	8 × Ø22	24	107.1	1 1 2 8
Surface rough	oss (flango). EN	I 1092-1 Eorm E	31 (DIN 2526 Form	(C) Ra 3.2 to 1	25.um	

Surface roughness (flange): EN 1092-1 Form B1 (DIN 2526 Form C), Ra 3.2 to 12.5 μm

Flange according to EN 1092-1 (DIN 2501): PN 40 with reduction in nominal diameter 1.4404 (F316/F316L)

DN [mm]	reduction to DN [mm]	Order code for "Process connection", Option	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]
80	50	DGS	200	160	8ר18	24	82.5	840
100	80	DIS	235	190	8 × Ø 22	24	107.1	874
150	100	DKS	300	250	8 × Ø 26	28	159.3	1167
Surfacor	ughnoss (flang	o). EN 1092-1 Form	B1 (DIN 2	526 Form	$()$ $P_{2} = 3.2 \pm 0.12$	5 um		

Surface roughness (flange): EN 1092-1 Form B1 (DIN 2526 Form C), Ra 3.2 to 12.5 μm

Flange according to EN 1092-1 (DIN 2501 / DIN 2512N): PN 63 1.4404 (F316/F316L): order code for "Process connection", option D3S

Flange with groove according to EN 1092-1 Form D (DIN 2512N): PN 63 1.4404 (F316/F316L): order code for "Process connection", option D7S

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]		
50	180	135	4ר22	26	54.5	724
80	215	170	8 × Ø22	28	81.7	875
100	250	200	8ר26	30	106.3	1128
Surface roughr	uess (flange): EN	1092-1 Form E	31 (DIN 2526 Form	n C). Ra 3.2 to 1	2.5 um	

Endress+Hauser

Flange with groove according to EN 1092-1 Form D (DIN 2512N): PN 100 1.4404 (F316/F316L): order code for "Process connection", option D8S								
DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm		
25	140	100	4 × Ø18	24	28.5	470		
50	195	145	4 × Ø26	28	53.9	740		
80	230	180	8 × Ø26	32	80.9	885		
100	265	210	8 × Ø30	36	104.3	1 128		

Flange according to ASME B16.5: Class 150 1.4404 (F316/F316L)

	Order code for "Process connection", option AAS
--	--

Order code jor	Sider code for Process connection, option AAS										
DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]					
25	110	79.4	4 × Ø15.7	14.2	26.7	440					
50	150	120.7	4 × Ø19.1	19.1	52.6	715					
80	190	152.4	4 × Ø19.1	23.9	78.0	840					
100	230	190.5	8 × Ø19.1	23.9	102.4	1128					
Surface rough	Surface reaching (flam ce) be 2.2 to 6.2 um										

Surface roughness (flange): Ra 3.2 to 6.3 μm

Flange according to ASME B16.5: Class 150 with reduction in nominal diameter 1.4404 (F316/F316L)										
DN [mm]	reduction to DN [mm]	Order code for "Process connection", Option	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]		
80	50	AJS	190	152.4	4 × Ø 19.1	23.9	78.0	720		
100	80	ALS	230	190.5	8 × Ø 19.1	23.9	102.4	874		
150	100	ANS	280	241.3	8 × Ø 22.4	25.4	154.2	1167		
Surface ro	oughness (flang	e): Ra 3.2 to 6.3 µm								

Burrace roughness (in	unge/. nu 9.2	10 0.5	P111
•			

Flange according to ASME B16.5: Class 300 1.4404 (F316/F316L) Order code for "Process connection", option ABS									
DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]			
25	125	88.9	4 × Ø19.1	17.5	26.7	440			
50	165	127	8 × Ø19.1	22.3	52.6	715			
80	210	168.3	8 × Ø22.3	28.4	78.0	840			
100	255	200	8 × Ø22.3	31.7	102.4	1128			
100 255 200 8 × Ø22.3 31.7 102.4 1128 Surface roughness (flange): Ra 3.2 to 6.3 μm									

Flange according to ASME B16.5: Class 300 with reduction in nominal diameter 1.4404 (F316/F316L)											
reduction to DN [mm]	Order code for "Process connection", Option	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]				
50	AKS	210	168.3	8 × Ø 22.3	28.4	78.0	732				
80	AMS	255	200	8 × Ø 22.3	31.7	102.4	894				
100	AOS	320	269.9	12 × Ø 22.3	36.5	154.2	1187				
	7316/F316L) reduction to DN [mm] 50 80 100	reduction to DN [mm] Order code for "Process connection", Option 50 AKS 80 AMS	reduction to DN [mm]Order code for "Process connection", OptionA [mm]50AKS21080AMS255100AOS320	reduction to DN [mm]Order code for "Process connection", OptionA [mm]B [mm]50AKS210168.380AMS255200100AOS320269.9	reduction to DN [mm]Order code for "Process connection", OptionA [mm]B [mm]C [mm]50AKS210168.38 × Ø 22.380AMS2552008 × Ø 22.3100AOS320269.912 × Ø 22.3	reduction to DN [mm] Order code for "Process connection", Option A [mm] B [mm] C [mm] D [mm] 50 AKS 210 168.3 8 × Ø 22.3 28.4 80 AMS 255 200 8 × Ø 22.3 31.7 100 AOS 320 269.9 12 × Ø 22.3 36.5	reduction to DN [mm] Order code for "Process connection", Option A [mm] B [mm] C [mm] D [mm] E [mm] 50 AKS 210 168.3 8 × Ø 22.3 28.4 78.0 80 AMS 255 200 8 × Ø 22.3 31.7 102.4 100 AOS 320 269.9 12 × Ø 22.3 36.5 154.2				

Surface roughness (flange): Ra 3.2 to 6.3 µm

Flange according to ASME B16.5: Class 600 1.4404 (F316/F316L)

Order code for "Process connection", option ACS

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]	
25	125	88.9	4 × Ø19.1	23.9	24.3	490	
50	165	127	8 × Ø19.1	31.8	49.2	742	
80	210	168.3	8 × Ø22.2	40.0	73.7	900	
100	275	215.9	8 × Ø25.4	48.4	97.3	1 1 5 8	
Surface rough	Surface resurbaces (flange): Do 2.2 to 6.2 um						

Surface roughness (flange): Ra 3.2 to 6.3 μm

Flange JIS B2220: 10K 1.4404 (F316/F316L)

Order code for "Process connection", option NDS

Order code jor	TTOLESS CONNECT	1011, 0ption ND .				
DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]
50	155	120	4ר19	16	50	715
80	185	150	8ר19	18	80	832
100	210	175	8 × Ø19	18	100	1 1 2 8
Surface rough	Joss (flango): Ba	3 2 to 6 3 um				

Surface roughness (flange): Ra 3.2 to 6.3 µm

Flange JIS B2220: 20K 1.4404 (F316/F316L) Order code for "Process connection", option NES DN Α В С D Е L [mm] [mm] [mm] [mm] [mm] [mm] [mm] 25 125 90 $4 \times Ø19$ 25 16 440 155 8ר19 715 50 120 18 50 80 200 160 8ר23 22 80 832 225 100 185 8 × Ø23 24 100 1128 Surface roughness (flange): Ra 1.6 to 3.2 μ m

Flange JIS B2220: 40K 1.4404 (F316/F316L) Order code for "Process co


ction" option NGS

oraer code for Process connection, option NGS						
DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]
25	130	95	4 × Ø19	22	25	485
50	165	130	8 × Ø19	26	50	760
80	210	170	8 × Ø23	32	75	890
100	250	205	8 × Ø25	36	100	1168
Surface roughr	ness (flange): Ra	a 1.6 to 3.2 µm				

Flange JIS B2220: 63K 1.4404 (F316/F316L) Order code for "Process connection", option NHS

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]
25	140	100	4 × Ø23	27	22	494
50	185	145	8 × Ø23	34	48	775
80	230	185	8 × Ø25	40	73	915
100	270	220	8 × Ø27	44	98	1168
Surface rough	ness (flange): Ra	1.6 to 3.2 µm			-	

Fixed flange DIN 11864-2

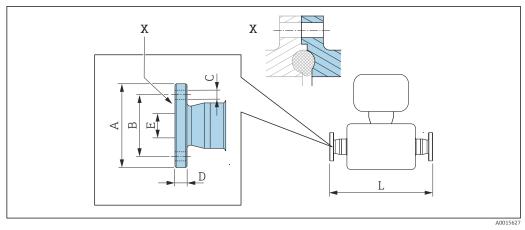

■ 22 Detail X: Asymmetrical process connection; the part shown in blue is provided by the supplier.

Length tolerance for dimension L in mm: +1.5 / -2.0

Flange DIN11864-2 Form A, for pipe according to DIN11866 series A, flat flange 1.4404 (316/316L)

Order code for "Process connection", option KCS

,		, I				
DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]
25	70	53	4 × Ø9	10	26	454
50	94	77	4 × Ø9	10	50	720
80	133	112	8ר11	12	81	900
100	159	137	8ר11	14	100	1128

3A-version available: order code for "Additional approval", option LP in conjunction with Ra $\leq 0.8~\mu m$: Order code for "Measuring tube material", option SB

Flange DIN11864-2 Form A, for pipe according to DIN11866 series A, flat flange with nominal diameter reduction

1.4404 (316/316L)

Order code for "Process connection", option KAS


DN [mm]	reduction to DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]
40	25	82	65	4 × Ø 9	10	38	_ 1)

3A-version available: order code for "Additional approval", option LP in conjunction with Ra $\leq 0.8~\mu m$: Order code for "Measuring tube material", option SB

1) Information on the installation length is available from your Endress+Hauser Sales Center.

Clamp connections

Tri-Clamp

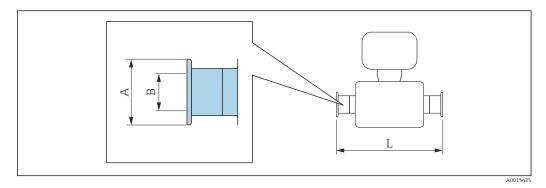



Length tolerance for dimension L in mm: +1.5 / -2.0

1.4404 (316/316L) Order code for "Process connection", option FTS						
DN [mm]	Clamp [in]	A [mm]	B [mm]	L [mm]		
25	1	50.4	22.1	434		
50	2	63.9	47.5	720		
80	3	90.9	72.9	900		
100	4	118.9	97.4	1 128		

Ra \leq 0.8 µm: Order code for "Measuring tube material", option **SB**


Order code for "Process connection", option FAS						
DN [mm]	reduction to DN [mm]	Clamp [in]	A [mm]	B [mm]	L [mm]	
40	25	1½ ¹⁾	50.4	34.80	_ 2)	

1) The connection complies with the hygienic clamp dimensions as per ASME BPE.

2) Information on the installation length is available from your Endress+Hauser Sales Center.

Cable glands

Threaded adapter DIN 11851, DIN11864-1, SMS 1145

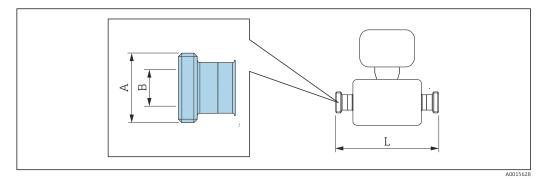

Length tolerance for dimension L in mm: +1.5 / -2.0

Threaded hygienic connection DIN 11851, for pipe according to DIN11866, series A 1.4404 (316/316L)

Order code for "Process connection", option FMW

DN [mm]	A [in]	B [mm]	L [mm]
25	Rd 52 × ¼	26	434
50	Rd 78 × ¹ ⁄ ₆	50	720
80	Rd 110 × ¼	81	900
100	Rd 130 × ¼	100	1128

3A-version available: order code for "Additional approval", option LP in conjunction with Ra $\leq 0.8~\mu m$: Order code for "Measuring tube material", option SB

Threaded hygienic connection DIN11864-1 Form A, for pipe according to DIN11866, series A 1.4404 (316/316L)

Order code for "Process connection", option **FLW**

DN [mm]	A [in]	B [mm]	L [mm]			
25	Rd 52 × ¹ / ₈	26	434			
50	Rd 78 × 1/ ₆	50	720			
80	Rd 110 × ¼	81	900			
100	Rd 130 × ¼	100	1 128			

3A-version available: order code for "Additional approval", option LP in conjunction with Ra $\leq 0.8~\mu m$: Order code for "Measuring tube material", option SB

Threaded hygienic connection SMS 1145

1.4404 (316/316L)


Order code for "Process connection", option SCS

DN [mm]	A [in]	B [mm]	L [mm]			
25	Rd 40 × $\frac{1}{6}$	22.6	434			
50	Rd 70 × 1/ ₆	48.6	720			
80	Rd 98 × 1/ ₆	72.9	900			

Threaded hygienic connection SMS 1145 1.4404 (316/316L) Order code for "Process connection", option SCS						
DN [mm]	A [in]	B [mm]	L [mm]			
100	Rd 132 × ¼	97.6	1128			
	er code for "Additional approval" or "Measuring tube material", op	x 5	h			

Accessories

Purge connections/pressure monitoring of secondary containment/rupture disk

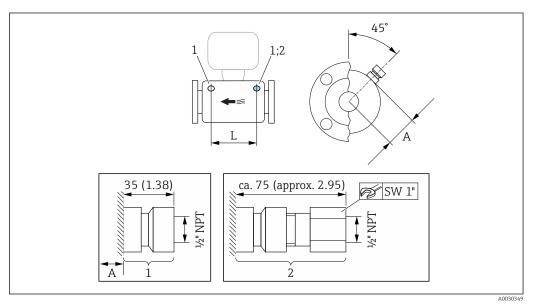


🖻 23 Engineering unit mm (in)

Connection nipple for purge connections/pressure vessel monitoring: order code for "Sensor options", option CH "Purge connection" Connection nipple with rupture disk: order code for "Sensor option", option CA "Rupture disk" 1

2


DN	А	L
[mm]	[mm]	[mm]
25	32	240
50	53	452
80	80	380
100	106	584

Remote display and operating module DKX001

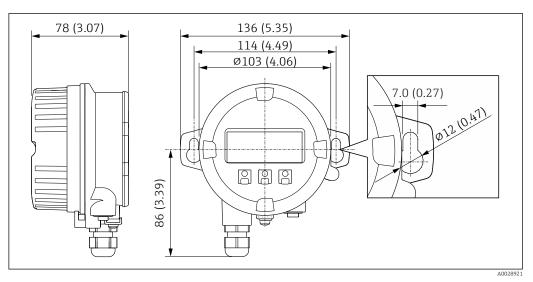

☑ 24 Engineering unit mm (in)


External WLAN antenna

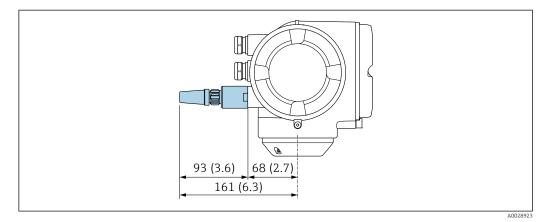

☑ 25 Engineering unit mm (in)

Dimensions in US units

Compact version

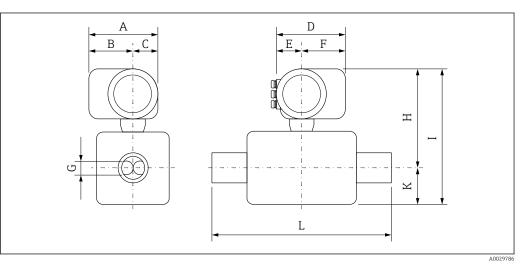

Order code for "Housing", option A "Aluminum, coated"

DN	A 1)	B 1)	С	D ²⁾	E ²⁾	F	G	Н	I	К	L
[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]
1	7.87	5.55	2.32	6.65	2.68	3.98	0.60	13.05	21.60	8.54	3)
2	7.87	5.55	2.32	6.65	2.68	3.98	1.10	13.86	29.92	16.06	3)
3	7.87	5.55	2.32	6.65	2.68	3.98	1.70	14.92	35.55	20.63	3)
4	7.87	5.55	2.32	6.65	2.68	3.98	2.71	15.95	41.73	25.79	3)

1) For version without local display: values - 1.18 in

2) 3) Depending on the cable gland used: values up to + 1.18 in

dependent on respective process connection

DN	A 1)	В	С	D 2)	Е	F	G	Н	I	К	L
[in]	[in]	[in]	[in]								
1	7.87	5.55	2.32	6.65	2.68	3.98	0.60	14.23	22.78	8.54	3)
2	7.87	5.55	2.32	6.65	2.68	3.98	1.10	15.04	31.10	16.06	3)
3	7.87	5.55	2.32	6.65	2.68	3.98	1.71	16.10	36.73	20.63	3)
4	7.87	5.55	2.32	6.65	2.68	3.98	2.71	17.13	42.91	25.79	3)

Order code for "Housing", option A "Aluminum, coated"; Ex d

1) For version without local display: values - 1.49 in

Depending on the cable gland used: values up to + 1.18 in 2)

3) Dependent on the respective process connection

Order code for "Housing", option B "Stainless, hygienic"

DN	A ¹⁾	В	С	D ²⁾	E	F	G	Н	I	К	L
[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]
1	7.87	5.55	2.32	6.65	2.68	3.98	0.60	13.01	21.56	8.54	3)
2	7.87	5.55	2.32	6.65	2.68	3.98	1.10	13.82	29.88	16.06	3)

DN	A 1)	В	С	D ²⁾	E	F	G	Н	I	К	L
[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]
3	7.87	5.55	2.32	6.65	2.68	3.98	1.71	14.88	35.51	20.63	3)
4	7.87	5.55	2.32	6.65	2.68	3.98	2.71	15.91	41.70	25.79	3)

1) For version without local display: values - 0.63 in

2) Depending on the cable gland used: values up to + 1.18 in

3) Dependent on the respective process connection


Order code for "Housing", option L "Cast, stainless"


DN	Α	В	C	D 1)	Е	F	G	Н	I	К	L
[in]	[in]	[in]	[in]								
1	7.87	5.55	2.32	6.65	2.68	3.98	0.60	14.23	22.78	8.54	2)
2	7.87	5.55	2.32	6.65	2.68	3.98	1.10	15.04	31.10	16.06	2)
3	7.87	5.55	2.32	6.65	2.68	3.98	1.71	16.10	36.73	20.63	2)
4	7.87	5.55	2.32	6.65	2.68	3.98	2.71	17.13	42.91	25.79	2)

1) Depending on the cable gland used: values up to + 1.18 mm

2) Dependent on the respective process connection

Fixed flange connections ASME B16.5

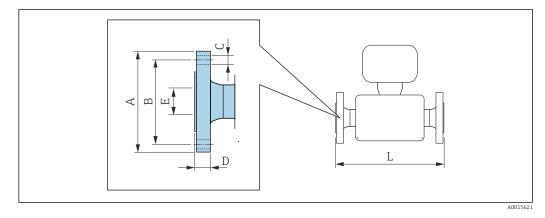



1.4404 (F3	16/F316L)	E B16.5: Class						
DN [in]	A [in]	B [in]	C [in]	D [in]	E [in]	L [in]		
1	4.33	3.13	4 × Ø0.62	0.56	1.05	17.32		
2	5.91	4.75	4 × Ø0.75	0.75	2.07	28.15		
3	7.48	6.00	4 × Ø0.75	0.94	3.07	33.07		
4	9.06	7.50	8 × Ø0.75	0.94	4.03	44.41		
Surface roughness (flange): Ra 125 to 248 µin								

Flange according to ASME B16.5: Class 300 1.4404 (F316/F316L)

Order code for "Process connection", option ABS

Order code	order code for Trocess connection, option Abs								
DN [in]	A [in]	B [in]	C [in]	D [in]	E [in]	L [in]			
1	4.92	3.50	4 × Ø0.75	0.69	1.05	17.32			
2	6.50	5.00	8 × Ø0.75	0.88	2.07	28.15			
3	8.27	6.63	8 × Ø0.88	1.12	3.07	33.07			
4	10.04	7.87	8 × Ø0.88	1.25	4.03	44.41			
Surface rou	abnoss (flango):	Do 125 to 249	uin						


Surface roughness (flange): Ra 125 to 248 μin

Flange according to ASME B16.5: Class 600 1.4404 (F316/F316L) Order code for "Process connection", option ACS

-		•							
DN [in]	A [in]	B [in]	C [in]	D [in]	E [in]	L [in]			
1	4.92	3.50	4 × Ø0.75	0.94	0.96	19.29			
2	6.50	5.00	8 × Ø0.75	1.25	1.94	29.21			
3	8.27	6.63	8 × Ø0.87	1.57	2.90	35.43			
4	10.83	8.50	8 × Ø1.00	1.91	3.83	45.59			
Surface rou	Surface roughness (flange): Ra 125 to 248 µin								

Clamp connections

Tri-Clamp

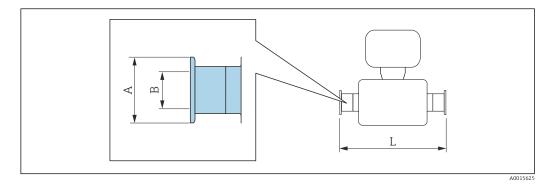

Length tolerance for dimension L in inch: +0.06 / -0.08

Tri-Clamp for pipe according to DIN 11866 series C 1.4404 (316/316L) Order code for "Process connection", option FTS									
DN [in]	Clamp [in]	A [in]	B [in]	L [in]					
1	1	1.98	0.87	17.09					
2	2	2.52	1.87	28.35					
3	3	3.58	2.87	35.43					
4 4 4.68 3.83 44.41									

3A-version available: order code for "Additional approval", option LP in conjunction with Ra \leq 32 μin : Order code for "Measuring tube material", option SB

Tri-Clamp (1½), for pipe according to DIN 11866 series C with nominal diameter reduction
1.4404 (316L)

Order code for "Process connection", option FAS

DN [in]	reduction to DN [in]	Clamp [in]	A [in]	B [in]	L [in]				
1½	1	1½ ¹⁾	1.98	1.37	_ 2)				


3A-version available: order code for "Additional approval", option LP in conjunction with Ra \leq 32 µin: Order code for "Measuring tube material", option SB

1) The connection complies with the hygienic clamp dimensions as per ASME BPE.

2) Information on the installation length is available from your Endress+Hauser Sales Center.

Cable glands

Threaded hygienic connection SMS 1145

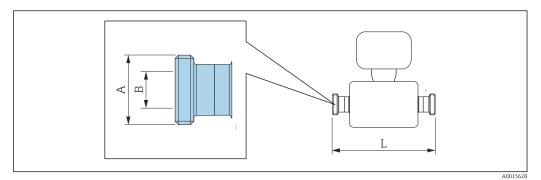




Length tolerance for dimension L in inch: +0.06 / -0.08

Threaded hygienic connection SMS 1145 1.4404 (316/316L) Order code for "Process connection", option SCS			
DN [in]	A [in]	B [in]	L [in]
1	Rd 40 × 1/ ₆	0.904	17.36
2	Rd 70 × 1/ ₆	1.944	28.80
3	Rd 98 × ¹ ⁄ ₆	2.916	36.00
4	Rd 132 × 1/ ₆	3.904	45.12

3A-version available: order code for "Additional approval", option LP in conjunction with Ra \leq 32 μin : Order code for "Measuring tube material", option SB

Accessories

Purge connections/pressure monitoring of secondary containment/rupture disk

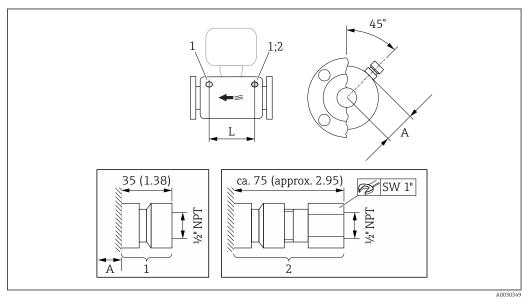


🖻 26 Engineering unit mm (in)

- 1 Connection nipple for purge connections/pressure vessel monitoring:
- order code for "Sensor options", option CH "Purge connection"
- 2 Connection nipple with rupture disk: order code for "Sensor option", option CA "Rupture disk"


DN	А	L
[in]	[in]	[in]
1	1.26	9.45
2	2.09	17.80
3	3.15	14.96
4	4.17	22.99

Remote display and operating module DKX001

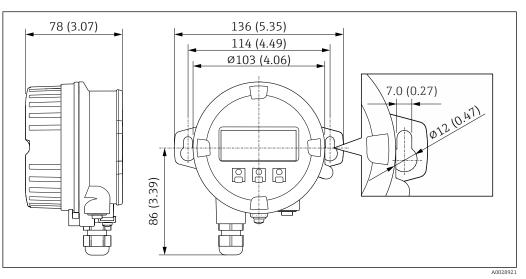

☑ 27 Engineering unit mm (in)

External WLAN antenna

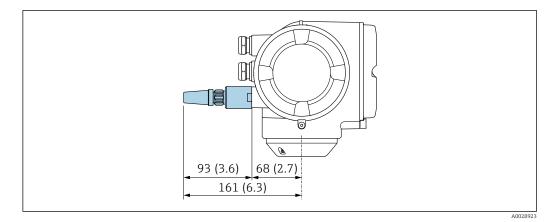

☑ 28 Engineering unit mm (in)

Weight

• All values (weight) refer to devices with EN/DIN PN 40 flanges.

- Weight data including transmitter
- Transmitter version for the hazardous area: +2 kg (+4.4 lbs)
- Cast transmitter version, stainless: +6 kg (+13 lbs)

Weight in SI units

DN [mm]	Weight [kg]
25	11
50	33

DN [mm]	Weight [kg]
80	60
100	149

Weight in US units

DN [in]	Weight [lbs]
1	24
2	73
3	132
4	329

Materials

Transmitter housing

Order code for "Housing":


- Option A "Aluminum, coated": aluminum, AlSi10Mg, coated
- Option L "Cast, stainless": cast, stainless steel, 1.4409 (CF3M) similar to 316L

Window material

Order code for "Housing":

- Option A "Aluminum, coated": glass
- Option L "Cast, stainless": glass

Cable entries/cable glands

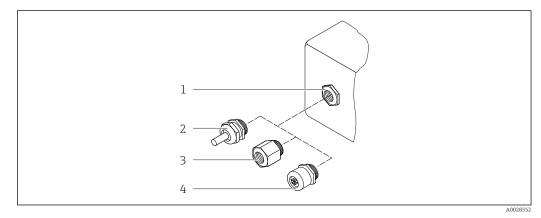

■ 29 Possible cable entries/cable glands

- 1 Cable entry with M20 × 1.5 internal thread
- 2 Cable gland $M20 \times 1.5$
- 3 Adapter for cable entry with internal thread G $\frac{1}{2}$ " or NPT $\frac{1}{2}$ "
- 4 Device plug coupling

Order code for "Housing", option A "Aluminum, coated"

The various cable entries are suitable for hazardous and non-hazardous areas.

Cable entry/cable gland	Material
Cable gland M20 × 1.5	Plastic/nickel-plated brass
Adapter for cable entry with internal thread G $\frac{1}{2}$ "	Nickel-plated brass

Cable entry/cable gland	Material
Adapter for cable entry with internal thread NPT ½"	
Device plug coupling	Plug M12 × 1 • Socket: Stainless steel, 1.4404 (316L) • Contact housing: Polyamide • Contacts: Gold-plated brass

Order code for "Housing", option L "Cast, stainless"

The various cable entries are suitable for hazardous and non-hazardous areas.

Cable entry/cable gland	Material
Cable gland M20 × 1.5	Stainless steel, 1.4404 (316L)
Adapter for cable entry with internal thread G ½"	
Adapter for cable entry with internal thread NPT ½"	
Device plug coupling	Plug M12 × 1 • Socket: Stainless steel, 1.4404 (316L) • Contact housing: Polyamide • Contacts: Gold-plated brass

Device plug

Electrical connection	Material
Plug M12x1	Socket: Stainless steel, 1.4404 (316L)Contact housing: PolyamideContacts: Gold-plated brass

Measuring tubes

Stainless steel, 1.4404 (316/316L); manifold: stainless steel, 1.4404 (316/316L)

Process connections

Flanges according to EN 1092-1 (DIN 2501) / according to ASME B16.5 / as per JIS B2220: Stainless steel, 1.4404 (F316/F316L)



List of all available process connections $\rightarrow \cong 68$

Seals

Welded process connections without internal seals

Accessories

Protective cover

Stainless steel, 1.4404 (316L)

External WLAN antenna


- WLAN antenna: ASA plastic (acrylic ester-styrene-acrylonitrile) and nickel-plated brass
- Adapter: Stainless steel and copper

Process connections	Fixed flange connections: – EN 1092-1 (DIN 2501) flange – EN 1092-1 (DIN 2512N) flange – ASME B16.5 flange – JIS B2220 flange
	For information on the different materials used in the process connections $\rightarrow \square 67$
Surface roughness	All data relate to parts in contact with fluid. The following surface roughness quality can be ordered • Not polished

Ra_{max} = 0.8 μm (32 μin)

Operability

Operating concept	 Operator-oriented menu structure for user-specific tasks Commissioning Operation Diagnostics Expert level Fast and safe commissioning Guided menus ("Make-it-run" wizards) for applications Menu guidance with brief explanations of the individual parameter functions Device access via Web server Optional: WLAN access to device via mobile handheld terminal 		
	 Reliable operation Operation in local language → 68 Uniform operating philosophy applied to device and operating tools If replacing electronic modules, transfer the device configuration via the integrated memory (integrated HistoROM) which contains the process and measuring device data and the event logbook. No need to reconfigure. 		
	 Efficient diagnostics increase measurement availability Troubleshooting measures can be called up via the device and in the operating tools Diverse simulation options, logbook for events that occur and optional line recorder functions 		
Languages	 Can be operated in the following languages: Via local operation English, German, French, Spanish, Italian, Dutch, Portuguese, Polish, Russian, Turkish, Chinese, Japanese, Korean, Arabic, Bahasa (Indonesian), Thai, Vietnamese, Czech, Swedish Via Web browser English, German, French, Spanish, Italian, Dutch, Portuguese, Polish, Russian, Turkish, Chinese, Japanese, Korean, Arabic, Bahasa (Indonesian), Thai, Vietnamese, Czech, Swedish Via Web browser English, German, French, Spanish, Italian, Dutch, Portuguese, Polish, Russian, Turkish, Chinese, Japanese, Korean, Arabic, Bahasa (Indonesian), Thai, Vietnamese, Czech, Swedish Via "FieldCare", "DeviceCare" operating tool: English, German, French, Spanish, Italian, Chinese, Japanese 		
Local operation	 Via display module Two display modules are available: Order code for "Display; operation", option F "4-line, backlit, graphic display; touch control" Order code for "Display; operation", option G "4-line, backlit, graphic display; touch control + WLAN Information about WLAN interface → 73 		

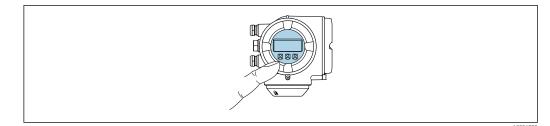

■ 30 Operation with touch control

Display elements


- 4-line, illuminated, graphic display
- White background lighting; switches to red in event of device errors
- Format for displaying measured variables and status variables can be individually configured
- Permitted ambient temperature for the display: -20 to +60 °C (-4 to +140 °F)
- The readability of the display may be impaired at temperatures outside the temperature range.


Operating elements

- External operation via touch control (3 optical keys) without opening the housing: ±, ⊡, ⊑
- Operating elements also accessible in various hazardous areas

Via remote display and operating module DKX001

The remote display and operating module DKX001 is available as an optional extra: Order code for "Display; operation", option **O** "Separate backlit, 4-line display; 10 m (30 ft) Cable; touch control"



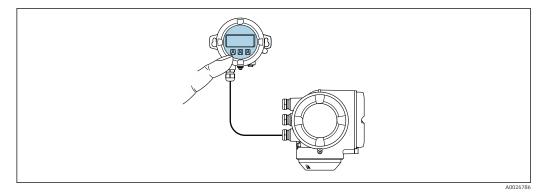

31 Operation via remote display and operating module DKX001

Display and operating elements

The display and operating elements correspond to those of the display module .

- The measuring device is always supplied with a dummy cover when the remote display and operating module DKX001 is used. Display or operation at the transmitter is not possible in this case.

 - If ordered subsequently: The remote display and operating module DKX001 cannot be connected at the same time as the existing display or operation unit. Only one display or operation unit may be connected to the transmitter at any one time.

Material

The housing material of the display and operating module DKX001 depends on the choice of transmitter housing material.

Transmitter housing		Remote display and operating module
Order code for "Housing"	Material	Material
Option A "Aluminum, coated"	AlSi10Mg, coated	AlSi10Mg, coated
Option L "Cast, stainless"	Cast stainless steel, 1.4409 (CF3M) similar to 316L	1.4409 (CF3M)

Cable entry

Corresponds to the choice of transmitter housing, order code for "Electrical connection".

Connecting cable

→ 🗎 35


Dimensions

→ 🗎 59

Remote operation


Via HART protocol

This communication interface is available in device versions with a HART output.

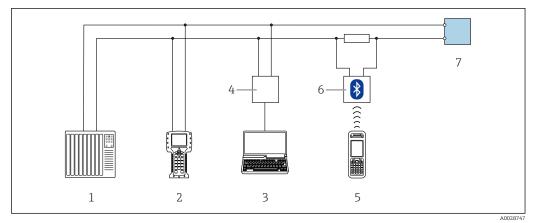

32 Options for remote operation via HART protocol (active)

- 1 Control system (e.g. PLC)
- 2 Field Communicator 475
- 3 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated device Web server or computer with operating tool (e.g. FieldCare, DeviceCare, AMS Device Manager, SIMATIC PDM) with COM DTM "CDI Communication TCP/IP"
- 4 Commubox FXA195 (USB)
- 5 Field Xpert SFX350 or SFX370
- 6 VIATOR Bluetooth modem with connecting cable
- 7 Transmitter

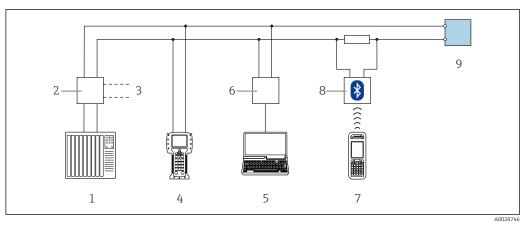


33 Options for remote operation via HART protocol (passive)

- 1 Control system (e.g. PLC)
- 2 Transmitter power supply unit, e.g. RN221N (with communication resistor)
- 3 Connection for Commubox FXA195 and Field Communicator 475
- 4 Field Communicator 475
- 5 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated device Web server or computer with operating tool (e.g. FieldCare, DeviceCare, AMS Device Manager, SIMATIC PDM) with COM DTM "CDI Communication TCP/IP"
- 6 Commubox FXA195 (USB)
- 7 Field Xpert SFX350 or SFX370
- 8 VIATOR Bluetooth modem with connecting cable
- 9 Transmitter

Via FOUNDATION Fieldbus network

This communication interface is available in device versions with FOUNDATION Fieldbus.

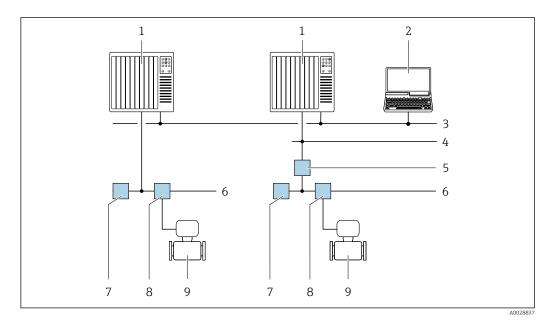


34 Options for remote operation via FOUNDATION Fieldbus network

- 1 Automation system
- 2 Computer with FOUNDATION Fieldbus network card
- 3 Industry network
- 4 High Speed Ethernet FF-HSE network
- 5 Segment coupler FF-HSE/FF-H1
- 6 FOUNDATION Fieldbus FF-H1 network
- 7 Power supply FF-H1 network
- 8 T-box
- 9 Measuring device

Via PROFIBUS PA network

This communication interface is available in device versions with PROFIBUS PA.

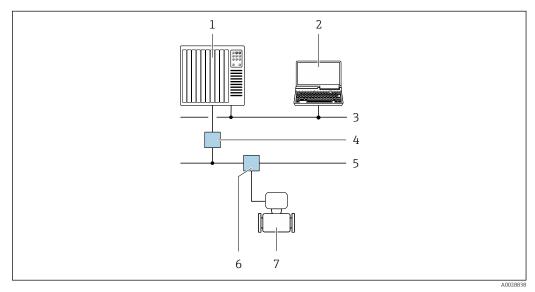


35 Options for remote operation via PROFIBUS PA network

- 1 Automation system
- 2 Computer with PROFIBUS network card
- 3 PROFIBUS DP network
- 4 Segment coupler PROFIBUS DP/PA
- 5 PROFIBUS PA network
- 6 T-box
- 7 Measuring device

Via Modbus RS485 protocol

This communication interface is available in device versions with a Modbus-RS485 output.

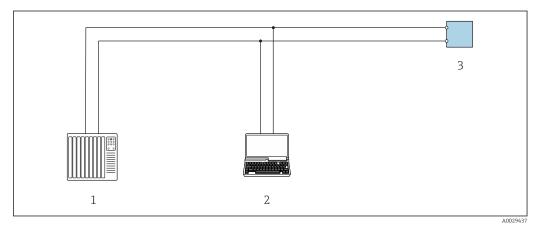


☑ 36 Options for remote operation via Modbus-RS485 protocol (active)

- 1 Control system (e.g. PLC)
- 2 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated device Web server or with operating tool (e.g. FieldCare, DeviceCare) with COM DTM "CDI Communication TCP/IP" or Modbus DTM
- 3 Transmitter

Service interface

Via service interface (CDI-RJ45)

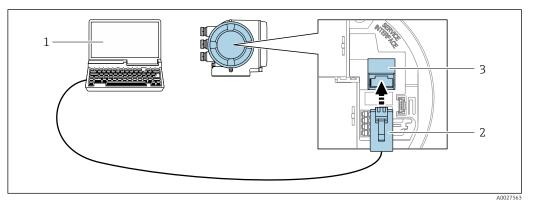


■ 37 Connection via service interface (CDI-RJ45)

- 1 Computer with Web browser (e.g. Microsoft Internet Explorer, Microsoft Edge) for accessing the integrated device Web server or with "FieldCare", "DeviceCare" operating tool with COM DTM "CDI Communication TCP/IP" or Modbus DTM
- 2 Standard Ethernet connecting cable with RJ45 connector
- 3 Service interface (CDI-RJ45) of the measuring device with access to the integrated Web server

Via WLAN interface

The optional WLAN interface is available on the following device version: Order code for "Display; operation", option **G** "4-line, backlit, graphic display; touch control + WLAN"

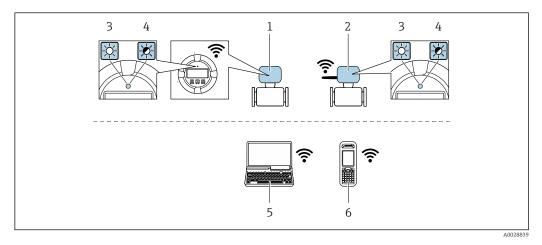

- 1 Transmitter with integrated WLAN antenna
- 2 Transmitter with external WLAN antenna
- 3 LED lit constantly: WLAN reception is enabled on measuring device
- 4 LED flashing: WLAN connection established between operating unit and measuring device
- 5 Computer with WLAN interface and Web browser (e.g. Microsoft Internet Explorer, Microsoft Edge) for accessing the integrated device Web server or with operating tool (e.g. FieldCare, DeviceCare)
- 6 Mobile handheld terminal with WLAN interface and Web browser (e.g. Microsoft Internet Explorer, Microsoft Edge) for accessing the integrated device Web server or operating tool (e.g. FieldCare, DeviceCare)

Wireless LAN	IEEE 802.11 b/g (2.4 GHz) WLAN
Encryption	WPA2 PSK/TKIP AES-128
Configurable channels	1 to 11
Function	Access point with DHCP
Range with integrated antenna	Max. 10 m (32 ft)
Range with external antenna	Max. 50 m (164 ft)

Supported operating tools

Different operating tools can be used for local or remote access to the measuring device. Depending on the operating tool used, access is possible with different operating units and via a variety of interfaces.

Operating unit	Interface	Additional information
Notebook, PC or tablet with Web browser	CDI-RJ45 service interfaceWLAN interface	Special Documentation for the device $\rightarrow \textcircled{B} 84$
Notebook, PC or tablet with Microsoft Windows system	 CDI-RJ45 service interface WLAN interface Fieldbus protocol 	→ 🗎 82
Notebook, PC or tablet with Microsoft Windows system	 CDI-RJ45 service interface WLAN interface Fieldbus protocol 	→ 🗎 82
Field Xpert SFX 100/350/370	HART and FOUNDATION Fieldbus fieldbus protocol	Operating Instructions BA01202S Device description files: Use update function of
	with Web browser Notebook, PC or tablet with Microsoft Windows system Notebook, PC or tablet with Microsoft Windows system Field Xpert SFX	with Web browserinterfaceNotebook, PC or tablet with Microsoft Windows system• CDI-RJ45 service interface • WLAN interface • Fieldbus protocolNotebook, PC or tablet with Microsoft Windows system• CDI-RJ45 service interface • Fieldbus protocolNotebook, PC or tablet with Microsoft Windows system• CDI-RJ45 service interface • Fieldbus protocolField Xpert SFX 100/350/370HART and FOUNDATION Fieldbus

Other operating tools based on FDT technology with a device driver such as DTM/iDTM or DD/EDD can be used for device operation. These operating tools are available from the individual manufacturers. Integration into the following operating tools, among others, is supported:

- Process Device Manager (PDM) by Siemens → www.siemens.com
- Asset Management Solutions (AMS) by Emerson → www.emersonprocess.com
- FieldCommunicator 375/475 by Emerson → www.emersonprocess.com
- Field Device Manager (FDM) by Honeywell → www.honeywellprocess.com
- FieldMate by Yokogawa → www.yokogawa.com
- PACTWare → www.pactware.com

The associated device description files are available at: www.endress.com \rightarrow Downloads

Web server

Thanks to the integrated Web server, the device can be operated and configured via a Web browser and via a service interface (CDI-RJ45) or via a WLAN interface. The structure of the operating menu is the same as for the local display. In addition to the measured values, status information on the device is also displayed and allows the user to monitor the status of the device. Furthermore the device data can be managed and the network parameters can be configured.

A device that has a WLAN interface (can be ordered as an option) is required for the WLAN connection: order code for "Display; operation", option **G** "4-line, illuminated; touch control + WLAN". The device acts as an Access Point and enables communication by computer or a mobile handheld terminal.

Supported functions

Data exchange between the operating unit (such as a notebook for example) and the measuring device:

- Uploading the configuration from the measuring device (XML format, configuration backup)
- Save the configuration to the measuring device (XML format, restore configuration)
- Export event list (.csv file)
- Export parameter settings (.csv file, create documentation of the measuring point configuration)
- Export the Heartbeat verification log (PDF file, only available with the "Heartbeat Verification" application package)
- Flash firmware version for device firmware upgrade, for instance
- Download driver for system integration

HistoROM data management

The measuring device features HistoROM data management. HistoROM data management comprises both the storage and import/export of key device and process data, making operation and servicing far more reliable, secure and efficient.



When the device is delivered, the factory settings of the configuration data are stored as a backup in the device memory. This memory can be overwritten with an updated data record, for example after commissioning.

Additional information on the data storage concept

There are different types of data storage units in which device data are stored and used by the device:

	Device memory	T-DAT	S-DAT
Available data	 Event history, such as diagnostic events Parameter data record backup Device firmware package Driver for system integration e.g.: DD for HART GSD for PROFIBUS PA DD for FOUNDATION Fieldbus 	 Measured value memory ("Extended HistoROM" order option) Current parameter data record (used by firmware at run time) Maximum indicators (min/max values) Totalizer values 	 Sensor data: diameter etc. Serial number User-specific access code (to use the "Maintenance" user role) Calibration data Device configuration (e.g. SW options, fixed I/O or multi I/O)
Storage location	Fixed on the user interface board in the connection compartment	Can be plugged into the user interface board in the connection compartment	In the sensor plug in the transmitter neck part

Data backup

Automatic

- The most important device data (sensor and transmitter) are automatically saved in the DAT modules
- If the transmitter or measuring device is replaced: once the T-DAT containing the previous device data has been exchanged, the new measuring device is ready for operation again immediately without any errors
- If the sensor is replaced: once the sensor has been replaced, new sensor data are transferred from the S-DAT in the measuring device and the measuring device is ready for operation again immediately without any errors

Manual

Additional parameter data record (complete parameter settings) in the integrated device memory for:

- Data backup function
- Backup and subsequent restoration of a device configuration in the device memory
- Data comparison function
- Comparison of the current device configuration with the device configuration saved in the device memory

Data transfer

Manual

Transfer of a device configuration to another device using the export function of the specific operating tool, e.g. with FieldCare, DeviceCare or Web server: to duplicate the configuration or to store in an archive (e.g. for backup purposes)

Event list

Automatic

- Chronological display of up to 20 event messages in the events list
- If the **Extended HistoROM** application package (order option) is enabled: up to 100 event messages are displayed in the events list along with a time stamp, plain text description and remedial measures
- The events list can be exported and displayed via a variety of interfaces and operating tools e.g. DeviceCare, FieldCare or Web server

Data logging

Manual

If the **Extended HistoROM** application package (order option) is enabled:

- Record up to 1000 measured values via 1 to 4 channels
- User configurable recording interval
- Record up to 250 measured values via each of the 4 memory channels
- Export the measured value log via a variety of interfaces and operating tools e.g. FieldCare, DeviceCare or Web server
- Use the recorded measured value data in the integrated device simulation function in the **Diagnostics** submenu.

Service logbook

Manual

- Create up to 20 user-specific events with a date and customized text in a separate logbook for documentation of the measuring point
- Use for calibration or service operations, for example, or for maintenance or revision work that has been performed

Certificates and approvals

CE mark	The measuring system is in conformity with the statutory requirements of the applicable EU Directives. These are listed in the corresponding EU Declaration of Conformity along with the standards applied.				
	Endress+Hauser confirms successful testing of the device by affixing to it the CE mark.				
C-Tick symbol	The measuring system meets the EMC requirements of the "Australian Communications and Media Authority (ACMA)".				
Ex approval	The measuring device is certified for use in hazardous areas and the relevant safety instructions are provided in the separate "Safety Instructions" (XA) document. Reference is made to this document on the nameplate.				
	The separate Ex documentation (XA) containing all the relevant explosion protection data is available from your Endress+Hauser sales center.				
	ATEX/IECEx				
	Currently, the following versions for use in hazardous areas are available:				
	Ex db eb				

Category	Type of protection
II1/2G	Ex db eb ia IIC T6T1 Ga/Gb Ex db eb ia IIB T6T1 Ga/Gb
II2G	Ex db eb ia IIC T6T1 Gb Ex db eb ia IIB T6T1 Gb

Ex db

Category	Type of protection
II1/2G	Ex db ia IIC T6T1 Ga/Gb Ex db ia IIB T6T1 Ga/Gb
II2G	Ex db ia IIC T6T1 Gb Ex db ia IIB T6T1 Gb

Ex ec

Category	Type of protection
II3G	Ex ec IIC T5T1 Gc

Ex tb

Category	Type of protection
II2D	Ex tb IIIC T** °C Db

$_{\rm C}{\rm CSA}_{\rm US}$

Currently, the following versions for use in hazardous areas are available:

	 IS (Ex i) and XP (Ex d) Class I, III, III Division 1 Groups A-G Class I, III, III Division 1 Groups C-G
	NI (Ex nA) Class I Division 2 Groups A - D
	 Ex de Class I, Zone 1 AEx/ Ex de ia IIC T6T1 Ga/Gb Class I, Zone 1 AEx/ Ex de ia IIB T6T1 Ga/Gb Class I, Zone 1 AEx/ Ex de ia IIC T6T1 Gb Class I, Zone 1 AEx/ Ex de ia IIB T6T1 Gb
	 Ex d Class I, Zone 1 AEx/ Ex d ia IIC T6T1 Ga/Gb Class I, Zone 1 AEx/ Ex d ia IIB T6T1 Ga/Gb Class I, Zone 1 AEx/ Ex d ia IIC T6T1 Gb Class I, Zone 1 AEx/ Ex d ia IIB T6T1 Gb
	Ex nA Class I, Zone 2 AEx/ Ex nA IIC T5T1 Gc
	Ex tb Zone 21 AEx/ Ex tb IIIC T** °C Db
Sanitary compatibility	 3-A approval EHEDG-tested
Functional safety	The measuring device can be used for flow monitoring systems (min., max., range) up to SIL 2 (single-channel architecture; order code for "Additional approval", option LA) and SIL 3 (multichannel architecture with homogeneous redundancy) and is independently evaluated and certified by the TÜV in accordance with IEC 61508.
	The following types of monitoring in safety equipment are possible: • Mass flow • Volume flow • Density
	Functional Safety Manual with information on the SIL device $\rightarrow \cong 84$
HART certification	HART interface
	The measuring device is certified and registered by the FieldComm Group. The measuring system meets all the requirements of the following specifications: • Certified according to HART 7
	- The device any place he experted with contified devices of other menufacturers (interesperchility)

• The device can also be operated with certified devices of other manufacturers (interoperability)

FOUNDATION Fieldbus	FOUNDATION Fieldbus interface							
certification	 The measuring device is certified and registered by the FieldComm Group. The measuring system meets all the requirements of the following specifications: Certified in accordance with FOUNDATION Fieldbus H1 							
	 Interoperability Test Kit (ITK), revision version 6.1.2 (certificate available on request) Physical Layer Conformance Test The device can also be operated with certified devices of other manufacturers (interoper 							
Certification PROFIBUS	PROFIBUS interface							
	measuri • Certifi	suring device is certified as ng system meets all the rec ed in accordance with PRO	quireme FIBUS F	ents of the fo PA Profile 3	ollowing sj .02	pecifications:		
	Ine de	evice can also be operated v	with ter			manufacturers (interoperability)	
Modbus RS485 certification	"MODBU	nsuring device meets all the IS/TCP Conformance Test F est procedures carried out.						
Radio approval	Europe: RED 201	L4/53/EU						
		tates of America: e 47, FCC Part 15.247						
	Canada: RSS-247 Issue 1							
	Japan: Article 2 clause 1 item 19							
	Additional country-specific approvals on request.							
Measuring instrument approval	The measuring device is (optionally) approved as a gas meter (MI-002) or component systems (MI-005) in service subject to legal metrological control in accordance with th Measuring Instruments Directive 2004/22/EC (MID).							
	The measuring device is qualified to OIML R117 or OIML R137 and has an OIML Certificate of Conformity (optional).					Certificate of		
Additional certification	CRN app	proval						
	Some device versions have CRN approval. A CRN-approved process connection with a CSA approval must be ordered for a CRN-approved device.							
	Tests and certificates							
	 Pressure test, internal procedure, inspection certificate EN10204-3.1 Material certificate, wetted parts and secondary containment PMI test (XRF), internal procedure, wetted parts, test report EN10204-2.1 confirmation of compliance with the order and EN10204-2.2 test report 							
	Testing of welded connections							
	Option Test standard Comport						iponent	
		ISO 23277 AL2x (PT) ISO 10675-1 AL1 (RT, DR)	ASME B31.3 NFS	ASME VIII Div.1 Appx. 4+8	NORSOK M-601	Measuring tube	Process connection	
	CF	X				PT	RT	
	KK		x			PT	RT	
	KP			x		PT	RT	
						1		
	KR				x	VT, PT	VT, RT	
	KR K1	X			x	VT, PT PT	VT, RT DR	

	Option	Option Test standard				Component	
		ISO 23277 AL2x (PT) ISO 10675-1 AL1 (RT, DR)	ASME B31.3 NFS	ASME VIII Div.1 Appx. 4+8	NORSOK M-601	Measuring tube	Process connection
	К3			х		PT	DR
	K4				x	VT, PT	VT, DR
		PT = penetrant testing, RT = r		ohic testing, V options with t		testing, DR = digita	l radiography
Other standards and guidelines	 IEC/EI Enviro device EN 61 Safety genera IEC/EI Emiss requir NAMU Electra NAMU Data r microj NAMU Standa analog NAMU Softwa NAMU Self-m NAMU Coriol ETSI E Guidel EN 30 	es of protection provided b N 60068-2-6 onmental influences: Test p N 60068-2-31 onmental influences: Test p es. .010-1 requirements for electrica al requirements N 61326 ion in accordance with Class ements). JR NE 21 omagnetic compatibility (E JR NE 32 retention in the event of a p processors JR NE 43 ardization of the signal lev g output signal. JR NE 53 are of field devices and sign JR NE 53 are of field devices and sign JR NE 105 ications for integrating fiel JR NE 107 nonitoring and diagnosis of JR NE 131 rements for field devices for JR NE 132 is mass meter EN 300 328 lines for 2.4 GHz radio com	procedui procedui l equipr ss A req (MC) of power fa cower fa el for th nal-proc quipme dbus de field do r standa	re - Test Fc: re - Test Ec: nent for me uirements. T industrial p ailure in fiel e breakdow ressing devic nt directive rvices in eng evices ard applicat s.	vibrate (si shocks du asuremen Electroma rocess and d and cont n informa ces with di to process ineering t ions	e to rough handl t, control and lab gnetic compatibil l laboratory contr trol instruments tion of digital tra igital electronics s control devices ools for field devi	ooratory use - lity (EMC rol equipment with .nsmitters with

Ordering information

Detailed ordering information is available from the following sources:

- In the Product Configurator on the Endress+Hauser website: www.endress.com -> Click "Corporate"
 -> Select your country -> Click "Products" -> Select the product using the filters and search field ->
 Open product page -> The "Configure" button to the right of the product image opens the Product
 Configurator.
- From your Endress+Hauser Sales Center: www.addresses.endress.com

Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
 - Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
 - Automatic verification of exclusion criteria
 - Automatic creation of the order code and its breakdown in PDF or Excel output format
 - Ability to order directly in the Endress+Hauser Online Shop

Application packages

Many different application packages are available to enhance the functionality of the device. Such packages might be needed to address safety aspects or specific application requirements.

The application packages can be ordered with the device or subsequently from Endress+Hauser. Detailed information on the order code in question is available from your local Endress+Hauser sales center or on the product page of the Endress+Hauser website: www.endress.com.

Detailed information on the application packages: Special Documentation for the device

Diagnostics functions	Package	Description
	Extended HistoROM	Comprises extended functions concerning the event log and the activation of the measured value memory.
		Event log: Memory volume is extended from 20 message entries (standard version) to up to 100 entries.
		 Data logging (line recorder): Memory capacity for up to 1000 measured values is activated. 250 measured values can be output via each of the 4 memory channels. The recording interval can be defined and configured by the user. Measured value logs can be accessed via the local display or operating tool e.g. FieldCare, DeviceCare or Web server.
Heartbeat Technology	Package	Description
	Heartbeat Verification +Monitoring	 Heartbeat Monitoring Continuously supplies data, which are characteristic of the measuring principle, to an external condition monitoring system for the purpose of preventive maintenance or process analysis. These data enable the operator to: Draw conclusions - using these data and other information - about the impact process influences (such as corrosion, abrasion, buildup etc.) have on the measuring performance over time. Schedule servicing in time. Monitor the process or product quality, e.g. gas pockets.
		 Heartbeat Verification Meets the requirement for traceable verification to DIN ISO 9001:2008 Chapter 7.6 a) "Control of monitoring and measuring equipment". Functional testing in the installed state without interrupting the process. Traceable verification results on request, including a report. Simple testing process via local operation or other operating interfaces. Clear measuring point assessment (pass/fail) with high test coverage within the framework of manufacturer specifications. Extension of calibration intervals according to operator's risk assessment.

Concentration	Package	Description
		Calculation and outputting of fluid concentrations Many applications use density as a key measured value for monitoring quality or controlling processes. The device measures the density of the fluid as standard and makes this value available to the control system.
		 With the help of the "Concentration Measurement" application package, the measured density is used to calculate other process parameters: Temperature-compensated density (reference density). Percentage mass of the individual substances in a two-phase fluid. (Concentration in %). Fluid concentration is output with special units ("Brix, "Baumé, "API, etc.) for standard applications.

Accessories

Various accessories, which can be ordered with the device or subsequently from Endress+Hauser, are available for the device. Detailed information on the order code in question is available from your local Endress+Hauser sales center or on the product page of the Endress+Hauser website: www.endress.com.

Accessories	1
	Description
Transmitter Promass 300	Transmitter for replacement or storage. Use the order code to define the following specifications: Approvals Output Input Display / operation Housing Software For details, see Installation Instructions EA01150
Remote display and operating module DKX001	The remote display and operating module DKX001 is available as an optional extra: Order code for "Display; operation", option O "Separate backlit, 4-line display; 10 m (30 ft) Cable; touch control" The remote display and operating module DKX001 can also be ordered separately
	and subsequently as an accessory without a measuring device . The mounting bracket can be ordered directly with the DKX001 (order code DKX001: order code for "Accessory enclosed", option RA "Mounting bracket, 1"/2" pipe"). It is also available as a separate accessory. Order number: 71130772
	f Further information on display and operating module DKX001 \rightarrow 🗎 69.
	For details, see Special Documentation SD01763D
WLAN antenna Wide range	External WLAN antenna for a range of up to 50 m (165 ft). Further information on the WLAN interface → 73.
Protective cover	Is used to protect the measuring device from the effects of the weather: e.g. rainwater, excess heating from direct sunlight.
	Remote display and operating module DKX001 WLAN antenna Wide range

For the sensor

Accessories	Description	
Heating jacket	Is used to stabilize the temperature of the fluids in the sensor. Water, water vapor and other non-corrosive liquids are permitted for use as fluids. If using oil as a heating medium, please consult with Endress+Hauser.	

Communication-specific	Accessories	Description
accessories	Commubox FXA195	For intrinsically safe HART communication with FieldCare via the USB interface.
	HART	For details, see "Technical Information" TI00404F
	HART Loop Converter HMX50	Is used to evaluate and convert dynamic HART process variables to analog current signals or limit values.
		For details, see "Technical Information" TI00429F and Operating Instructions BA00371F
	Fieldgate FXA320	Gateway for the remote monitoring of connected 4 to 20 mA measuring devices via a Web browser.
		For details, see "Technical Information" TI00025S and Operating Instructions BA00053S
	Fieldgate FXA520	Gateway for the remote diagnostics and remote configuration of connected HART measuring devices via a Web browser.
		For details, see "Technical Information" TI00025S and Operating Instructions BA00051S
	Field Xpert SFX350	Field Xpert SFX350 is a mobile computer for commissioning and maintenance. It enables efficient device configuration and diagnostics for HART and FOUNDATION Fieldbus devices in the non-Ex area .
		For details, see Operating Instructions BA01202S
	Field Xpert SFX370	Field Xpert SFX370 is a mobile computer for commissioning and maintenance. It enables efficient device configuration and diagnostics for HART and FOUNDATION Fieldbus devices in the non-Ex area and the Ex area .
		For details, see Operating Instructions BA01202S

Service-specific accessories	Accessories	Description
	Applicator	 Software for selecting and sizing Endress+Hauser measuring devices: Choice of measuring devices for industrial requirements Calculation of all the necessary data for identifying the optimum flowmeter: e.g. nominal diameter, pressure loss, flow velocity and accuracy. Graphic illustration of the calculation results Determination of the partial order code, administration, documentation and access to all project-related data and parameters over the entire life cycle of a project.
		Applicator is available:Via the Internet: https://wapps.endress.com/applicatorAs a downloadable DVD for local PC installation.
	W@M	W@M Life Cycle Management Improved productivity with information at your fingertips. Data relevant to a plant and its components is generated from the first stages of planning and during the asset's complete life cycle. W@M Life Cycle Management is an open and flexible information platform with online and on-site tools. Instant access for your staff to current, in-depth data shortens your plant's engineering time, speeds up procurement processes and increases plant uptime. Combined with the right services, W@M Life Cycle Management boosts productivity in every phase. For more information, visit www.endress.com/lifecyclemanagement

FieldCare	FDT-based plant asset management tool from Endress+Hauser. It can configure all smart field units in your system and helps you manage them. By using the status information, it is also a simple but effective way of checking their status and condition. For details, see Operating Instructions BA00027S and BA00059S
DeviceCare	Tool for connecting and configuring Endress+Hauser field devices.

System components

Accessories	Description
Memograph M graphic display recorder	The Memograph M graphic display recorder provides information on all relevant measured variables. Measured values are recorded correctly, limit values are monitored and measuring points analyzed. The data are stored in the 256 MB internal memory and also on a SD card or USB stick.
	For details, see "Technical Information" TI00133R and Operating Instructions BA00247R
Cerabar M	The pressure transmitter for measuring the absolute and gauge pressure of gases, steam and liquids. It can be used to read in the operating pressure value.
	For details, see "Technical Information" TI00426P, TI00436P and Operating Instructions BA00200P, BA00382P
Cerabar S	The pressure transmitter for measuring the absolute and gauge pressure of gases, steam and liquids. It can be used to read in the operating pressure value.
	For details, see "Technical Information" TI00383P and Operating Instructions BA00271P
iTEMP	The temperature transmitters can be used in all applications and are suitable for the measurement of gases, steam and liquids. They can be used to read in the fluid temperature.
	For details, see "Fields of Activity", FA00006T

Supplementary documentation

For an overview of the scope of the associated Technical Documentation, refer to the following: • The *W@M Device Viewer* : Enter the serial number from the nameplate

- (www.endress.com/deviceviewer)
- The *Endress+Hauser Operations App*: Enter the serial number from the nameplate or scan the 2-D matrix code (QR code) on the nameplate.

Standard documentation Brief Operating Instructions

Part 1 of 2: Sensor

Measuring device	Documentation code
Proline Promass	KA01212D

Part 2 of 2: Transmitter

	Documentation code			
Measuring device	HART	FOUNDATION Fieldbus	PROFIBUS PA	Modbus RS485
Proline 300	KA01226D	KA01229D	KA01227D	KA01228D

Operating Instructions

Measuring device	Documentation			
	HART FOUNDATION PROFIBUS PA Modbus RS485 Fieldbus			Modbus RS485
Promass Q 300	BA01490D	BA01523D	BA01512D	BA01501D

Description of device parameters

	Documentation code			
Measuring device	HART	FOUNDATION Fieldbus	PROFIBUS PA	Modbus RS485
Promass 300	GP01057D	GP01094D	GP01058D	GP01059D

Supplementary devicedependent documentation

Safety Instructions

Contents	Documentation code
ATEX/IECEx Ex d/Ex de	XA01405D
ATEX/IECEx Ex ec	XA01439D
cCSAus XP	XA01373D
cCSAus Ex d/ Ex de	XA01372D
cCSAus Ex nA	XA01507D
INMETRO Ex d/Ex de	XA01468D
INMETRO Ex ec	XA01470D
NEPSI Ex d/Ex de	XA01469D
NEPSI Ex nA	XA01471D

Remote display and operating module DKX001

Contents	Documentation code
ATEX/IECEx Ex i	XA01494D
ATEX/IECEx Ex ec	XA01498D
cCSAus IS	XA01499D
cCSAus Ex nA	XA01513D
INMETRO Ex i	XA01500D
INMETRO Ex ec	XA01501D
NEPSI Ex i	XA01502D
NEPSI Ex nA	XA01503D

Special documentation

Contents	Documentation code
Information on the Pressure Equipment Directive	SD01614D
Functional Safety Manual	SD01727D
Remote display and operating module DKX001	SD01763D

Contents	Documentation				
	HART	FOUNDATION Fieldbus	PROFIBUS PA	Modbus RS485	
Web server	SD01662D	SD01665D	SD01664D	SD01663D	
Heartbeat Technology	SD01642D	SD01696D	SD01698D	SD01697D	
Concentration measurement	SD01644D	SD01706D	SD01708D	SD01707D	
Custody transfer	SD01688D	-	-	SD01689D	

Installation Instructions

Contents	Documentation code
Installation Instructions for spare part sets	Specified for each individual accessory

Registered trademarks

HART®

Registered trademark of the FieldComm Group, Austin, Texas, USA

PROFIBUS®

Registered trademark of the PROFIBUS User Organization, Karlsruhe, Germany

FOUNDATIONTM Fieldbus

Registration-pending trademark of the FieldComm Group, Austin, Texas, USA

Modbus®

Registered trademark of SCHNEIDER AUTOMATION, INC.

www.addresses.endress.com

